


[REDACTED] Plant Test: [REDACTED]
Summary of Results

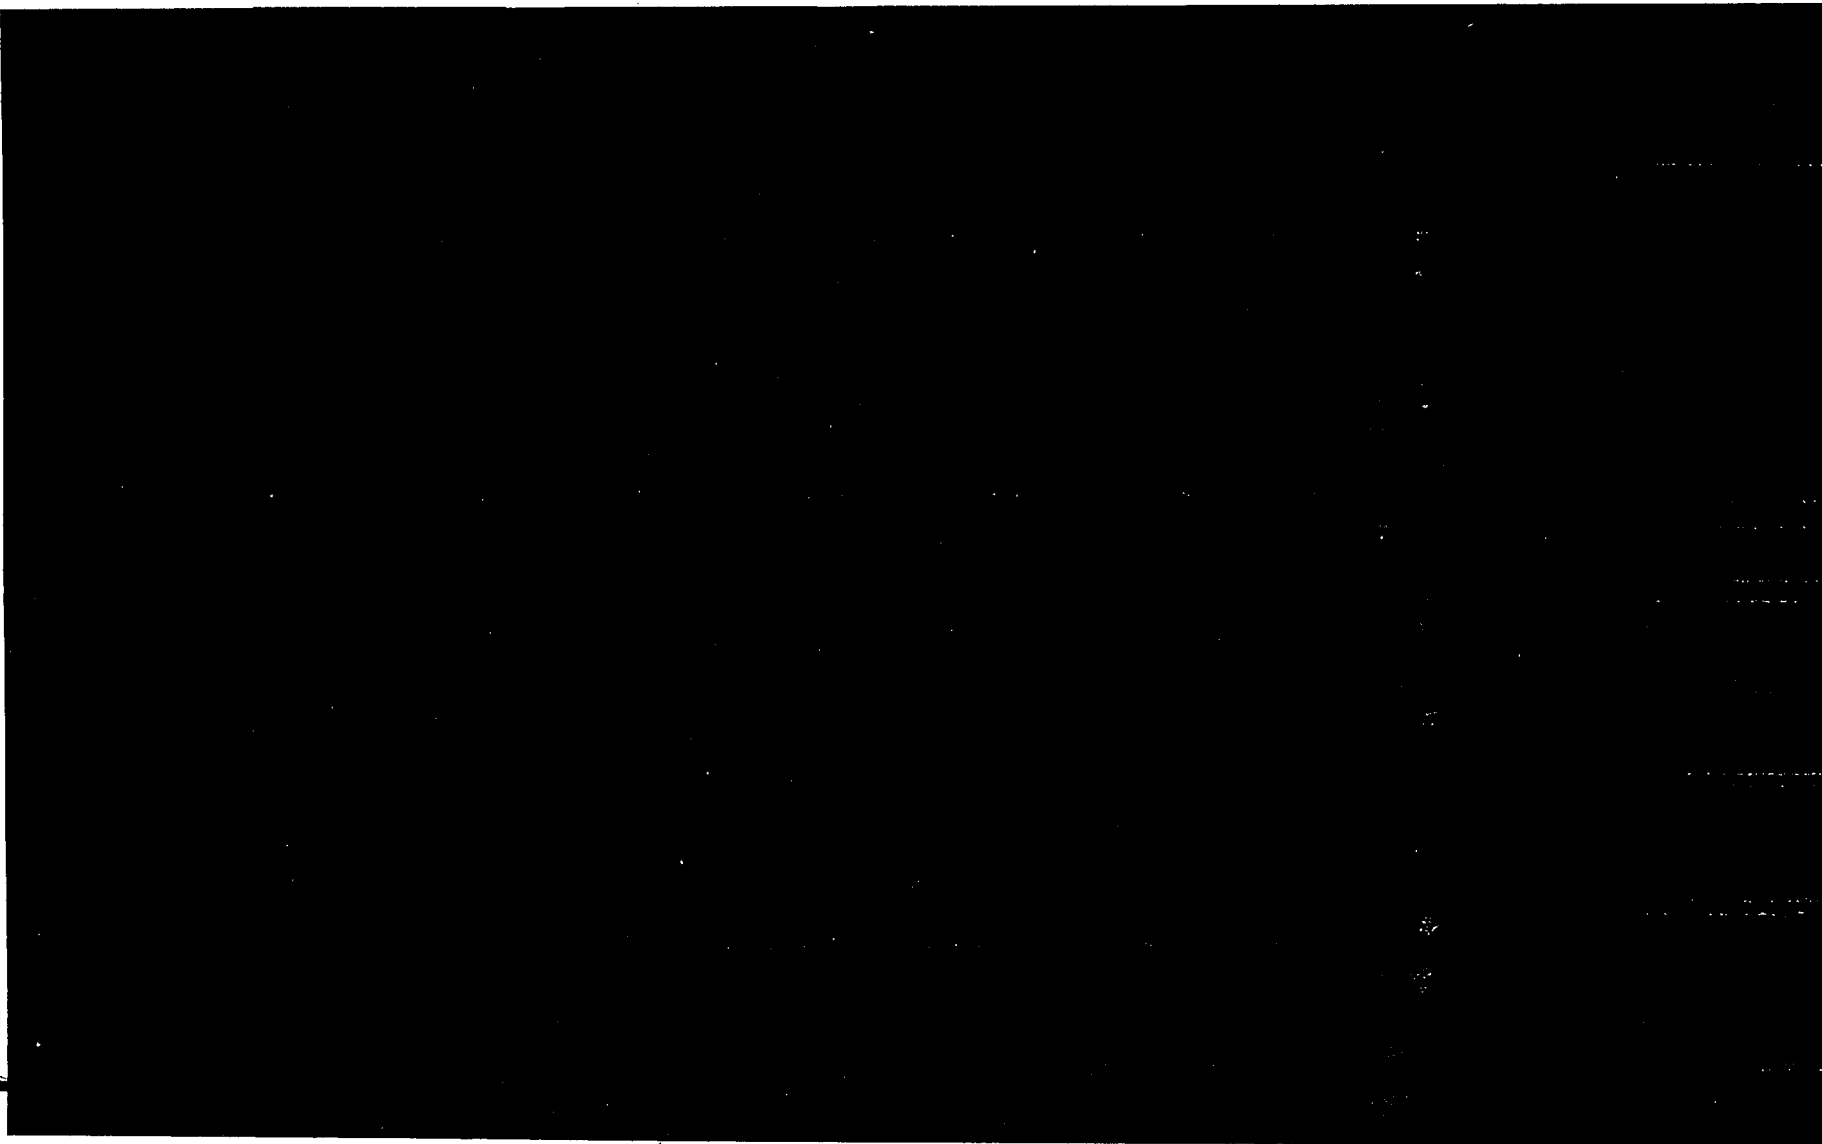


9-Jan-2004

DuPont Confidential

Company Sanitized. Does not contain TSCA CBI

[REDACTED] Plant Test: [REDACTED]
Summary of Results

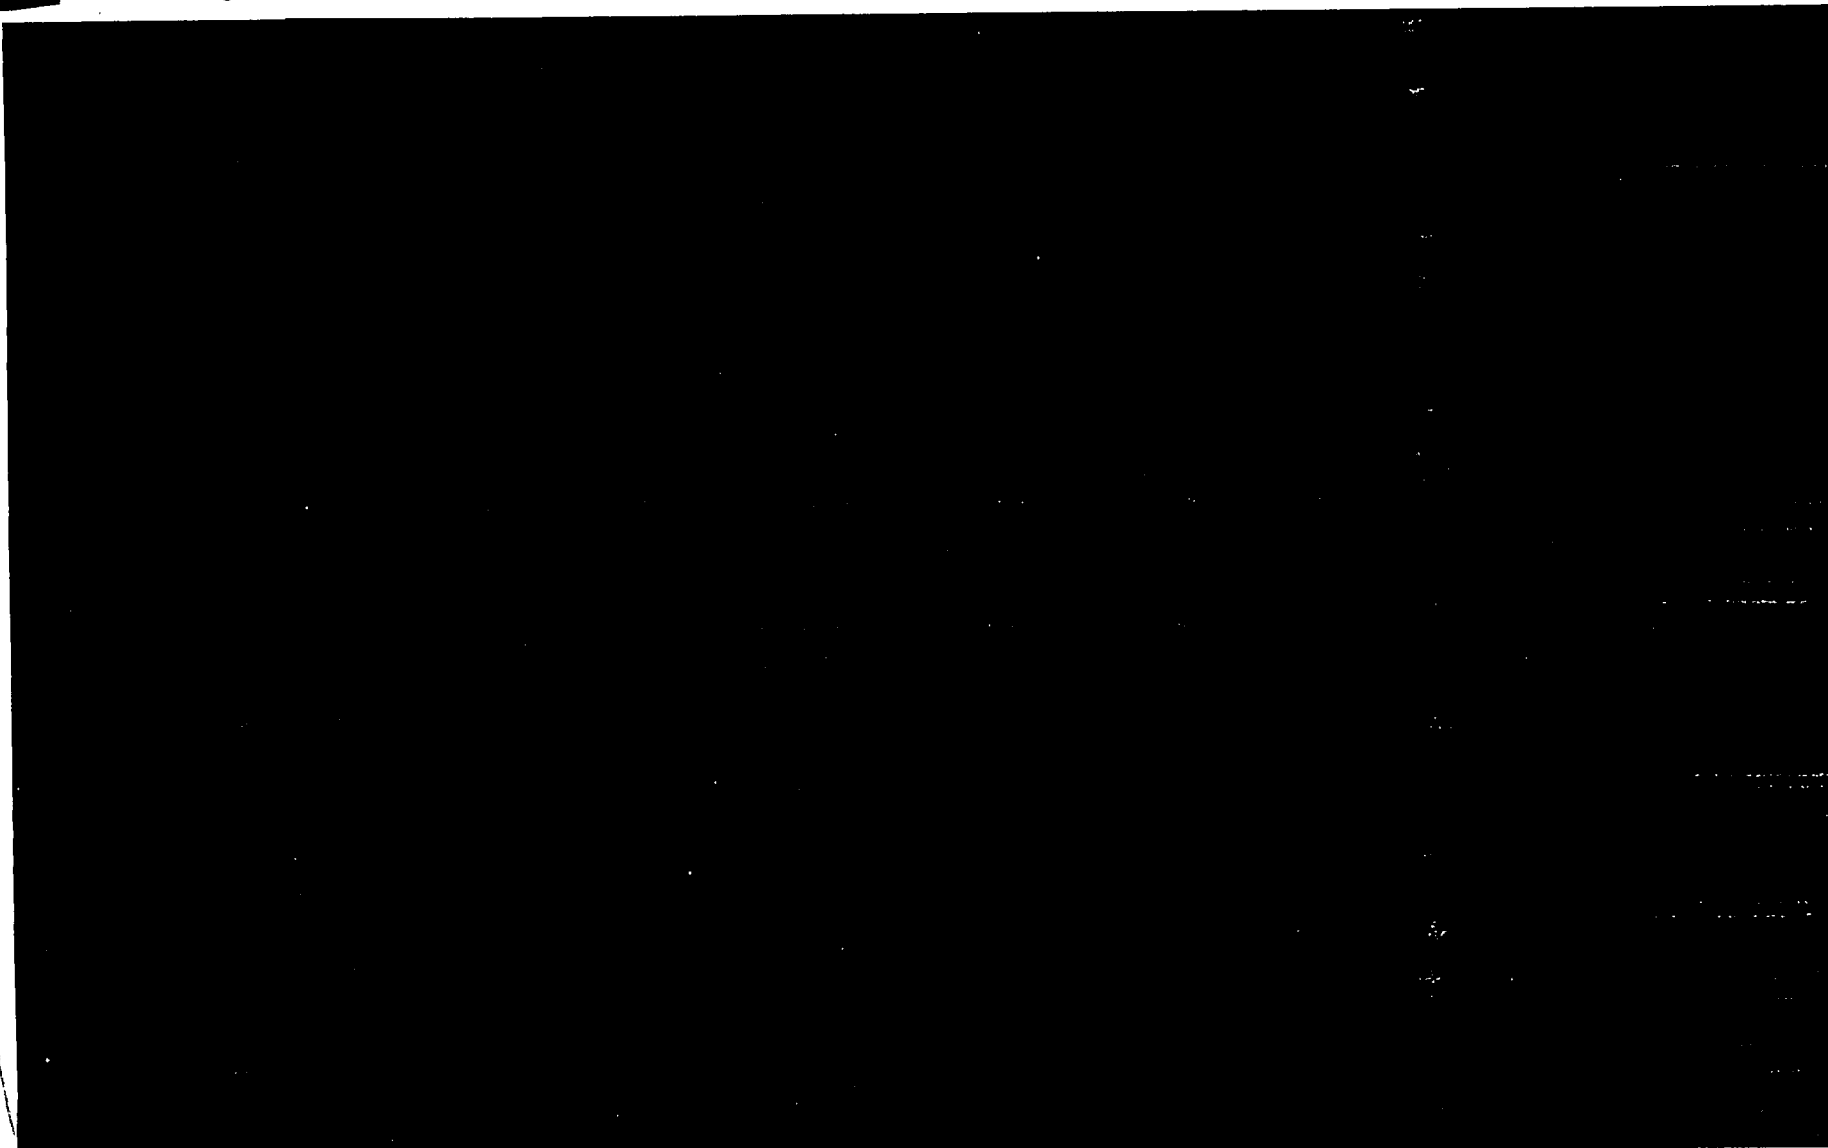


9-Jan-2004

DuPont Confidential

2

Company Sanitized. Does not contain TSCA CBI

DOE Used to Screen Main Effects on PFOA Levels

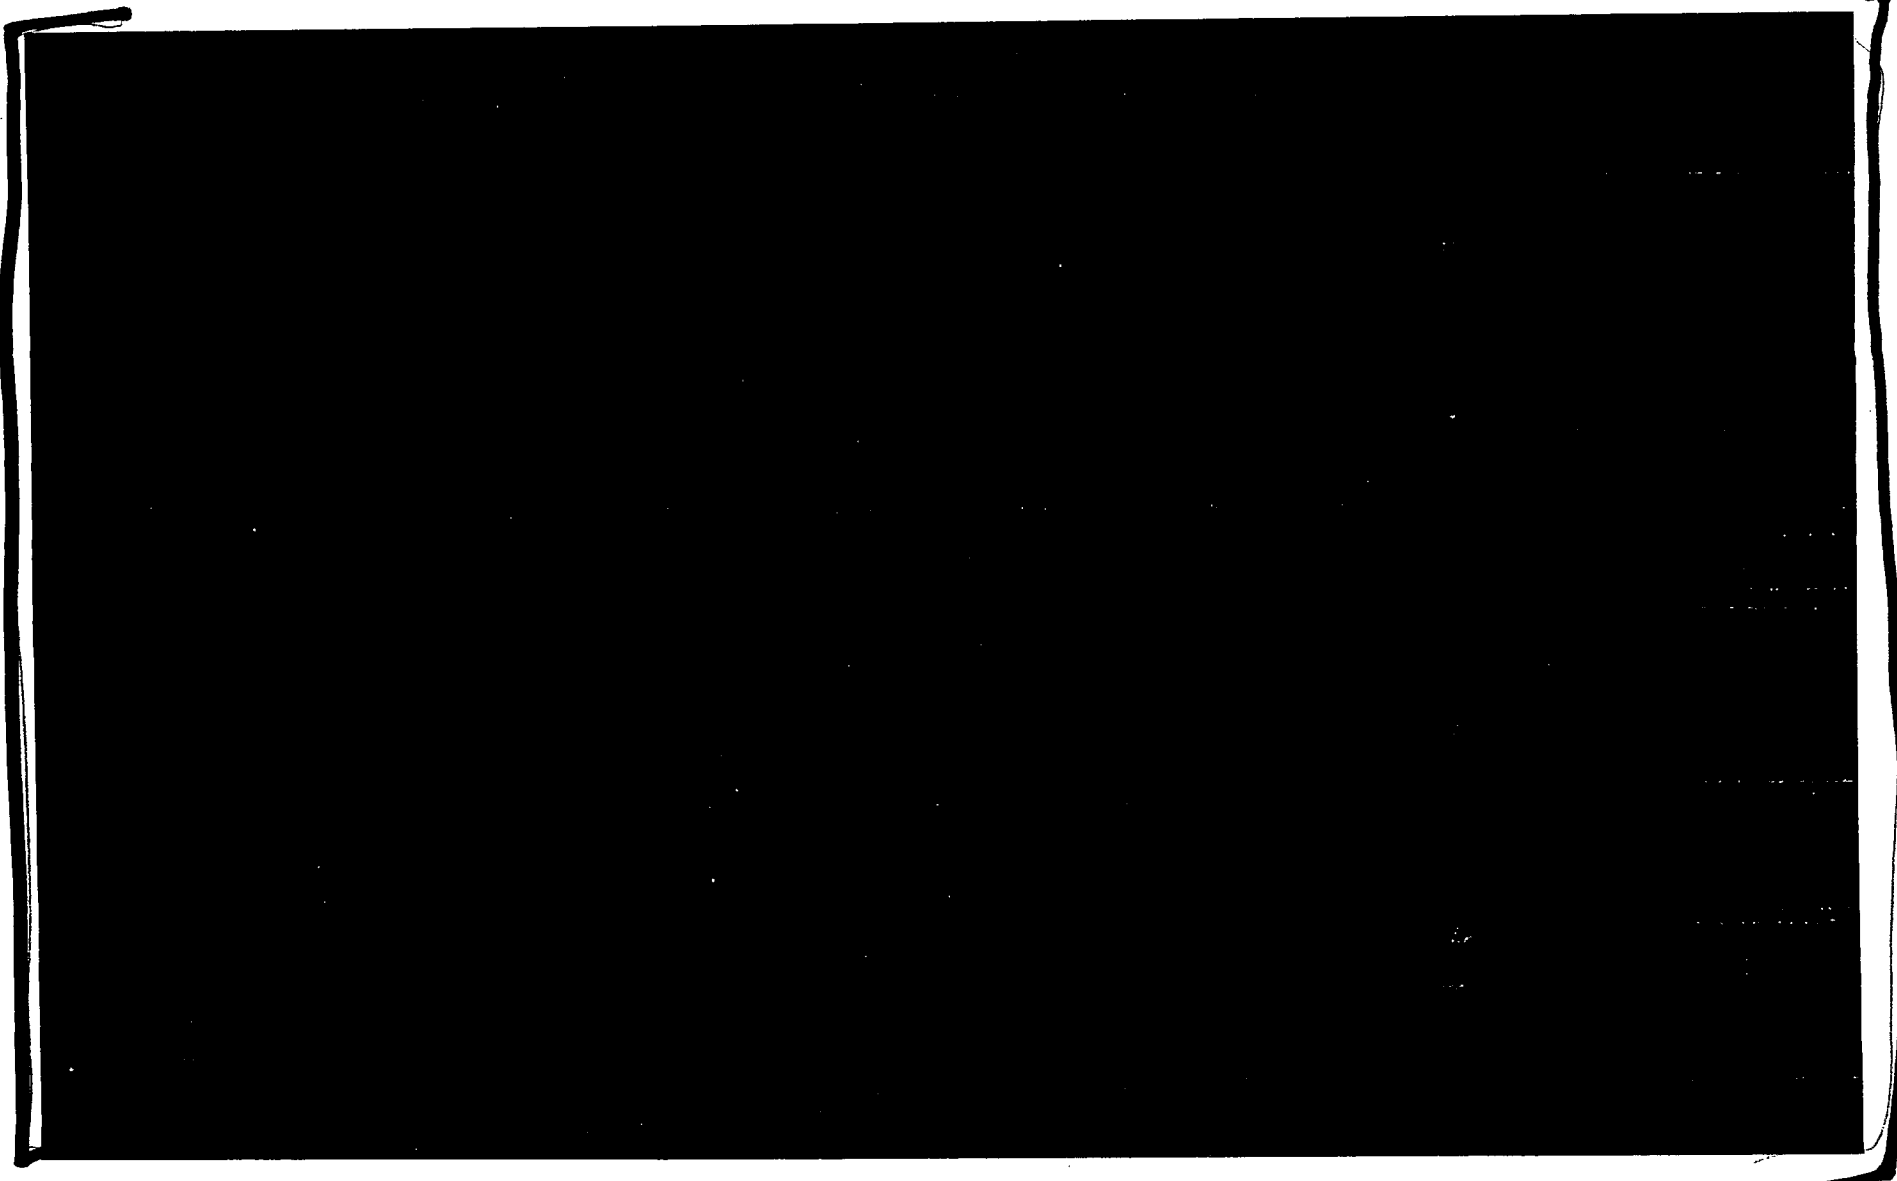

9-Jan-2004

DuPont Confidential

Company Sanitized. Does not contain TSCA CBI

9-Jan-2004

DuPont Confidential


Company Sanitized. Does not contain TSCA ⁴ ~~CB~~

9-Jan-2004

DuPont Confidential

5
Company Sanitized. Does not contain TSCA CBI

Summary

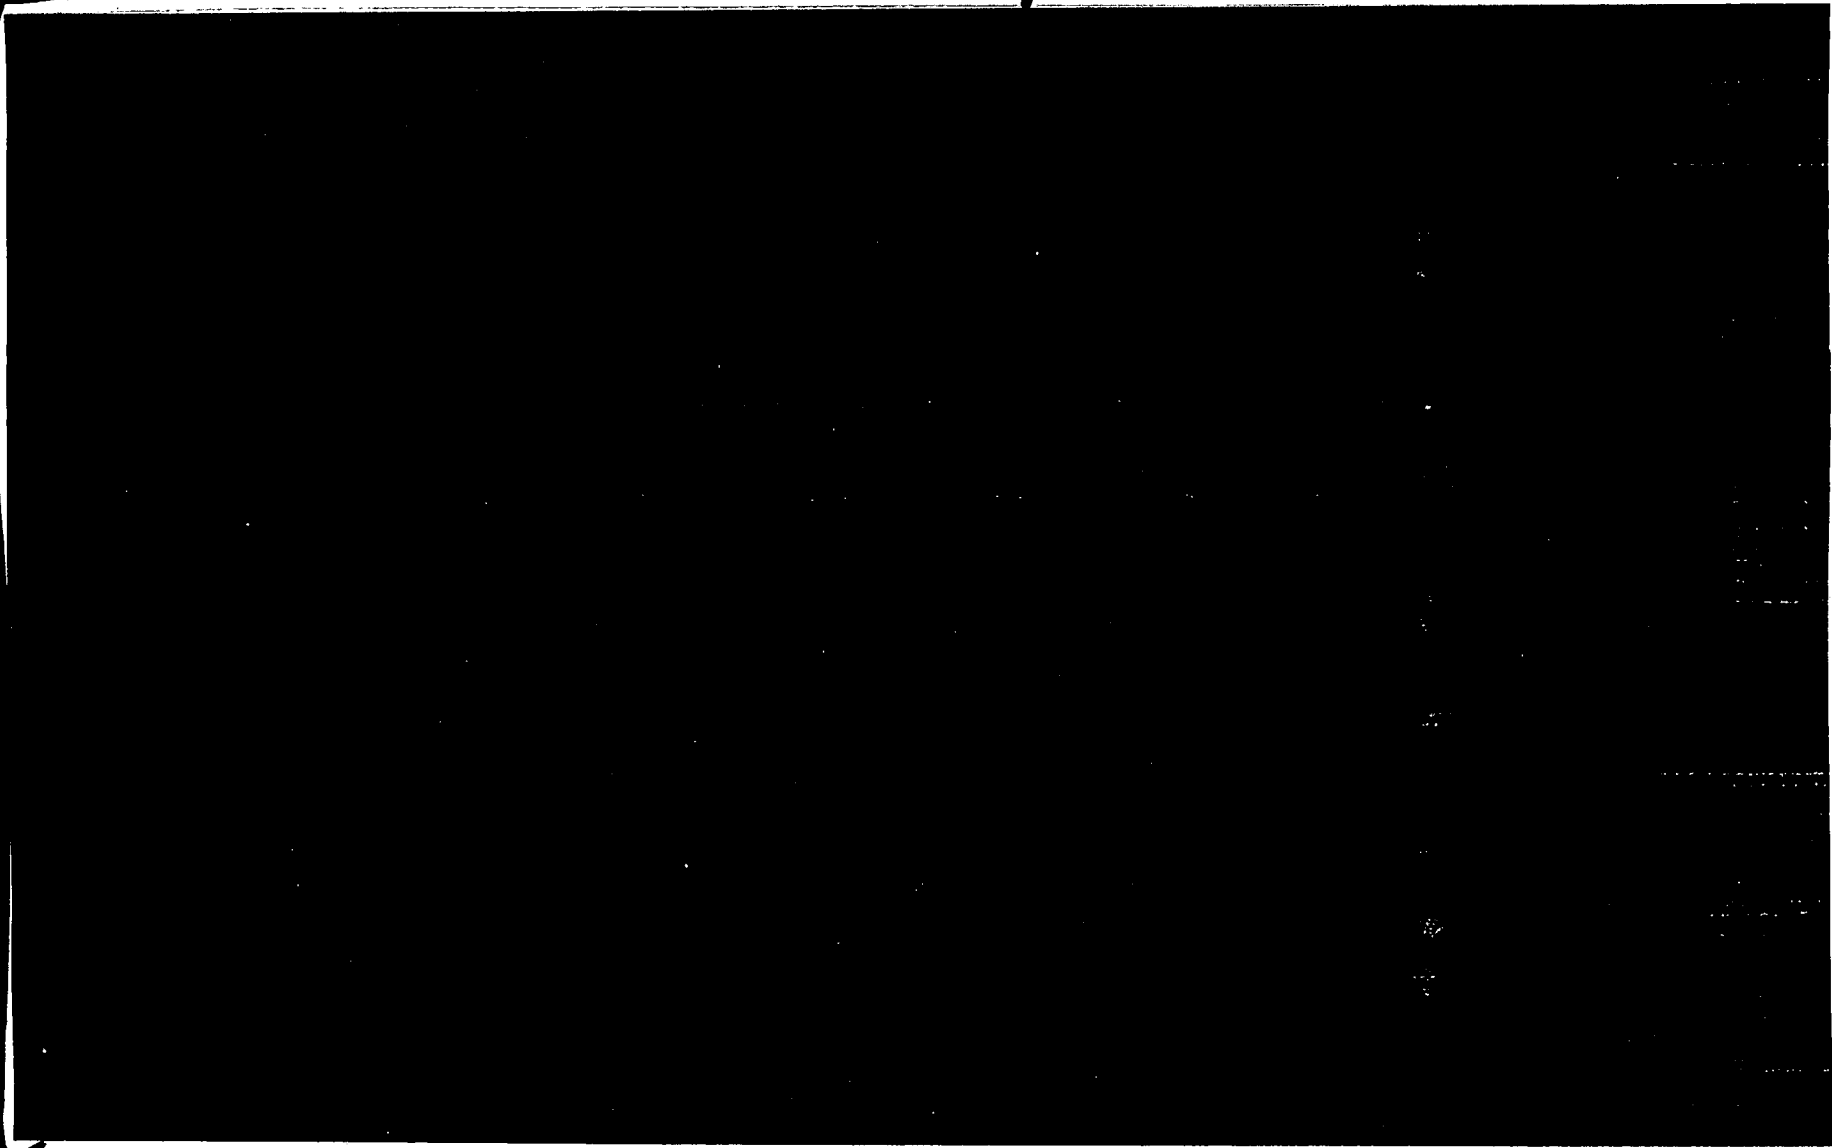

9-Jan-2004

DuPont Confidential

Company Sanitized. Does not contain TSCA CB

9-Jan-2004

DuPont Confidential

Company Sanitized. Does not contain TSCA CBI