

Mr. C. H. Borcharding, Jr.
November 20, 1967
Page Two

5. ANY CHANGE IN TYPE OF SOLVENTS USED

1967 - None

6. NOISE REDUCTION MEASURES

1967 - None

7. ARE STATIC PRESSURE READINGS BEING TAKEN ON VENTILATION EQUIPMENT?

1967 - None. Ammeter readings are taken to control loading of motors - proper motor load is an indication of the Dust Collector handling the approximate designed load.

8. HEAT REDUCING MEASURES

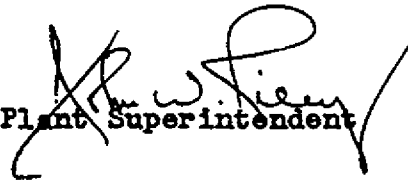
1967 - See Items 1 and 2.

9. AIR POLLUTION ABATEMENT MEASURES

1967 - None

10. INDUSTRIAL HYGIENE IMPROVEMENTS SCHEDULED FOR 1968

1968 - None - Due to revamping Strip Finishing and Inspection Departments, additional Dust Collectors will be added.


Plant Superintendent

J.W. Riley/jk

cc: D. K. Rennie
C. B. Mallory
C. L. Curtis
W. H. Baker

RECEIVED

NOV 27 1967

ABEX CORPORATION
MEDICAL DEPT.

SPNY 006364