


A-5


oil-fired boilers
hot water or steam

PLAINTIFF'S EXHIBIT

ASI-161

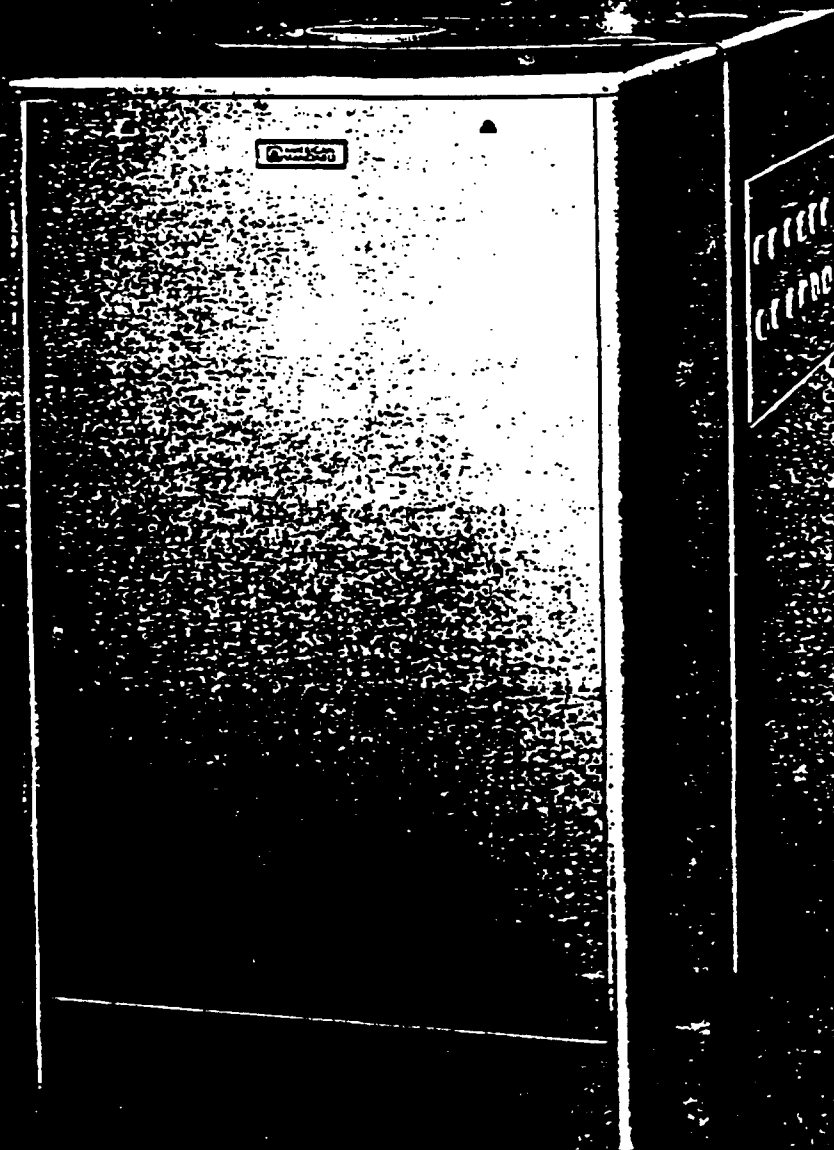


A-5 oil-fired boiler—a versatile, durable performer

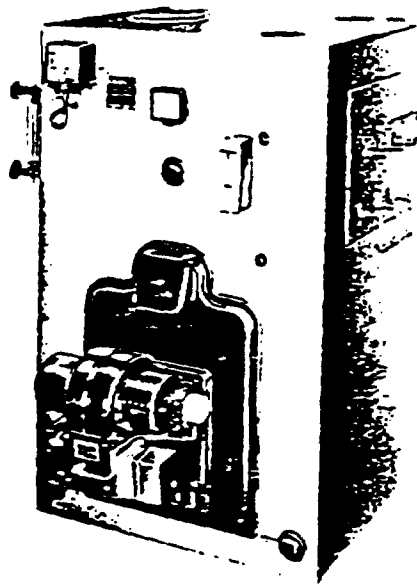


steam boiler illustrated

The A-5 oil-fired unit is designed for installation in large homes and small to medium-size apartments and commercial buildings. This big performance boiler has been engineered specifically for oil operation and is available as a boiler-burner unit or boiler only in a full range of eight sizes for hot water or steam application, with gross I=B=R output ratings of 251,000-830,000 Btu/hr range. The A-5 is built for long-lasting efficiency and easy, low-cost installation. Vertical flue design reduces section weight, speeds heat circulation; unique tankless hot water heater adapts to meet varying domestic requirements; rugged cast iron sections assure long, dependable service; wet base construction eliminates need for special base, keeps floor cool, pre-cast combustion chamber saves on installation time; and American-Standard precision burners are tested for peak oil heating performance.

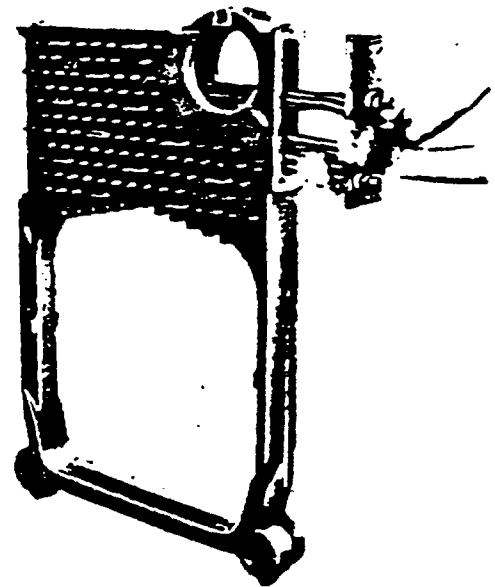

The A-5 boiler is unmatched in its ability to meet a wide variety of domestic hot water needs. A unique tankless heater arrangement lets you match expanding domestic hot water requirements (from 4 to 16 gpm) by the insertion of extra tankless water heaters into A-5 center sections. No need to install a bigger boiler or separate water heater to handle expanding hot water requirements. A special copper manifold assembly, pre-fabricated to cut installation time and cost, connects multiple heaters in parallel. Special center sections, with heater opening, are supplied at no extra cost on all A-5 boilers specified for tankless use. This special A-5 tankless heater arrangement also permits the use of split systems to serve different domestic hot water needs. For versatility and flexibility in meeting domestic hot water needs, the A-5 is the answer.

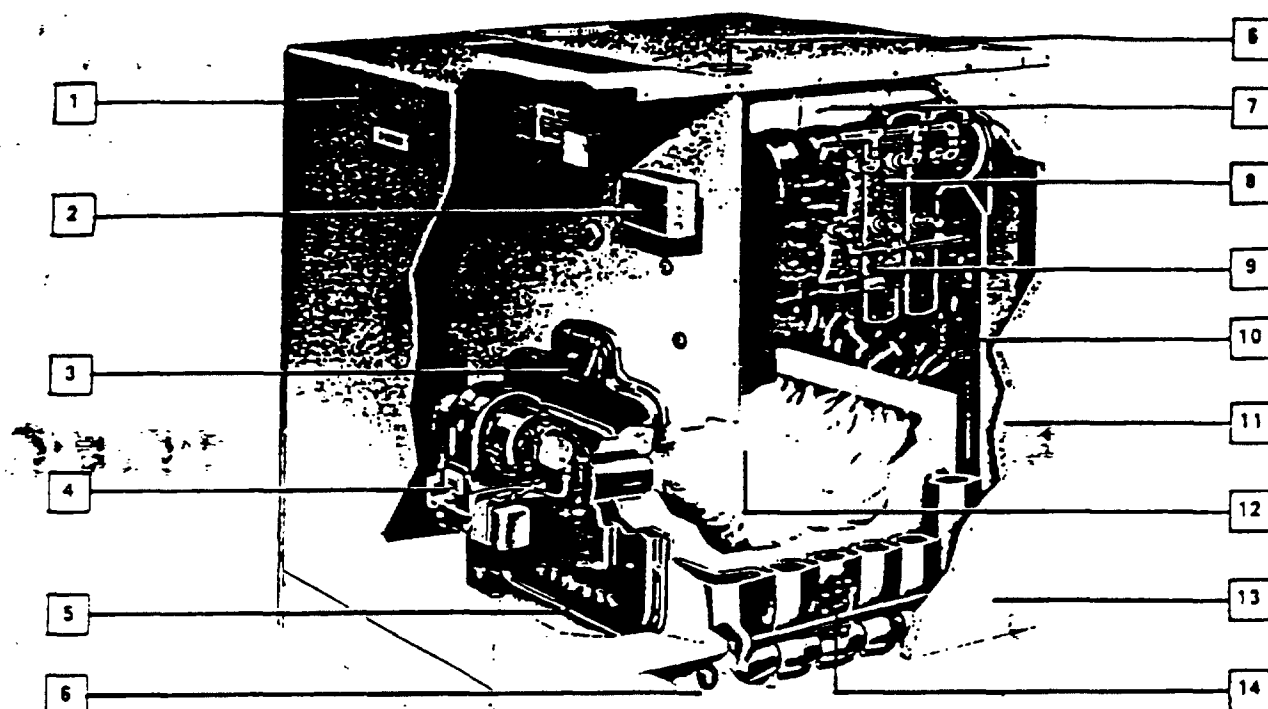

water boiler illustrated

1—optional jacket extension—matches jacket and has removable front panel for ready access to burner and controls. arch-type openings to provide ample air for combustion and circulation.

2—control—control mounted on front of boiler for easy maintenance and adjustment.

3—observation door—permits convenient flame viewing; simplifies burner and control adjustment while boiler is firing. A 1/2-inch pipe tap is provided for draft test purposes.

4—oil burner—is available in four models for mounting on boilers. Burners are laboratory tested for clean, efficient firing in all A-5 boiler-burner units.

5—secondary air inlet—built into the front of the boiler; provides for easy accurate adjustment of secondary air.

6—tappings—4-inch supply (top) and 2 1/2-inch return (bottom) located in both front and back sections, eliminate need for header on largest steam assembly.

7—flue canopy—aluminized steel construction permits smaller flue pipe sizes; makes A-5 readily adaptable for gas firing.

8—water heater—internal tankless type with finned copper tubing. Unique arrangement permits flexibility in meeting domestic hot water requirements ranging from 4 to 16 gpm.

9—heater manifold—connects multiple water heater in parallel and is pre-assembled for quick installation.

10—boiler sections—are ruggedly constructed of cast iron and feature vertical flue design with large 7-inch top nipple port. Off-center location of nipple port speeds up circulation; projecting studs and horizontal bars extract maximum heat from combustion gases. Sections are water tested at 125 psi (2 1/2 times rated capacity of relief valve). Accessible from left side for cleaning.

11—insulation—heavy glass fiber insulation prevents wasteful heat loss, keeps jacket cool.

12—combustion chamber—high-temperature, pre-cast refractory combustion chamber—provided for all assemblies—heats quickly and evenly.

13—jacket—smartly-styled of sturdy steel in sparkling gray finish with modern radius corners.

14—wet base construction—provides extra heat-absorbing bottom surface and increased water content. Waterways completely surround combustion area, extend beneath boiler, keep floor cool.



A-5 ratings

boiler numbers		gross I=B=R output water & steam (Btu/hr)	net I=B=R ratings ^a			I=B=R burner capacity (gph) ^e	chimney		water content (gallons)	
water	steam		water (Btu/hr)	steam (sq. ft.)	steam (Btu/hr)		size (inches)	height (feet)	water boiler	steam boiler
boiler-burner units										
A-504-WB(T)	A-504-SB(T)	261,000	227,000	816	195,800	2.55	8 x 12	15	57.7	45.6
A-505-WB(T)	A-505-SB(T)	346,000	300,900	1082	259,600	3.30	8 x 12	20	66.7	52.4
A-506-WB(T)	A-506-SB(T)	426,000	370,400	1332	319,600	4.00	12 x 12	20	75.5	59.3
A-507-WB(T)	A-507-SB(T)	508,000	441,700	1588	381,100	4.75	12 x 12	20	84.5	66.1
A-508-WB(T)	A-508-SB(T)	588,000	511,300	1838	441,100	5.55	12 x 16	25	93.4	72.9
A-509-WB(T)	A-509-SB(T)	668,000	580,900	2088	501,100	6.30	12 x 16	25	102.3	79.8
A-510-WB(T)	A-510-SB(T)	748,000	650,400	2338	561,100	7.00	12 x 16	25	111.3	86.6
A-511-WB(T)	A-511-SB(T)	830,000	721,700	2594	622,700	7.65	16 x 16	30	120.2	93.4

boilers

A-504-W(T)	A-504-S(T)	261,000	227,000	816	195,800	2.55	8 x 12	15	57.7	45.6
A-505-W(T)	A-505-S(T)	346,000	300,900	1082	259,600	3.30	8 x 12	20	66.7	52.4
A-506-W(T)	A-506-S(T)	426,000	370,400	1332	319,600	4.00	12 x 12	20	75.5	59.3
A-507-W(T)	A-507-S(T)	508,000	441,700	1588	381,100	4.75	12 x 12	20	84.5	66.1
A-508-W(T)	A-508-S(T)	588,000	511,300	1838	441,100	5.55	12 x 16	25	93.4	72.9
A-509-W(T)	A-509-S(T)	668,000	580,900	2088	501,100	6.30	12 x 16	25	102.3	79.8
A-510-W(T)	A-510-S(T)	748,000	650,400	2338	561,100	7.00	12 x 16	25	111.3	86.6
A-511-W(T)	A-511-S(T)	830,000	721,700	2594	622,700	7.65	16 x 16	30	120.2	93.4

^a Net I=B=R ratings shown are based on a piping and pick up allowance of 1.333 for steam and 1.15 for water. American-Standard should be consulted before selecting a boiler for installations having unusual piping and pick up requirements.

^e For complete information on burners and nozzles furnished with A-5 boiler-burner units, see chart on page 8. (Based on oil at 140,000 Btu per gallon.)


Note: Suffix "B" denotes boiler-burner unit; "S" denotes steam; "W" denotes hot water; "T" denotes unit with tankless heater section(s).

control sets for A-5 boiler-burner units

control set	control function	description
standard		
no. 1 steam	unit without domestic hot water	thermostat, Pressurtrol
no. 3 gravity water	unit without domestic hot water, immersion control	thermostat, Aquastat limit control
optional		
no. 2 steam	unit with year-round domestic hot water, built-in tankless heater	thermostat, Pressurtrol Aquastat operating control
no. 4 forced water	unit without domestic hot water	thermostat, Aquastat limit and circulator control
no. 5 forced water	unit with year-round domestic hot water, built-in tankless heater, using circulator	thermostat, Aquastat limit, reverse and operating control, circulator relay
no. 5-Z forced water	one no. 5-Z control set is required for each zone in addition to the first zone which is controlled by no. 5 control set.	thermostat, relay

A-5 oil-fired boilers are designed and built to comply with the American Society of Mechanical Engineers' Code and bear their approval symbol. Ratings have been approved by the Institute of Boiler and Radiator Manufacturers.

dimensions and tappings

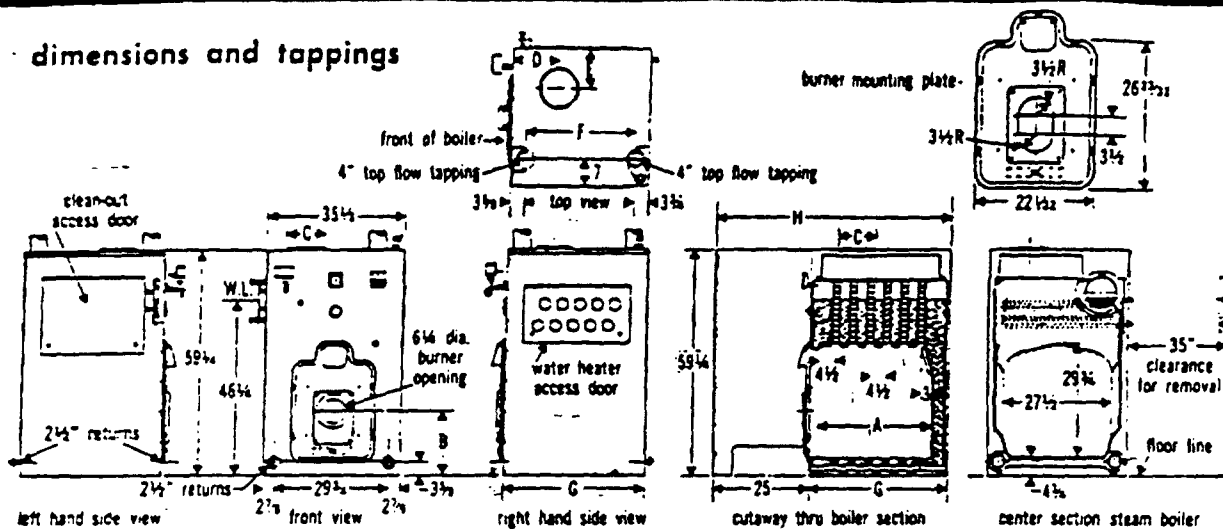

boiler number	number of sections	number and size of tappings		dimensions (inches)								G flush jacket	H jacket extension
		flow (in.)	return (in.)	A	B	C	D	E	F				
A-504	4	(2)-4	(4)-2½	16½	13¼	9	11½	9½	15½			22½	47½
A-505	5	(2)-4	(4)-2½	21	16¾	9	11½	9½	20			27½	52½
A-506	6	(2)-4	(4)-2½	25½	16¾	10	12	10	24½			31½	56½
A-507	7	(2)-4	(4)-2½	30	16¾	10	12	10	29			36½	61½
A-508	8	(2)-4	(4)-2½	34½	16¾	10	12	10	33½			40½	65½
A-509	9	(2)-4	(4)-2½	39	16¾	12	13	11	38			45½	70½
A-510	10	(2)-4	(4)-2½	43½	16¾	12	13	11	42½			49½	74½
A-511	11	(2)-4	(4)-2½	48	16¾	12	13	11	47			54½	79½


assemblage of sections

boiler number	arrangement of sections from front of boiler (with tankless heater opening)											arrangement of sections from front of boiler (less tankless heater opening)										
	1	2	3	4	5	6	7	8	9	10	11	1	2	3	4	5	6	7	8	9	10	11
A-504	FX	CT	CT	BX	—	—	—	—	—	—	—	FX	C	C	BX	—	—	—	—	—	—	—
A-505	FX	CT	CT	CT	BX	—	—	—	—	—	—	FX	C	C	C	BX	—	—	—	—	—	—
A-506	FX	CT	CT	CT	C	BX	—	—	—	—	—	FX	C	C	C	C	BX	—	—	—	—	—
A-507	FX	CT	CT	CT	C	C	BX	—	—	—	—	FX	C	C	C	C	C	BX	—	—	—	—
A-508	FX	CT	CT	CT	C	C	C	BX	—	—	—	FX	C	C	C	C	C	C	BX	—	—	—
A-509	FX	CT	CT	CT	CT	C	C	C	BX	—	—	FX	C	C	C	C	C	C	C	BX	—	—
A-510	FX	CT	CT	CT	CT	C	C	C	C	BX	—	FX	C	C	C	C	C	C	C	C	BX	—
A-511	FX	CT	CT	CT	CT	C	C	C	C	C	BX	FX	C	C	C	C	C	C	C	C	C	BX

Legend

FX—front connecting section
CT—center section with tankless heater opening
C—center section without tankless heater opening
BX—back connecting section

F	2½	low water cut-off	not used
G	¾	pressure limit control	temperature limit control
H	¾	operating control, tankless heater	not used
J	½	pressure gauge	combination altitude gauge and thermometer
K	¾	not used	operating control, tankless heater
L	¾	not used	reverse acting control



Note: 2-inch blow-off in back section.
2-inch safety or relief valve on top of back section.

boiler number	number of heaters	ratings (gpm)
A-504-A-511	1	4
A-504-A-511	2	7
A-505-A-511	3	10
A-508-A-511	4	13
A-510-A-511	5	16

gallons of water per minute raised from 40°F to 140°F with 200°F boiler water temperature.


The above table shows the recommended number of heaters to be used with each boiler and the ratings attained if more than one heater is connected in parallel. Additional heaters can be added if the heaters are serving different systems and it is not likely that heaters will all be in use at the same time. No. 530 tankless heater available for single purpose or multiple parallel hook-up. Copper manifolds (illustrated below) for two, three or four-heater parallel arrangement furnished with No. 530 heater if specified.

Provision for tankless heater is available when specified. If suffix letter "T" is added on order to unit or boiler numbers, the following maximum number of center sections with heater openings will be furnished.


boiler or unit number	number of openings
A-504-T	2
A-505-T A-506-T A-507-T	3
A-508-T A-509-T	4
A-510-T A-511-T	4 or 5

Note: Additional openings can be specified on order. Cover plate for water heater openings will be furnished if specified on order, at added charge for "T" type units and boilers. Cover plate is available with 2" tapping for connection of external water heater.


tankless heater piping

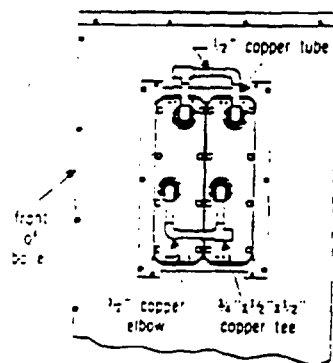

2-heater manifold piping

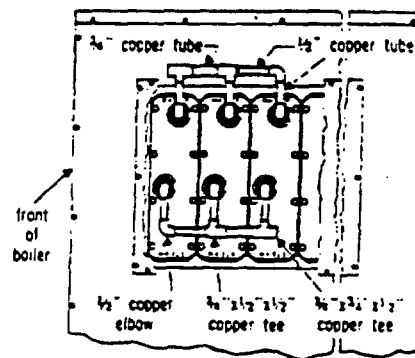

3-heater manifold piping

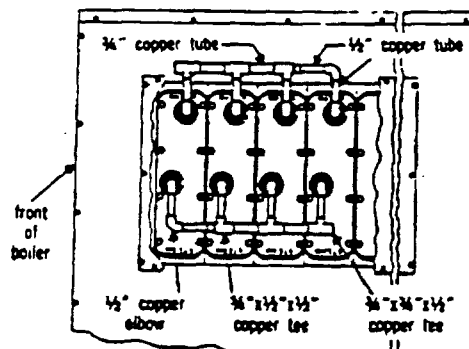


4-heater manifold piping

Note: Single arrangement or any combination of the above manifold piping arrangements can be used. Water heaters are assembled in boiler starting with the second section from front of boiler. Heater cover plates are marked "steam" and "water." When installing in a steam boiler the word "steam" should read at the top. When installing in a water boiler, the word "water" should read at the top.


minimum piping recommendations

hot water

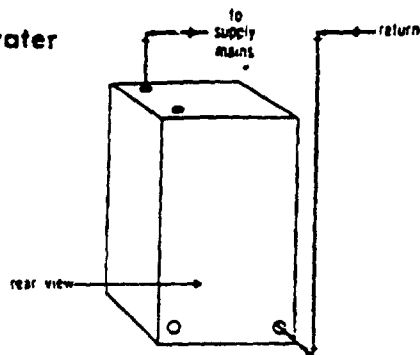

boiler number	gravity		forced	
	supply (in.)	return (in.)	supply (in.)	return (in.)
A-504	2½	2½	1½	1½
A-505	2½	2½	2	2
A-506	(2)-2	(2)-2	2	2
A-507	(2)-2	(2)-2	2	2
A-508	(2)-2½	(2)-2½	2½	2½
A-509	(2)-2½	(2)-2½	2½	2½
A-510	(2)-2½	(2)-2½	2½	2½
A-511	(2)-2½	(2)-2½	2½	2½


steam

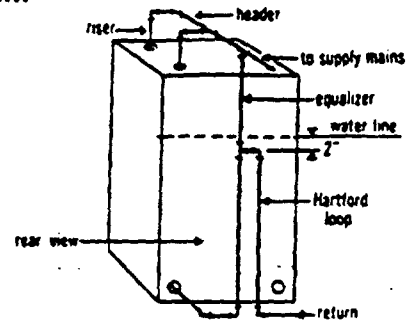

boiler number	riser (in.)	header (in.)	equalizer (in.)	return (in.)
A-504	3	—	2½	1½
A-505	3	—	2½	1½
A-506	4	—	2½	1½
A-507	4	—	2½	1½
A-508	(2)-3	4	2½	1½
A-509	(2)-4	4	2½	1½
A-510	(2)-4	4	2½	2
A-511	(2)-4	5	2½	2

combustion chamber dimensions

Heat Lib-O-Rator molded refractory combustion chambers

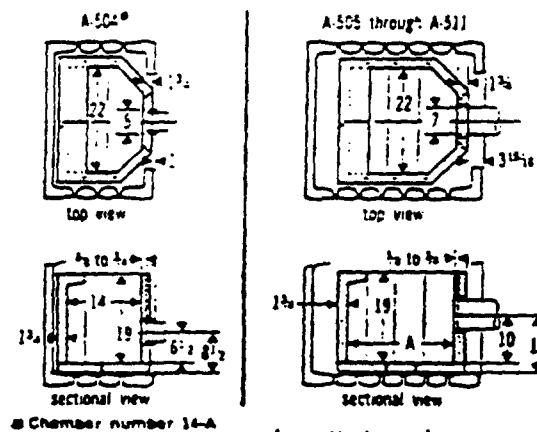


Chamber number 14-A

boiler number	Heat Lib-O-Rator chamber number	A (in.)
A-505	15-A	19½
A-506	15-AA	20
A-507	16-A	21½
A-508	16-A	21½
A-509	17-A	27½
A-510	17-A	27½
A-511	17-A	27½

Heat Lib-O-Rator refractory combustion chambers are standard equipment on A-5 boiler-burner units; optional with boiler only.

fire brick refractory combustion chambers

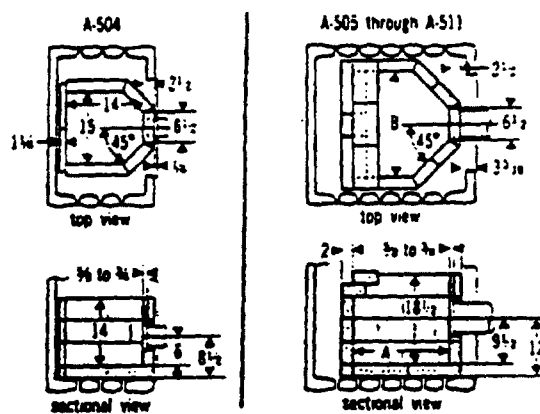

boiler number	A (in.)	B (in.)
A-505	14½	18
A-506	18	18
A-507	20	22
A-508	22	22
A-509	24	22
A-510	24	22½
A-511	26	22½

oil-fired boilers

oil burner specifications

boiler number	burner number	diameters—(inches)		I=B=R burner capacity (gph)	nozzle data			
		choke	disc		number required	gph each	spray angle	type
including light-sensing primary control								
A-504	DH-5			2.55	one	2.50	60'	solid,
A-505	45WU-3606	3 3/4	2 1/4	3.30	two	1.65	70'	solid
A-506	45WU-3606	3 3/4	2 1/4	4.00	two	2.00	70'	solid
A-507	62A-7056-1	5	3	4.75	two	(1)-2.25 (1)-2.50	80' 80'	hollow hollow
A-508	62A-7056-1	5	3	5.55	two	2.75	80'	hollow
A-509	62A-7056-1	5	3 1/4	6.30	two	(1)-3.00 (1)-3.25	80' 80'	hollow hollow
A-510	96-7506-1	5	3 1/4	7.00	two	3.50	80'	solid
A-511	96-7506-1	5	3 1/4	7.65	two	(1)-3.50 (1)-4.00	80' 80'	solid solid

■ One stage fuel unit is regular equipment on DM-5.
Two stage fuel unit is optional on DM-5, standard on all other burners on chart.

▲ Remove disc when installed in boiler, if firing rate exceeds 5.75 GPH.

Electronic flame safeguard equipment—62A-7056-1-F burner with electronic flame safeguard control is available instead of 62A-7056-1 burner for A-507, A-508 and A-509 boiler-burner units. 96-7506 burner is available for A-510 and A-511 boiler-burner units.
For installations requiring Factory Mutual Approval and in states and

municipalities with regulations more stringent than Underwriters' Laboratories, Inc., oil burners with special electronic flame safeguard controls are available for A-5 boiler-burner units as follows: 62A-7056-1-FFM burner for A-507, A-508, and A-509; 96-7507 burner for A-510 and A-511.

APPROVAL: American-Standard oil burners (115 volt/60 cycle) are listed with Underwriters' Laboratories, Inc. for No. 1 and No. 2 grades of fuel oil, distillate or catalytic cracked. They are approved by the New York City Board of Standards and Appeals, the State Fire Marshal of the Commonwealth of Massachusetts and the Dept. of State Police, State of Connecticut.

sample specification for A-5

Contractor shall furnish and install, as indicated on plans, oil fired boiler(s) having a firing rate of gph and an I=B=R gross output of Btuh. Boiler(s) shall be constructed of cast iron in accordance with A.S.M.E. requirements for low pressure heating boilers and bear the A.S.M.E. symbol. Each section shall be factory tested at 2 1/2 times maximum working pressure of 50 lbs. for water. Boiler(s) shall have I=B=R ratings. Boiler(s) shall be composed of cast iron sections with vertical flues. Manufacturers will furnish boilers with an aluminized steel canopy.

Water or steam trim as required. Oil burners shall include controls as herein described. (Note: include description of controls as required and other burner features and combustion chamber as desired.)

Boiler shall be equipped with tankless heater(s) having a rating of gpm. If more than one heater is required to meet requirements a copper manifold factory assembled will be installed by the contractor as recommended by the manufacturer to connect the heater in parallel arrangement.



PLUMBING & HEATING DIVISION

40 WEST 40TH STREET • NEW YORK, N.Y. 10018