APPLICATION
BASIC INSULATION

PIPE AND FITTINGS

CALCIUM SILICATE
SINGLE LAYER:

K. 2. Outdoor covers having an O.D. less than 20 inches or a perimeter less than 60 inches shall be secured with 3/4 inch wide s/s bands and #204 case latch fasteners.

2.1 The method of fabricating case latch and s/s band portable cover straps is described in Section VII-B instruction sheet #5 page 5.

2.2 Outdoor covers having an O.D. of 20 inches or more or a perimeter of 60 inches or more shall be secured with 1-1/4 inch wide s/s band and #210 case latch fasteners.

2.3 Where practical, the strap fasteners, for portable covers shall be secured to at least one part of the cover by either a mechanical means, wiring or cementing.

2.4 One strap is sufficient for screwed union, check valve, flange covers, etc., having an O.D. less than 7" or a perimeter less than 24" and neither being over 12" long. Figures 55 A & B.

FIG. 55 A

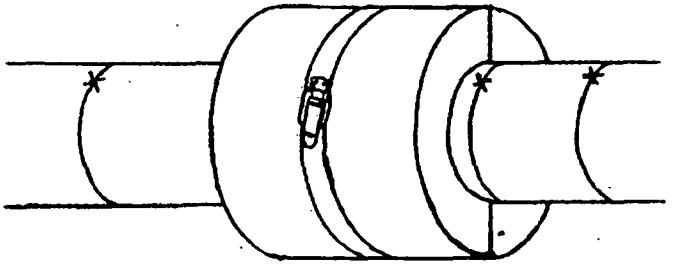

FIG. 55 B

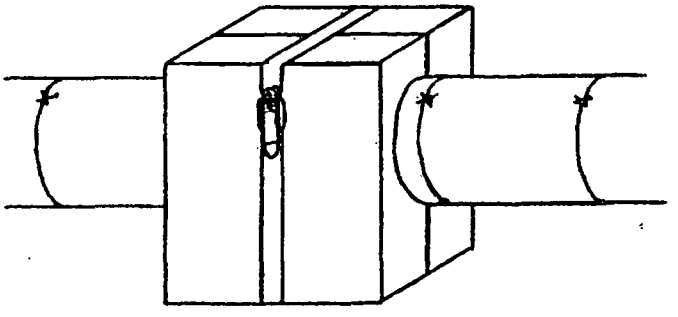

2.5 Larger flange covers and covers not having a bonnet or the like shall have a minimum of 2 straps. Figure 56.