


APPLICATION
BASIC INSULATION
PIPE AND FITTINGS

SECTION V A-1a.5


CALCIUM SILICATE
SINGLE LAYER:

Fig. 4B

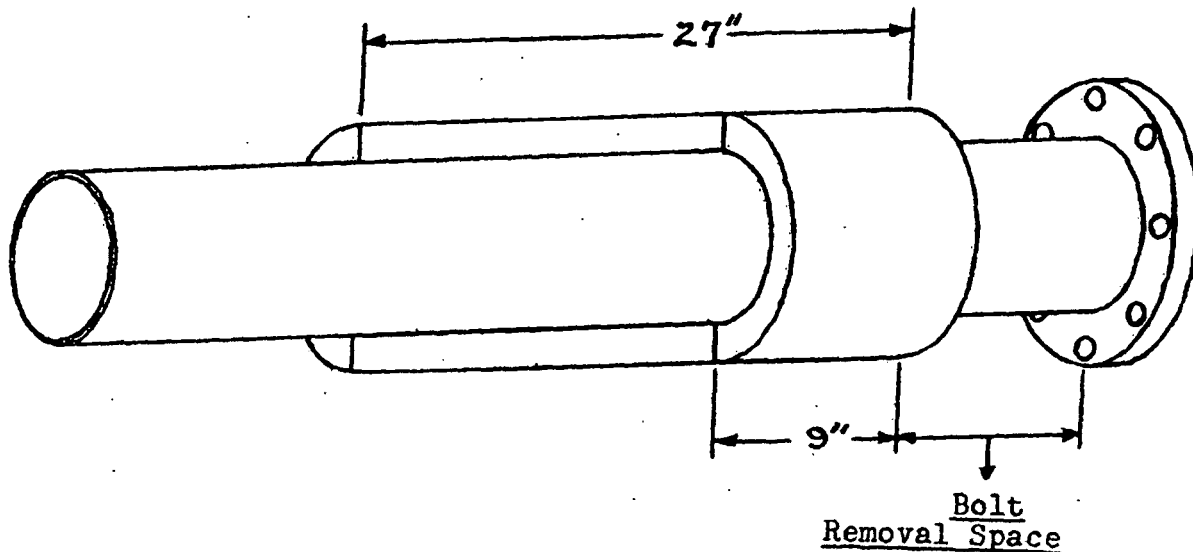

- B 3.4 Tri-segmental covering shall have the butt joints staggered 9 - 9 and 18 inches.
- 4a. One of the 3 segments shall be cut to make one 9" long piece and one 27" long piece as shown in 5.

Fig. 5

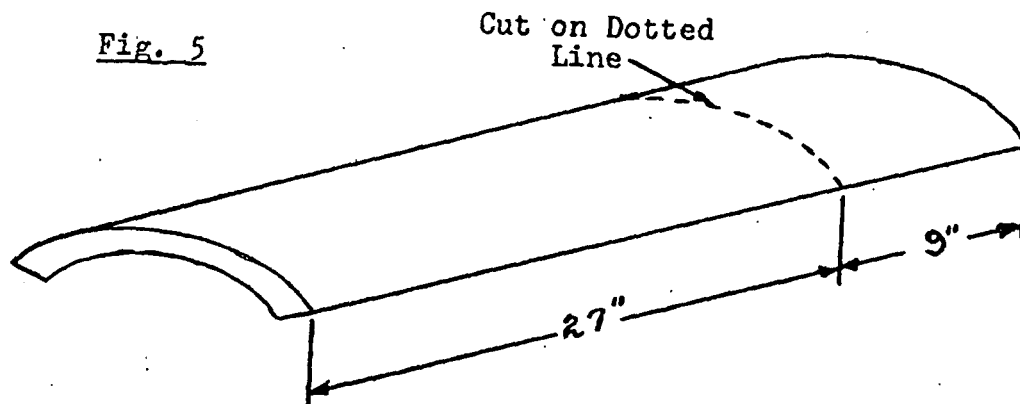

- 4b. The 9 and 27 inch long pieces with one full length 36" segment shall be applied as shown in figures 6.