

TO: Harold Kramer

TGG: JCL: ~~ERT~~: ~~MTA~~: ~~AJO~~: RF

XF: none

FROM: T. G. Grumbles

DATE: July 3, 1990

Interoffice
Communication

SUBJ: LIGHT LEVELS IN ENGINEERING LIBRARY

VISTA

At the request of employees, I measured the light levels in the engineering library to determine if they met recommended guidelines for this type of work location. The recommended level for this area is 100 foot candles. None of the areas surveyed currently have this level. Attached is a rough sketch of the work area and measured levels.

I recommend that the light levels be increased in this work area by whatever means is most practicable.



T. G. Grumbles


dlj

Attachment

VVV 000013268

Engineering Library - Lighting Survey

6/29/30

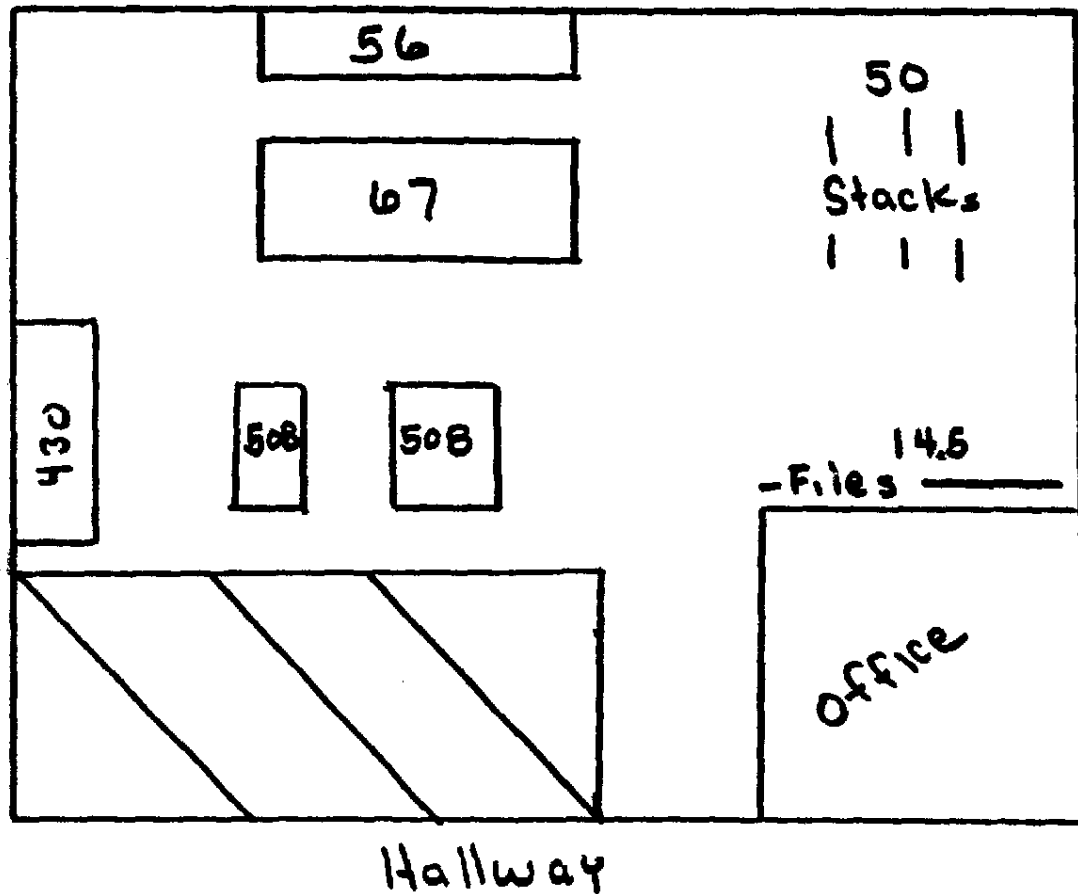

All measurements in footcandles

Drawing not to scale