

FILE NAME: !σŏ\$σúŰσ /\$Ψ\$Ωú tŋμ\$ †ΩŚ {!\$Sú !/t{

DATE: W†Ω

DOC#: !/t{

DOCUMENT DESCRIPTION LΩŚŋσúob| w\$ŎŰΨΨ\$ΩŚ\$Ś to†ŎŰŋŎ\$σ

INDUSTRIAL VENTILATION

A Manual of Recommended Practice

COMMITTEE ON INDUSTRIAL VENTILATION


P. O. BOX 453

LANSING, MICHIGAN

American Conference of Governmental Industrial Hygienists

First Printing, January, 1951

Second Printing, January, 1952

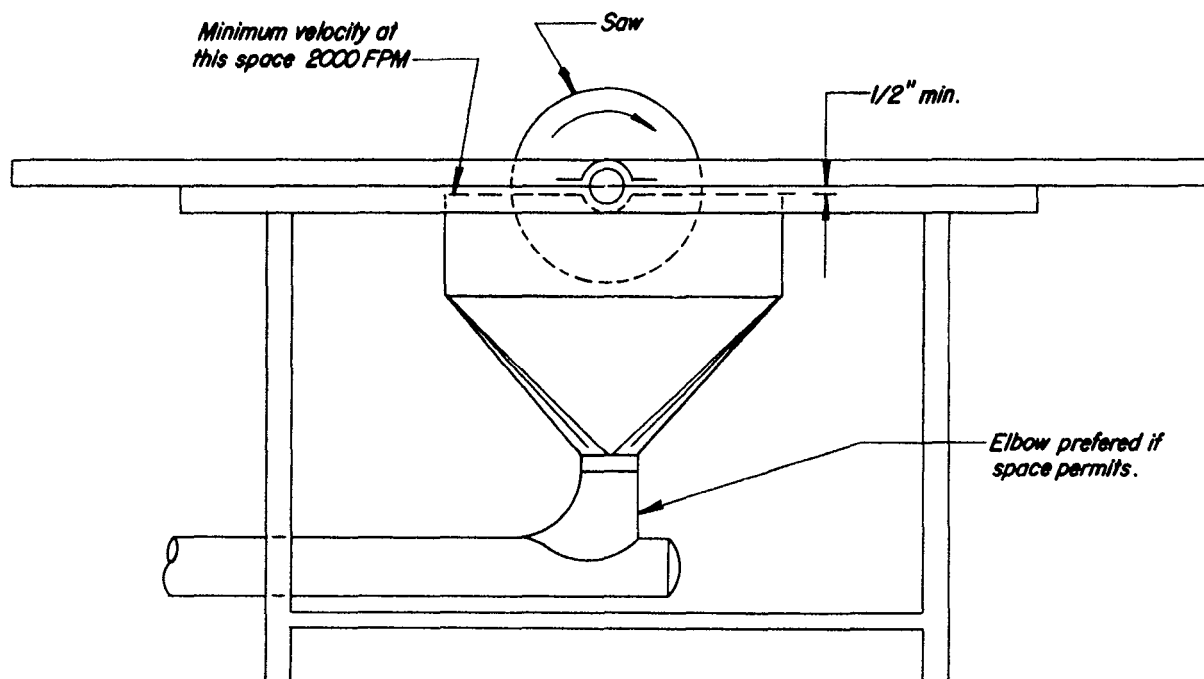

TABLE, RIP, MITRE, AND VARIETY SAWS

Saw diameter, inches	Exhaust volume, CFM
Up to 16 incl.	350
over 16 to 24 incl.	440
over 24	550
variety with dado	550

Duct velocity = 3500-4000 FPM

Entry loss = 1.0 slot VP plus conversions.

AMERICAN CONFERENCE OF
GOVERNMENTAL INDUSTRIAL HYGIENISTS

TABLE SAW

DATE 1-51

VS-46