


Regulation 61 sampling locations

Table S3.3 Point Source emissions to water (other than sewer) – emission limits and monitoring requirements						
Emission point ref. & location Note 5	Parameter	Source	Limit (incl. unit)	Reference period	Monitoring frequency Note 1	Monitoring standard or method
W2 Discharge to Hillylaid Pools	No parameters set	Uncontaminated surface water and roof water from the Permitted Installation	No limit set	--	--	--
W3 Discharge to Royles Brook	No parameters set	Overflow from the west effluent pit under conditions of very high rainfall.	No limit set	--	--	--


No specific location identified on AGCCE Permit, potential locations identified below.

W2 – Hillylaid Pools

Upstream of AGC plant [what3words](#)

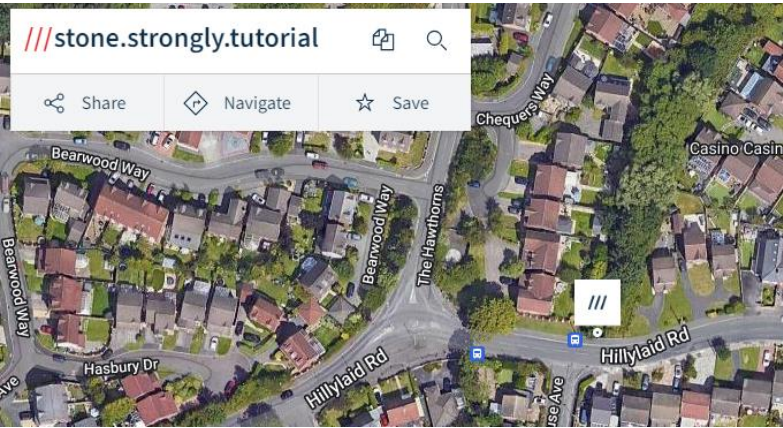


Downstream of AGC plant [what3words](#)

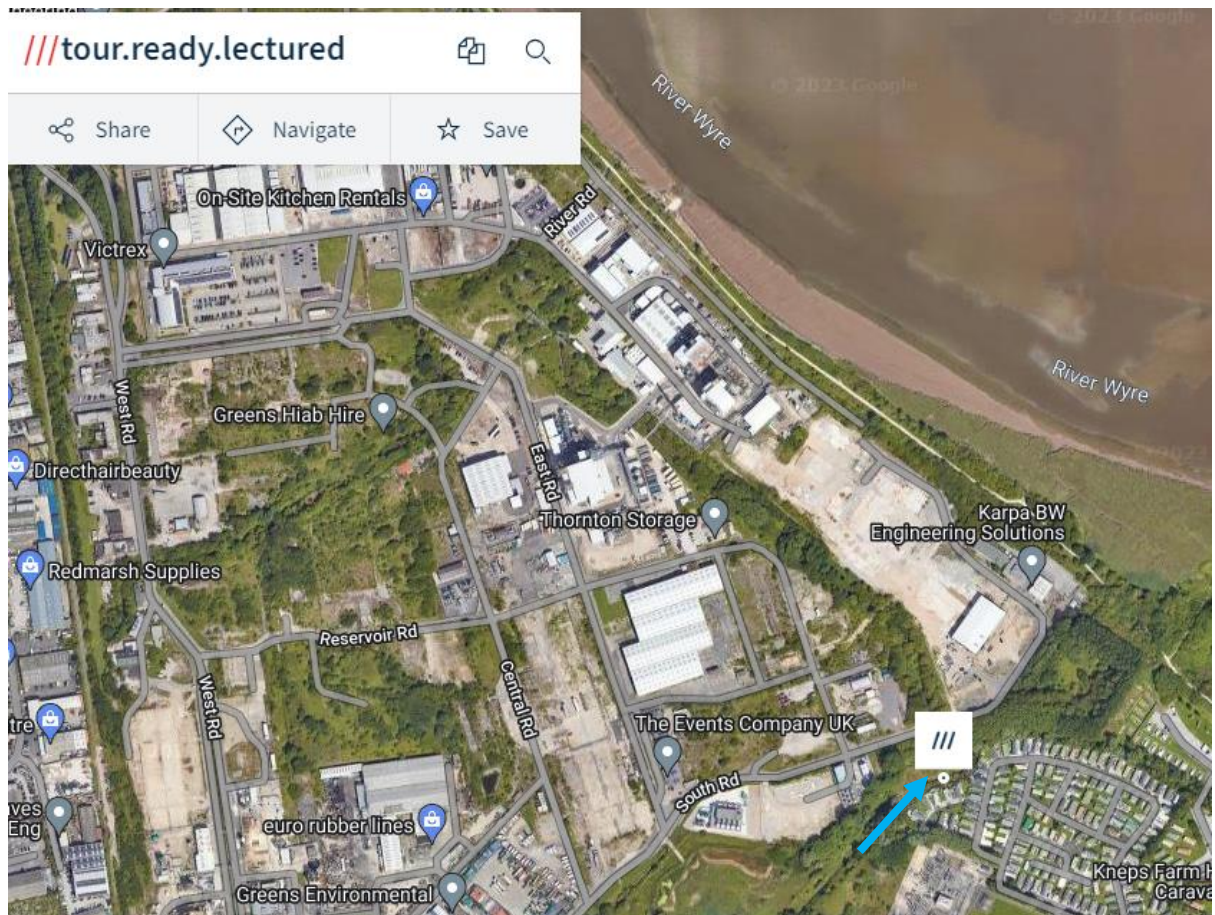

W3 – Royes Brook

Upstream AGC plant [what3words](#)

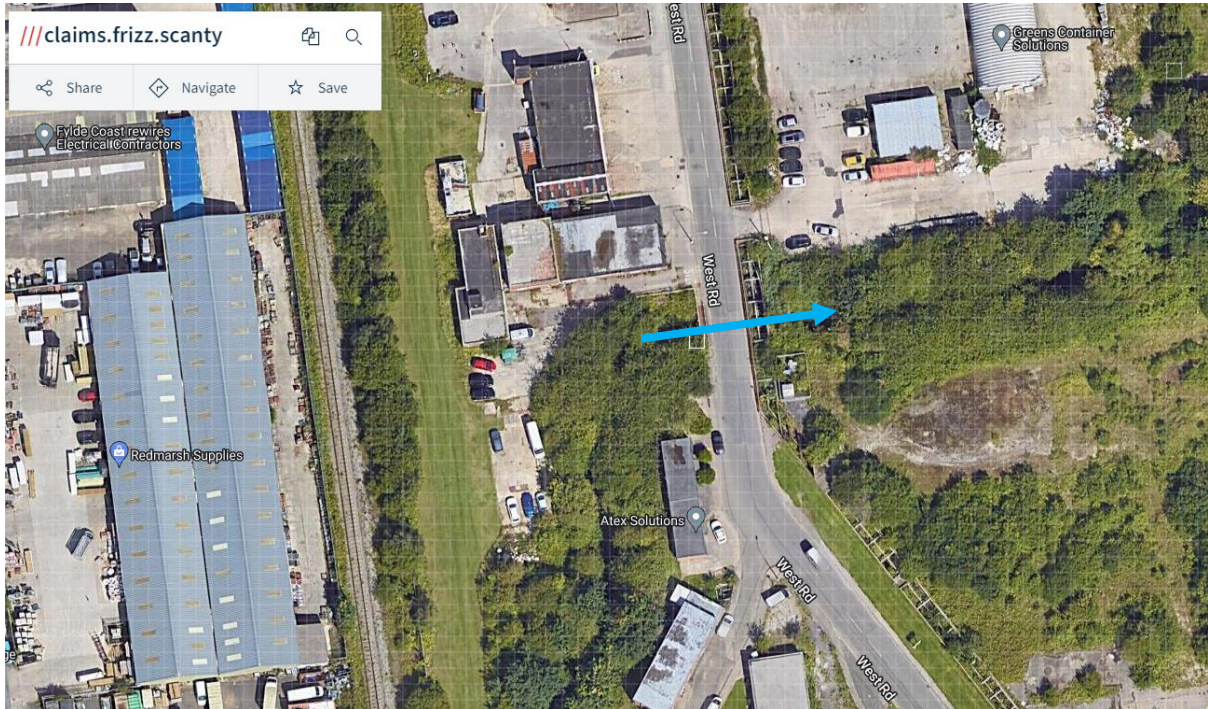

Downstream AGC plant [what3words](#)

Sample point from sluice gate

