water surrounding the coil. If the heater is located in the water of an actively steaming part of a boiler, the heat transfer may be twice as great as would be obtained if the water surrounding the coil were circulating slowly. Ratings of instantaneous water heating coils will therefore vary greatly, depending upon the assumptions made regarding the conditions of operation. The values of the coefficient of heat transmission for instantaneous heaters shown in Table 10, are conservative.

For a coil in which heat is transferred from steam to water, the value of $U = 300\sqrt{v}$ may safely be used (v = velocity of water in feet per second).

The rate of heat transfer, between steam or water as the carrier and the domestic water, is influenced by the rate of movement of both the carrier and the water which receives the heat. For this reason, where the transfer occurs from heating system water to domestic water, it is good practice to install a circulating pump to insure rapid movement of the boiler water.




FIG. 10. INDIRECT WATER HEATER PLACED IN BOILER

In view of the high condensation rates obtained when steam is used with gravity circulation from the boiler, as when there is a sudden demand followed by an inflow of cold water, the bottom of a steam heating transfer element always should be at least 30 in. above the boiler water line, and the steam and condensate return pipes should be of liberal size. Otherwise, water hammer and reduced capacity may result due to imperfect drainage of condensate.

When connecting a transfer-type hot water heater below the waterline of a cast-iron steam boiler having vertical sections, there should be a separate tapping for water circulation into every section of the boiler, as shown in Fig. 9, unless the boiler has large top nipple ports providing inter-sectional circulation. If the top nipples are entirely within the boiler steam space, no internal circulation occurs between sections. Steaming may then occur in the boiler sections not connected to the heater and, further, the unconnected sections will not deliver any heat to the water heater.

TABLE 10. COEFFICIENT OF HEAT TRANSFER OF INSTANTANEOUS WATER HEATERS

U = Btu per (hr) (sq ft) (Fahrenheit degree logarithmic mean temperature difference)

Boiler Water Temperature	210	200	180
U	225	175	150

HOT WATER SUPPLY PIPING

It is common practice to provide circulating piping in all hot water supply systems in which it is desirable to have hot water available continuously at the fixtures. In average-sized and small residences and systems, in which the piping from the heater to the fixtures is short, return circulating piping is generally omitted in order to reduce installation cost, and to reduce heat loss from the piping, particularly during periods of no water demand.

The hot water supply may be distributed by either an up-feed or down-feed piping system. Three common methods of arranging the circulating lines are shown in Fig. 11. Although the diagrams apply to multi-story buildings, the arrangements (*a*) and (*b*) are sometimes used in residential designs.

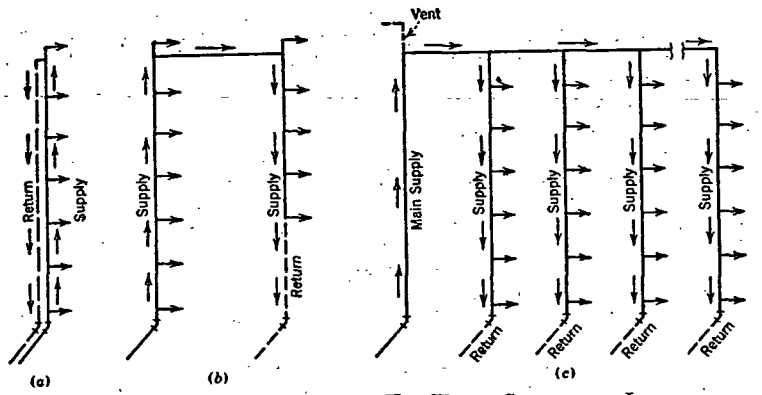


FIG. 11. METHODS OF ARRANGING HOT WATER CIRCULATION LINES

A check valve should be provided in the run-out from each return riser to prevent temporary reversal of flow in the piping when a faucet is open. Proper air venting of a circulating system is extremely important, particularly if gravity circulation is employed. In Fig. 11 (*a*) and (*b*), this is accomplished by connecting the circulating line below the top fixture supply. With this arrangement, air is eliminated from the system each time the top fixture is opened.

Where an overhead supply main is located above the highest fixture as in Fig. 11 (*c*), an automatic float type air vent is installed at the highest point of the system, or a fixture branch is connected to the top of the main where air venting is desired and then dropped to the fixture outlet.

It is sometimes necessary to make an allowance for pressure drop through the heater when sizing hot water lines, particularly where instantaneous hot water heaters are used and the available pressure is low.

The principles involved in the sizing of the hot water supply pipes are the same as those for the sizing of cold water supply lines. For small and medium sized installations a ¾-in. hot water return will be ample. For larger installations the size of the hot water return may be computed from considerations of the heat losses in the hot water piping.[3] A throttling valve should be placed in the hot water return pipe so that the rate of circulation may be adjusted.

Where the hot water piping system is exceedingly long, a water circu-