

FILE NAME: Visible Dust (VDT)

DATE: 1933 Aug

DOC#: VDT003

DOCUMENT DESCRIPTION: Article from Trade Journal – National Safety
News

National Safety News

Published monthly in the interest of accident prevention and the health of industrial workers

VOL. XXVIII, No. 2

CONTENTS for AUGUST, 1933

We Can't Advance Without Records—J. L. Fundergrift	9
What "Permissible" Means in Respiratory Protection—William P. Yant	11
Recovering the Fire Hazards—J. W. Just	13
Safety Pays the Small Plant Too—Robert L. Schmitt	16
Handling Material—A Real Problem for the Safety Man—J. A. Purdy	17
Facing the Future—M. A. Gimbel	19
Mechanical Control of Occupational Disease—David S. Beyer	21
An Eye Saved—Stewart J. Owen, Jr.	23
Sound Objectives for the Vocational School—John A. McCarthy	25
The Congress Reporter	27
Million Children Ride in School Buses—Curtis Billmer	29
Electric Shock and Burns Cause Much Lost Time	36

Regular Departments

1. Journal	7	Parade of the Mages	41
2. The At-Risk of the "Bible" in the	8	The Subject Library	42
3. The At-Risk of the "Bible" in the	9	Common Events	43
4. The Subject Exchange	10	Perseus	44
5. Industrial Health	11	With the Museum	45
6. The Building Manual	12	The Museum Series	46

CARMAN T. FISH, Editor
G. M. BRIGGS, Associate Editor

STANLEY H. KUSHNAR, PAPER Editor
C. H. MILLER, Advertising Manager

Copyright 1933 by National Safety Council, Inc. Printed in U.S.A. Reprinted monthly.
Revised as second edition under June 1, 1937, at the New York office of the Council, Inc., under the
act of March 2, 1909. Additional copy at St. Joseph, Mo.

The subscription price is \$10.00 per year for the KATHOLIC MASTHEAD NEWS. Single copies, 50c. Reduced quantity prices for yearly subscribers.

Reproduction not available only in terms of the National Defense Council.

Member Audit Bureau of Circulation

This magazine is indexed in the Industrial Arts Index.

statements and opinions advanced in viewed articles are to be understood as indicative of their authors, not those of the National Labor Council.

National Safety Council, Inc.

1. *How many people are there in your family?* 2. *What do you do for a living?* 3. *What is your favorite food?* 4. *What is your favorite sport?*

20 North Wacker Drive, Chicago, U.S.A.

New York Office, 9 East 41st Street

National Safety Council
Officers, 1932-1933

JOHN L. LAMARCA, Treasurer
HARRY L. CATES, Vice-President for
Public Safety
J. C. COLBY, Vice-President for
Sanitation
HOWARD H. REED, Vice-President for
Neighborhood
L. T. HALLAM, Vice-President for
Community Administration
JOHN E. BROWN, Vice-President for Safety
Councils
HOWARD H. WATSON, Vice-President for
International Affairs
DR. CARLOS H. WATSON, Vice-President for
Health
ALBERT W. WATNEY, Vice-President for
Education
WILLIAM C. THOMPSON
WILLIAM C. THOMPSON, Secretary and Managing
President

Executive Committee

Wishers at large

[illegible]

Representing Safety Councils

WILLIAM F. ANDERSON, Wilmington, W. Va.
 J. L. BLOOMER, York Springs, Pa.
 FREDERICK K. BOWEN, Germantown, Ill.
 H. W. J. BOWEN, Cleveland
 W. W. BOWEN, Jackson
 J. L. BOWEN, New Haven, Conn.
 J. H. BOWEN, Birmingham, Ala.

Erneuerbare Setzungen

1. A. Bortov, Public Children
Proctor H. Condon, Marine
Thomas R. Cummings, Mining
J. L. Frazee, Paper and Pulp
R. N. Hansen, ASSESSING
R. T. Henningsen, Aerial Navigation
Landscape Architecture

For President

[illegible]

Honorary Members

1. James M. McMillan
 2. James M. McMillan
 3. James M. McMillan
 4. James M. McMillan
 5. James M. McMillan
 6. James M. McMillan
 7. James M. McMillan
 8. James M. McMillan
 9. James M. McMillan
 10. James M. McMillan
 11. James M. McMillan
 12. James M. McMillan
 13. James M. McMillan
 14. James M. McMillan
 15. James M. McMillan
 16. James M. McMillan
 17. James M. McMillan
 18. James M. McMillan
 19. James M. McMillan
 20. James M. McMillan
 21. James M. McMillan
 22. James M. McMillan
 23. James M. McMillan
 24. James M. McMillan
 25. James M. McMillan
 26. James M. McMillan
 27. James M. McMillan
 28. James M. McMillan
 29. James M. McMillan
 30. James M. McMillan
 31. James M. McMillan
 32. James M. McMillan
 33. James M. McMillan
 34. James M. McMillan
 35. James M. McMillan
 36. James M. McMillan
 37. James M. McMillan
 38. James M. McMillan
 39. James M. McMillan
 40. James M. McMillan
 41. James M. McMillan
 42. James M. McMillan
 43. James M. McMillan
 44. James M. McMillan
 45. James M. McMillan
 46. James M. McMillan
 47. James M. McMillan
 48. James M. McMillan
 49. James M. McMillan
 50. James M. McMillan
 51. James M. McMillan
 52. James M. McMillan
 53. James M. McMillan
 54. James M. McMillan
 55. James M. McMillan
 56. James M. McMillan
 57. James M. McMillan
 58. James M. McMillan
 59. James M. McMillan
 60. James M. McMillan
 61. James M. McMillan
 62. James M. McMillan
 63. James M. McMillan
 64. James M. McMillan
 65. James M. McMillan
 66. James M. McMillan
 67. James M. McMillan
 68. James M. McMillan
 69. James M. McMillan
 70. James M. McMillan
 71. James M. McMillan
 72. James M. McMillan
 73. James M. McMillan
 74. James M. McMillan
 75. James M. McMillan
 76. James M. McMillan
 77. James M. McMillan
 78. James M. McMillan
 79. James M. McMillan
 80. James M. McMillan
 81. James M. McMillan
 82. James M. McMillan
 83. James M. McMillan
 84. James M. McMillan
 85. James M. McMillan
 86. James M. McMillan
 87. James M. McMillan
 88. James M. McMillan
 89. James M. McMillan
 90. James M. McMillan
 91. James M. McMillan
 92. James M. McMillan
 93. James M. McMillan
 94. James M. McMillan
 95. James M. McMillan
 96. James M. McMillan
 97. James M. McMillan
 98. James M. McMillan
 99. James M. McMillan
 100. James M. McMillan


PLAINTIFF'S
EXHIBIT

G-400

NATIONAL SAFETY NEWS

AUGUST

1933

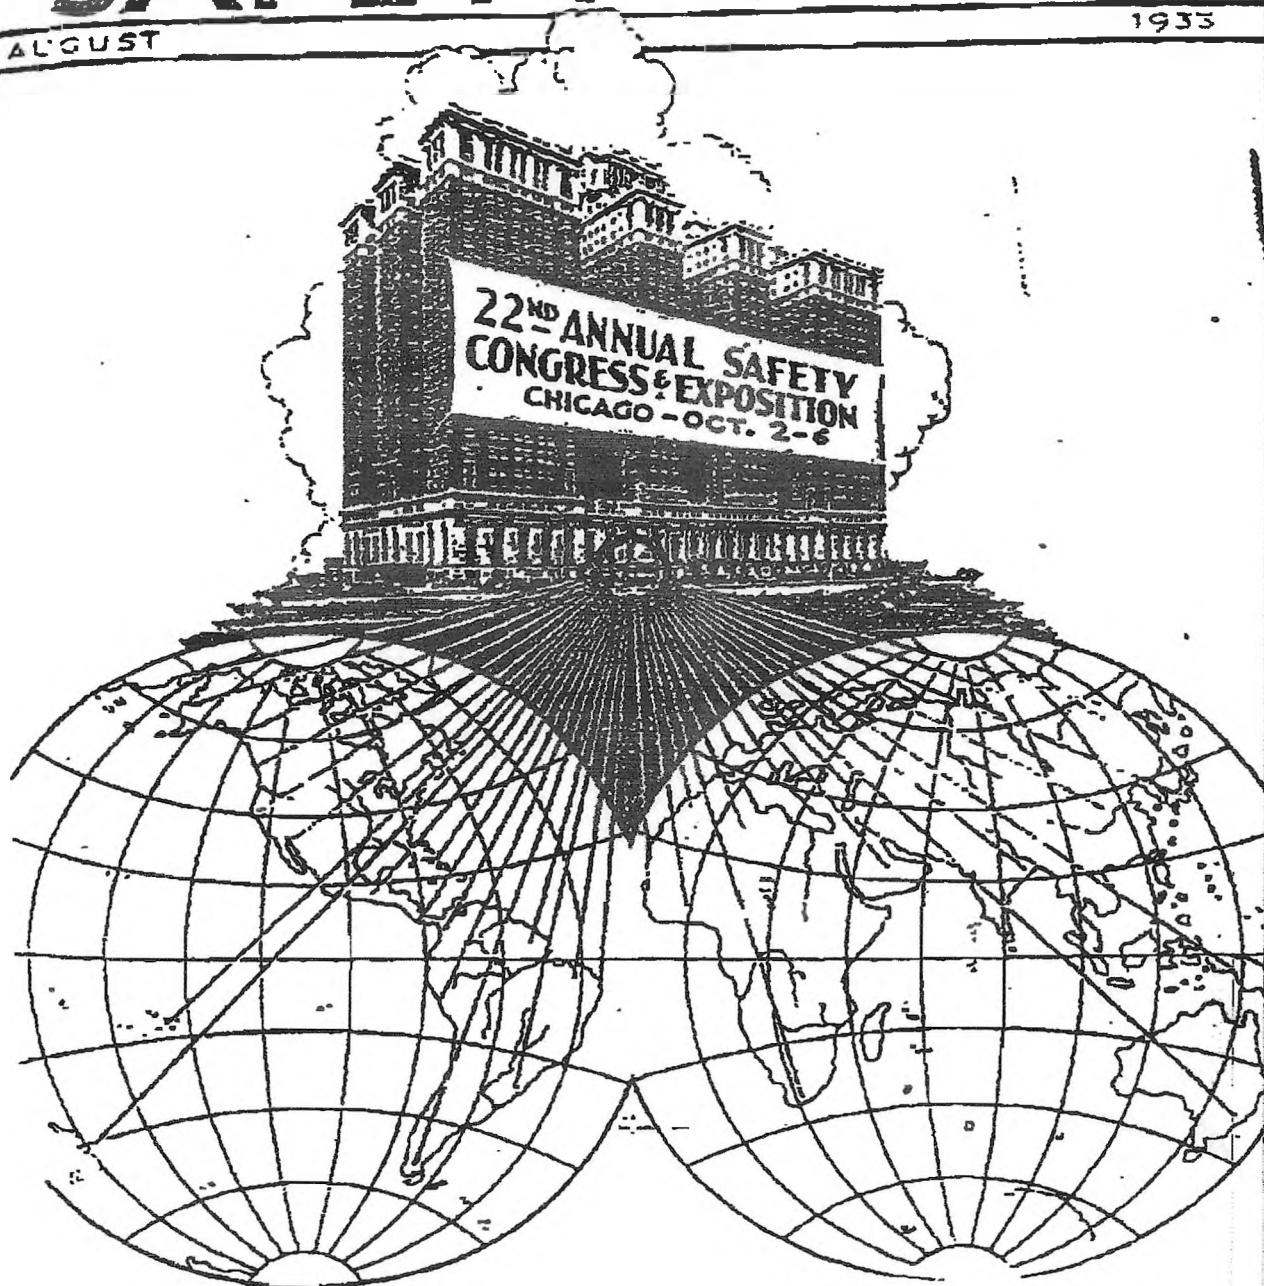

DEPOSITED 8/20/33

DEPOSITION
EXHIBIT

16



The Mechanical Control of Occupational Diseases

By DAVID S. BEYER*

THE mechanical control of industrial disease cannot be covered adequately in a single article; all we can hope to do is to touch upon a few of the important points encountered by the plant managers who are struggling with this problem today.

There are some forty different diseases included in the compensation acts of various American states; in Massachusetts, Connecticut and several other states there is no definite list of diseases that are compensated, but these diseases are considered as "personal injuries" under the law and compensation is paid without any specific schedule of diseases.

Many of these diseases are of infrequent occurrence. Probably most of us outside the medical profession have never even heard of "Gonorrhea Kankasi" (African bushwood) or "miner's cystitis" which appear on some of the state lists. A half dozen of the more important diseases, however, will probably cover ninety percent of the total payments being made throughout industry for all industrial diseases today.

An analysis of approximately \$300,000 in losses of one insurance company doing a general workmen's compensation and liability business, for recent industrial disease claims, showed 54 per cent for cases involving pneumoconiosis (including silicosis, asbestosis, etc.); 26 per cent for lead poisoning; 9 per cent for various forms of dermatitis; 5 per cent for benzol; and the remaining 6 per cent for scattered diseases such as carbon monoxide, carbon tetrachloride, chrome and chlorine.

We will accordingly look at the subject from the standpoint of these few important causes, bearing in mind that the most important of all is covered by the general heading of pneumoconiosis, or diseases caused by dust. Of these diseases the most serious come from inhaling the dust found in sand, granite dust, flour and powders, etc.

*Contributions and Chief Engineer, Liberty Mutual Insurance Company, Boston, Mass. A paper read at the Twelfth Annual Meeting of the American Society of Mechanical Engineers.

• Both the engineer and the physician are needed in protecting the health of the worker and the pocket book of the employer. In this article Mr. Beyer presents the engineering side of the problem. In the June issue Dr. W. Irving Clark discussed it from the point of view of the physician.

When the subject of dust is mentioned most of us probably think of visible particles. In fact, much of the dust removal work, even by companies specializing along this line in the past, has been directed at this form of dust.

Medical research has shown us, however, that the dust that is most dangerous, through its deep inhalation into the lungs, is so small that the individual particles are invisible and can only be seen by the naked eye if they are gathered in a dense cloud, which may have the appearance of a gray fog.

We are told that the amount of dust found in the lungs of miners who have died of silicosis is about 13 grams, or approximately half an ounce—about enough to fill a ten-cent soda-min water bottle.

Microscopic Menaces

Some idea of the problem of collecting such infinitesimal particles may be had when we further learn that these 13 grams contain some 20 million million particles; many of them are about the size of the tiny globules of tarry substance that make up cigaret smoke, that is, about a hundred thousandth of an inch in diameter. If they were equipped with legs they could march fifty abreast through the hollow center of a human hair!

So little has the seriousness of this hazard been appreciated in the past that it is not uncommon to go into a plant and find four or five tons of this fine dust which has floated in the air and settled on the roof trusses and overhead structures of the building. Here it may be dislodged by gusts of air or vibrations from moving cranes, etc. If one

stops to figure how many 13-gram bottles are contained in a ton of this dust its potentialities are appalling. The first need is to get rid of these unnecessary accumulations, and then try to prevent their recurrence.

Many a plant manager will say, "We go to all the trouble and expense necessary to catch this dust when, in most cases, it isn't worth anything after it's caught?" The answer is that it is better to spend the money and effort in getting rid of the dust than to be overwhelmed by occupational disease claims, as is the case with many industrial concerns today.

In one section where there is a so-called "dusty" trade employing on about 2000 men an annual loss has there have been 92 occupational disease claims during the latest available five year period (48 of them for death, permanent total disability) with combined losses of nearly \$300,000.

In some industries the cost of industrial disease is now four or five times that of all other industrial accidents combined. Many concerns that have serious occupational disease hazards, tending over a period of years to themselves virtually unmanageable, because of the heavy liability for claims that has been built up as the result of past exposure.


A Matter of Self-Preservation

It follows, therefore, that as a matter of self-preservation plants in these industries must start immediately a comprehensive program of improvement that will at least check the development of new cases.

In general, the most reliable way

Mechanical Control of Occupational Diseases

(continued from page 22)

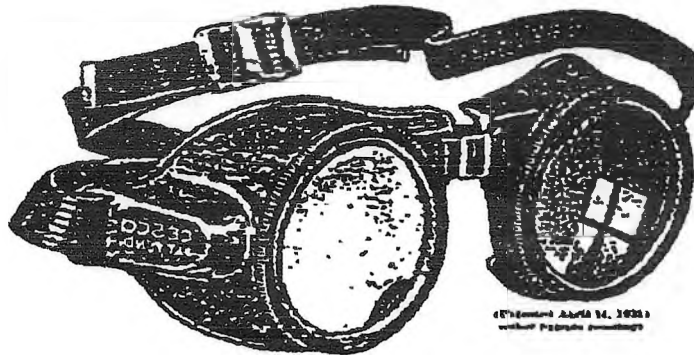

(Patented April 14, 1933)
without Federal approval

TO WEAR OVER GLASSES

If you have workmen who wear glasses give them the absolute assurance of eye protection as well as good vision by having them wear CESCO M & L GOGGLES over their prescription lenses.

These men will do better work and accident costs will be reduced.

CESCO M & L GOGGLES are specially designed to be worn over the workman's own spectacles—they fit snugly, are comfortable

and prevent breakage and pitting of expensive prescription lenses.

CESCO M & L GOGGLES are furnished in three styles meeting all necessary requirements. Ventilated pattern fitted with Super Safety lenses for chipping, grinding, cutting, erecting and like operations. Dura model fitted with Super Safety lenses. Welder's pattern fitted with CESCOWELD lenses for acetylene welding and cutting.


Send for sample and catalog

CHICAGO EYE SHIELD CO.

2300 Warren Blvd.

Chicago, Ill.

PLACE "STOP LOSS" ORDERS



Order a D. & M. Automatic Guard for the 50-ton 6" M.P. Press. State size and make of press and it will be sent to you at once.

Guard against costly punch press accidents. Order D. & M. Automatic Punch Press Guards. They are your "stop loss" against those unfortunate happenings that mean losses in men, money and morale.

D. & M. Automatics fit all punch presses - have only 3 working parts - are made entirely of drop forgings and steel (except the guard head) and are low in price \$12.50 - \$22.00.

TAYLOR SHANTZ CO. 488 ST. PAUL STREET, ROCHESTER, N.Y.

to effectively control dust requires thorough understanding of certain engineering principles that are completely lost sight of in many of the installations now in use.

For example, where the dust collector can be so arranged as to enclose the source of dust completely, or almost so, a very complete dust elimination may result, but where the inlet is five or six inches away from the source of the dust its efficiency may be reduced by as much as 90 to 95 per cent, and be wholly ineffective.

Where the exhaust equipment has been looked on in the past as more or less of a nuisance because it is non-productive and could accordingly be slighted will, it must now be recognized as a primary operating problem, and responsibility must be placed on someone to see that it is kept in first class condition at all times.

And so, to summarize the results of this brief survey of the mechanical control of occupational disease hazards, is the opinion of the writer that chief in this direction lies safety from some of the most serious diseases, if one also includes rearrangement of the process under "mechanical control," in contrast with the "medical control."

While agreeing that medical supervision of new prospects for employment of primary importance, in order to prevent placing new employees who have some physical impairment in a position where they will quickly break down as a result of the work hazard, and grant the value of medical follow-up of employees subjected to exposures such as lead and benzol, which bring about temporary condition that may be checked by medical supervision and a change of occupation. It seems evident that in the most serious industrial disease hazard that of exposure to silica dust, chief dependence must be placed on elimination or control of the dust.

In installing such equipment it is a waste of money and grief in the long run, to employ a competent engineer who understands the difficulties of collecting the palpable dusts or vapors, and can be a reasonable assurance of getting effective installation without too much of the "cat and dog" method.

For further information, contact the author at the "Stop Loss" Co., 111 Madison Ave., New York 17, N.Y., and Ventilation, Inc., 1111 1st St., New York 17, N.Y.

equipment that will capture the dust at the point where it is generated. This has been worked out very effectively for such equipment in grinding and milling wheels.

Unfortunately a complete system of dust collecting and separating for a large department costs a lot of money—more than many plants feel they can possibly afford under present business conditions.

Temporary Expedients

For such cases there may be other alternatives or temporary expedients that will at least tide matters over until improved business conditions warrant the installation of a permanent dust removal system.

For instance, the manager of a plant recently visited by the writer stated that they had already spent \$50,000 in exhaust equipment and had not yet fully solved the dust problem. In this industry, the use of oil which has been sprayed on the material in some cases in the past, to improve its handling in the machinery and processes, offers a promising solution to the dust problem. Dust counts in some plants using the oil show reductions of 90 per cent or more in millions of particles per cubic foot, and if further tests corroborate these results it offers a simple and comparatively inexpensive method of correcting the dust hazard in one industry.

In other operations, such as the shaking out of foundry castings, it may be possible to do this work at night, by men who are protected by respirators, and thus eliminate a common exposure to employees engaged in other operations in the same room. The use of enclosed mechanical conveyors and material handling systems, properly exhausted, instead of the old individual hand methods where the workers were brought into close contact with dusty substances, offers a solution in other cases.

The treasurer of one concern with whom I recently discussed the hazard of his laundry said, "Maybe we have the answer right here," and he brought out the design of a machine which was fabricated entirely from sheets, plates, angles and other structural shapes, riveted and welded together, which would entirely eliminate the castings of which it was largely composed in the past.

Where the dusty work is in a permanent location, and the great freedom of movement is not required, the air-fol-

respirator may give satisfactory results. For cases of temporary dust exposure, as for sweeping and cleaning up dust, the improved types of filter respirators may be adequate. In some cases substitutes may be found for the substance causing the trouble. This has already been done in some processes where benzol was formerly used, and efforts are being made to extend the use of this principle.

The use of water to overcome dust hazards is one of the first suggestions that is usually made. I recently tried to explain this problem to an industrial manager and after telling him that the dust which causes the trouble is less than 10 microns in size, a micron being about 1/25,000th of an inch, and being encouraged by his nods which seemed to indicate that he was following my explanation perfectly, I was a little discouraged at the end to have him say, "Why can't you get rid of those microns by washing the air?" Apparently after all my efforts he still thought a micron was something like a microbe!

Water has been found rather effective for laying the dust in some operations such as mixing, sweeping up dusty floors, etc. In other cases, it has been a disappointment as, for example, on grinding wheels, where a dry exhaust system has proved to be more satisfactory than wet grinding.

During the conference in South Africa in 1921, one of the speakers pointed out the futility of trying to completely remove dust clouds by water sprays or atomizing, adding the further comment that a tiny droplet of water may collect as many as 500 dust particles and then being inhaled is like hawking the lungs with sputum instead of simple air.

Unwarranted Confidence

Where exhaust equipment is installed, poor maintenance of these systems whereby their value is reduced or entirely vitiated is altogether too common. An inquiry in a plant recently as to how the dust filtering apparatus was working brought the reply, "Fine!—we haven't had to stop work at it for six years!" When we climbed a ladder to the roof to see this miraculous equipment, a touch on the screens shook a pail-full of dust from the "clean" side of the separator.

Another common and dangerous practice in many dust removal systems is

that of returning the filtered air to the plant in order to conserve the heat that would be lost if it were discharged outside the building. In five such systems where dust counts have been made during the past few months there was only one where there was even a question as to whether or not the air was fit to be returned. In one case over forty-seven million dust particles per cubic foot were found in the air that was being recirculated, or many times what we would consider a safe limit!

Ineffective Installations

The salesman who had put in the equipment had persuaded them that the filtered air was so much purer than God's product as represented by the outside atmosphere that he had even piped it into the office, so the manager was breathing the dust as well as the factory employees. (Perhaps that might be called cooperation!)

While it may be going too far to say that no filtering equipment can make dusty air suitable for re-breathing, the constant chance of the system getting out of order makes it almost as questionable a practice as an attempt to recover drinking water from a sewage system.

Installations that are clogged, leaking and otherwise ineffective are common. One of our engineers found that the belt connecting the exhaust fan to the motor in an overhead installation had been off for an indefinite period. The motor switch had been thrown regularly but no one noticed that there was no exhaust at the grinding wheels it serviced.

In another installation seen by the writer recently, a handkerchief held before the wheel hood out horizontally, showing that the dust was being blown out toward the operator instead of being drawn in away from him.

An important point that should be borne in mind in designing an exhaust system is that it is highly desirable to capture the dusts or vapors as close to the point at which they are generated as possible, before they have had a chance to be diffused throughout the air of the room.

General ventilation may be helpful in reducing the concentration, but it is obviously of little value to draw the objectionable substances up through a roof fan as is sometimes done, thereby carrying them past the faces of the operators who must draw them in with every breath.

The design of a proper exhaust system

Please turn to page 52

The Health of Workers in United States
U. S. Public Health Bulletin No. 157.
—Editorial—
—International Labour