

D.L. APPLICATION**B.2. LONGITUDINAL-VERTICAL PIPE****2.1 SECTIONAL AND SEGMENTAL**

- 1.1 The 1st layer of sectional and segmental covering shall be applied in such a manner that a minimum of cutting will be required to fit the 2nd layer around supports, run outs, etc.

B.3. CIRCUMFERENTIAL JOINTS**3.1. SECTIONAL COVERING**

- 1.1 Sectional covering shall have a 12" x 24" stagger of butt joints.
- 1.1a One half the section shall be cut as shown in figure 3A and the two pieces one 12" and one 24" long shall be applied as shown in figure 3B.

FIG. 3A
SECTIONAL


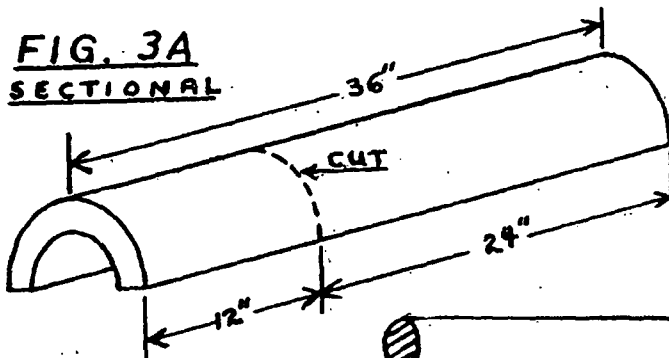


FIG. 3B
1ST. LAYER

**B 3.2 TRI-SEGMENTAL COVERING**

- 2.1 Tri-seg. covering shall have a butt joint stagger of 6" x 18" x 30".
- 2.1a One 36" long segment shall be cut as shown in figure 4A making a 30" long segment and a 6" long segment.

FIG. 4A
TRI-SEG

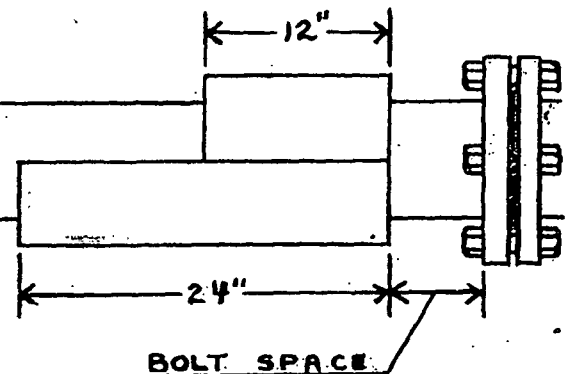