

Example 5. Assume that the heating units shown in Fig. 26 are handling 50,000 cfm of air and that the rise in the first row is from 0 to 40 F, in the second row from 40 to 65 F, and in the third row from 65 to 80 F. What is the load in EDR on each supply and return connection?

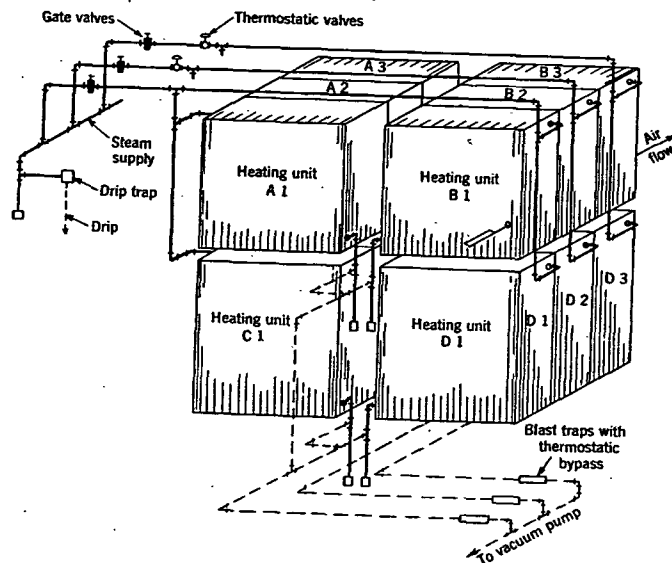


FIG. 26. TYPICAL PIPING FOR ATMOSPHERIC AND VACUUM SYSTEMS WITH THERMOSTATIC CONTROL (CENTRAL FAN SYSTEM)

Solution. For row 1,

$$R = \frac{50,000 \times (40 - 0)}{220.8} = 9058 \text{ sq ft.}$$

For row 2,

$$R = \frac{50,000 \times (65 - 40)}{220.8} = 5661 \text{ sq ft.}$$

For row 3,

$$R = \frac{50,000 \times (80 - 65)}{220.8} = 3397 \text{ sq ft.}$$

Each row of heating units consists of four stacks and each stack has two connections so that the load on each stack and each connection of the stack is as follows:

Row	TOTAL LOAD (EDR)	STACK LOAD ^a (EDR)	CONNECTION LOAD ^b (EDR)
1	9058	2265	2265 or 1132
2	5661	1415	1415 or 708
3	3397	849	849 or 425

^aOne quarter of total row load.

^bOne half of stack load if two steam connections are made; otherwise, same as stack load.

The pipe sizes would then be based on the length of the run and the pressure drop desired, as in the case of radiators. It generally is considered desirable to place the indirect heating units on a separate system and not on supply or return lines connected to the general heating system.

DRIPPING

Any steam main in any type of steam heating system may be dropped to a lower level without dripping if the pitch is downward with the steam flow. Any steam main in any heating system can be elevated if dripped (Fig. 27). Steam mains also may be run over obstructions without a change in level if a small pipe is carried below the obstruction to care for




FIG. 27. DRIPPING MAIN WHERE IT RISES TO HIGHER LEVEL




FIG. 28. LOOPING MAIN AROUND BEAM




FIG. 29. LOOPING DRY RETURN MAIN AROUND OPENING




FIG. 30. METHODS OF TAKING BRANCH FROM MAIN




FIG. 31. CONSTANTS FOR DETERMINING LENGTH OFFSET PIPE




FIG. 32. DIRT POCKET CONNECTION

the condensation (Fig. 28). Return mains may be carried past doorways or other obstructions by using the scheme illustrated in Fig. 29; in vacuum systems it is well to have a gate valve in the air line.

Branches from steam mains in one-pipe gravity steam systems should use the *preferred connection* shown in Fig. 30, but where radiator condensation does not flow back into the main the *acceptable method* shown in the same figure may be used. This acceptable method has the advantage of giving a perfect swing joint when connected to the vertical riser or radiator connection, whereas the preferred connection does not give this swing without distorting the angle of the pipe. Runouts from the steam main are usually made about 5 ft long to provide flexibility for movement in the main.

Offsets in steam and return piping should preferably be made with