

Competition with other fuels, especially gas, seems to be the major controlling factor. The first cost of electric storage heaters is also greater than for gas, owing to the need for larger tank storage due to off-peak service and slower recuperating capacity.

It is often desirable to connect an electric heater to a residential system having a coil in the fire-box of the furnace. In this case it is important to make the proper connections in order to benefit by any heat obtained from the furnace and at the same time to prevent dangerous overheating. The proper piping connections are shown in Fig. 10, and in this case the electric heater will only furnish heat when insufficient heat is supplied from the furnace. This arrangement has a further advantage in the summertime in that the bare tank through which the cold water passes on its way to the electric heater serves as a tempering tank, absorbing considerable warmth from the basement air and requiring the use of less energy in the electric heater.

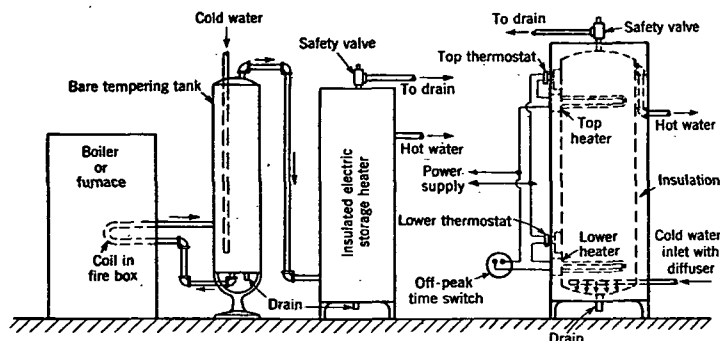


FIG. 10. PIPING ARRANGEMENT FOR CONNECTING ELECTRIC WATER HEATER TO FIRE-BOX COIL

FIG. 11. DOMESTIC HOT WATER HEATER FOR OFF-PEAK SERVICE

A typical domestic hot water heater as shown in Fig. 11 is arranged with upper and lower heating elements for the usual type of off-peak heating service for which most utilities have especially attractive low power rates. The lower heating element is under the control of the off-peak time switch. However, the upper heating element is usually connected to the line so that in case the supply of hot water in the tank becomes exhausted the top thermostat can turn on the top heater and heat a small supply of water. The top heater will not heat the water in the tank below its location, but when the off-peak period arrives the lower heater is turned on and the entire tank becomes heated.

INDUSTRIAL ELECTRICAL HEATING

Electric heating elements have been successfully developed for industrial work such as annealing, brazing, carburizing, enameling, forging, ceramic firing, hardening, metal melting, nitriding and process heating. Industrial ovens and furnaces where precise control of temperature is necessary can be very successfully operated with electric resistance ele-

ments at temperatures as high as 1800 F. For higher temperatures the electric arc or high frequency induction methods are often used. Electric heaters for heating oil to high temperatures for secondary circulation in process work are used as a substitute for superheated steam. Special oil can be electrically heated as high as 700 F and pumped at a pressure just sufficient to cause flow. When used in heating coils or jacketed vessels, this gives a safe and convenient automatic system for moderate-sized installations. Pitch, waxes, and many chemicals are successfully heated by electricity, but require careful design and adequate automatic control.

REVERSED CYCLE REFRIGERATION²

Reversed refrigeration is frequently referred to as a *heat pump* since the electric motor driving the refrigerating compressor furnishes the motive power to transfer heat from one temperature to a higher temperature level. The compressor acts as a reversible refrigerating unit to extract heat from the outdoor air in winter and deliver it indoors for heating purposes, and, by a reversal, to extract heat from the indoor air in summer and discharge it outdoors.

In normal use a refrigerating machine is arranged to remove heat and the heat removed is dissipated to the condenser cooling water. The driving energy is converted into heat most of which is added to the heat removed and extracted. In so-called reversed refrigeration the heat removed together with the heat converted from the driving energy is utilized to heat the building. This conservation of the heat converted from the driving energy enables the reversed refrigeration to show a better performance in heating service than straight refrigeration can show in cooling service. For a detailed description of this cycle see Chapter 24.

AUXILIARY ELECTRIC HEATING

In conjunction with heating systems of other types, an auxiliary electrical heating arrangement is a convenient means of caring for mild days in the spring and fall which require little heat to make a building comfortable. Likewise, such electrical heating might be used on abnormally cold days to help out the main heating system and by this means reduce the necessary size of the system.

Because of the feeling of comfort that a radiant type heater gives, bathrooms may be heated electrically with this type of heater while the rest of the house is cared for by some other system. Offices and rooms which require heat at periods when the main heating plant is shut down

²Cooling Homes. A Field for Refrigeration, by A. R. Stevenson, presented at the symposium of the Refrigeration with Gas Committee of the American Gas Association, April 20, 1926.

The Heat Pump, An Economical Method of Producing Low-grade Heat from Electricity, by T. G. N. Haldane (*Electric Review*, Vol. 105, p. 1161-1162, December 27, 1929, and *I. E. E. Journal*, Vol. 68, p. 666-675, June, 1930).

Edison Building Heated and Cooled by Electricity, by H. L. Doolittle (*Power*, Vol. 74, p. 384, September 8, 1931).

House Heating by Pump with 5 to 1 Pick-up Ratio, by Gilbert Wilkes and R. E. Marbury (*Electrical World*, Vol. 100, p. 828, December 17, 1932).

An All Electric Heating, Cooling and Air Conditioning System, by Philip Sporn and D. W. McLennan (*A.S.H.V.E. TRANSACTIONS*, Vol. 41, 1935, p. 307).

Using the Reversed Cycle Refrigerating Principle for a Self-Contained Heating and Cooling Unit, by Henry L. Galson (*A.S.H.V.E. JOURNAL SECTION, Heating, Piping and Air Conditioning*, October, 1935, p. 497).