


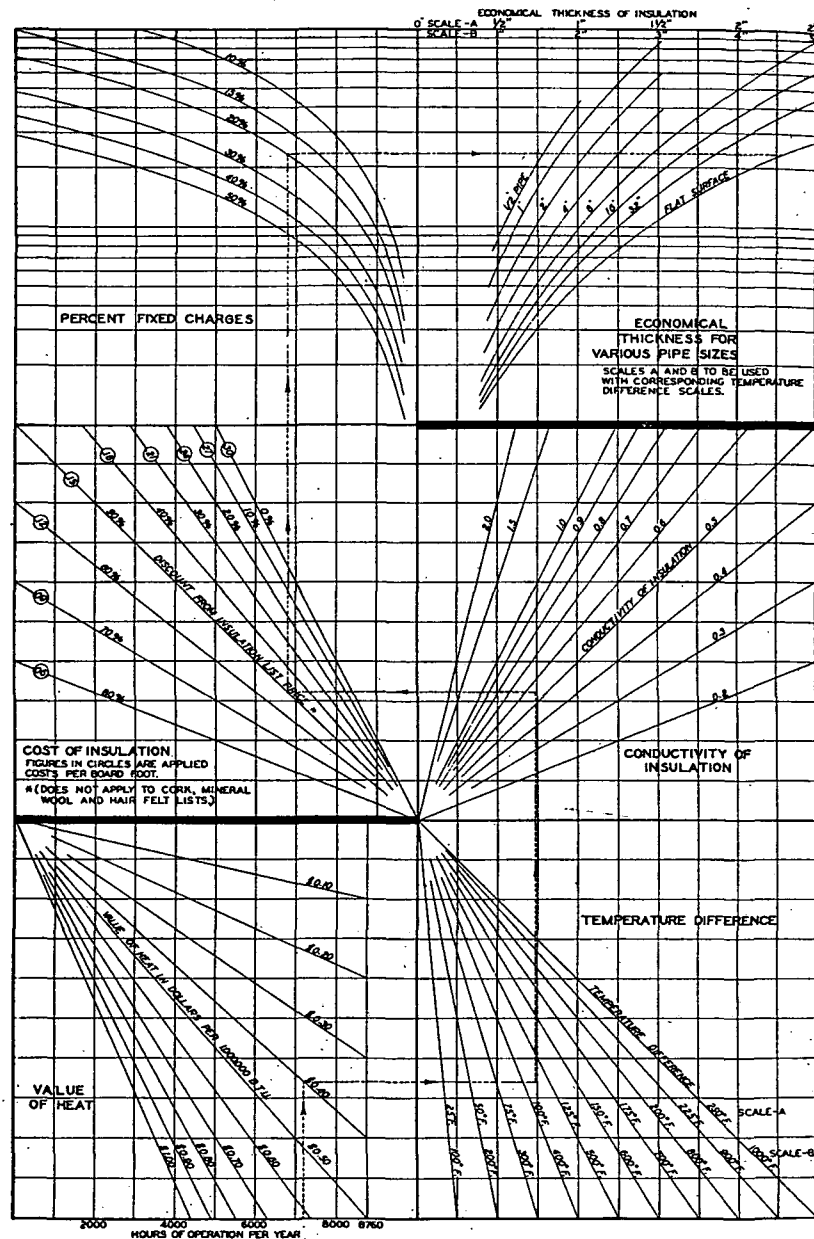

(L. B. McMillan, Proc. National Dist. Heating Assn., Vol. 18, p. 138).

FIG. 6. CHART FOR DETERMINING ECONOMICAL THICKNESS OF PIPE INSULATION

UNDERGROUND PIPE INSULATION

Underground steam distribution lines are carried in protective structures of various types, sizes and shapes. (See Chapter 17.) Detailed data on commonly used forms of tunnels and conduit systems have been published by the *National District Heating Association*².

Pipes in tunnels are covered with sectional insulation to provide maximum thermal efficiency and are also finished with good mechanical protection in the form of metal or waterproofing membrane outer jackets. Conduit systems are in more general use than tunnels. Pipes carried in conduits may be insulated with sectional insulation; however, the more usual practice is to fill the entire section of the conduit around the pipes with high quality, loose insulating material. The insulation must be kept dry at all times, and for this purpose effective waterproofing membranes enclose the insulation. A drainage system is also provided to divert water which may tend to enter the conduit.

The economical thickness of insulation for underground work is difficult to determine accurately due to the many variables which have to be

TABLE 13. THICKNESS OF LOOSE INSULATION FOR USE AS FILL IN UNDERGROUND CONDUIT SYSTEMS

STEAM PRESSURES (LB GAGE) OR CONDITIONS	STEAM TEMPERATURES DEGREES FAHRENHEIT	MINIMUM THICKNESS OF INSULATION IN INCHES					MINIMUM DISTANCE BETWEEN STEAM AND RETURN
		STEAM LINES			RETURN LINES		
		Pipes Less than 4 In.	Pipes 4 In. to 10 In.	Pipes Larger than 12 In.	Pipes Less than 4 In.	Pipes 4 In. and Larger	
Hot Water, or 0 to 25	212 to 267	1½	2	2½	1¼	1½	1
25 to 125	267 to 352	2	2½	3	1¼	1½	1¼
Above 125, or superheat	352 to 500	2½	3	3½	1¼	1½	1½

considered. As a result of theories³ previously developed, together with other experimental data which have been presented, the usual endeavor is to secure not less than 90 per cent efficiency for underground piping. Table 13 can be used as a guide in arriving at the minimum thickness of loose insulation fills to use for laying out conduit systems. Other factors such as the number of pipes and their combination of sizes, as well as the standard conduit sizes, are primary controlling factors in the amount and thickness of insulation for use.

When sectional insulation is applied to lines in tunnels or conduits, usual practice is to apply the most efficient materials ½ in. less in thickness than that determined by the use of Fig. 6. The data in Fig. 6 are based on conditions of insulation exposed to the air, whereas normal ground temperature is substituted for air temperature in determining the temperature difference for use with the chart when applying it for underground pipe line estimates.

¹Handbook of the *National District Heating Association*, Second Edition, 1932.²Theory of Heat Losses from Pipes Buried in the Ground, by J. R. Allen (A.S.H.V.E. TRANSACTIONS, Vol. 26, 1920, p. 335).