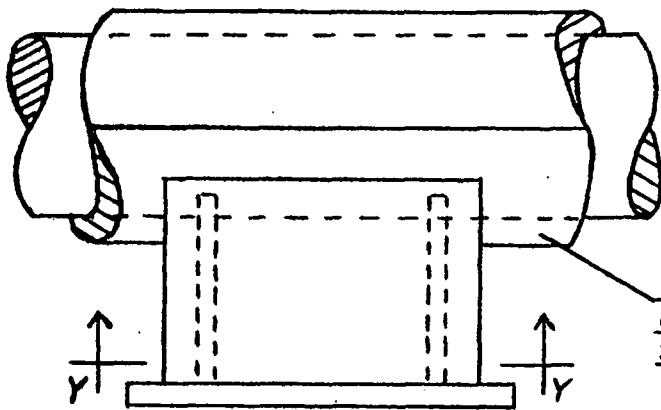
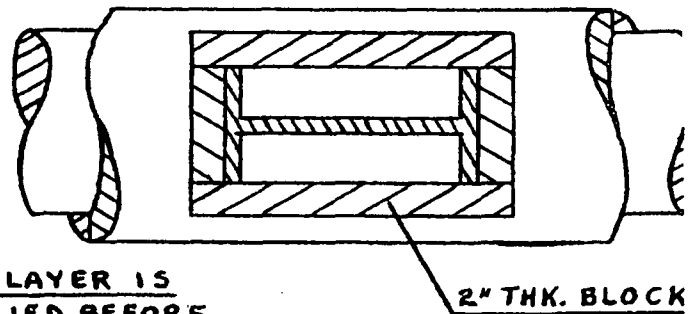


D.L. APPLICATION

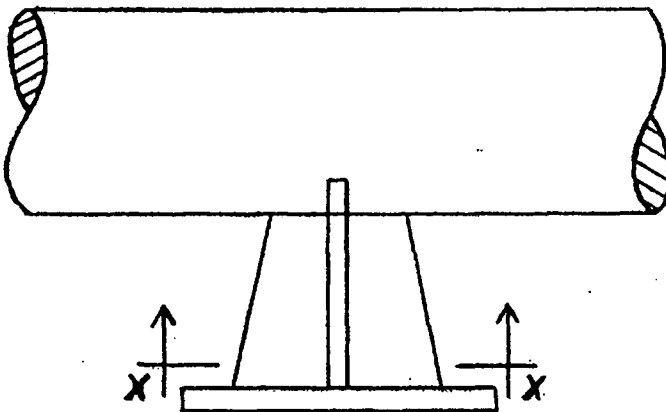
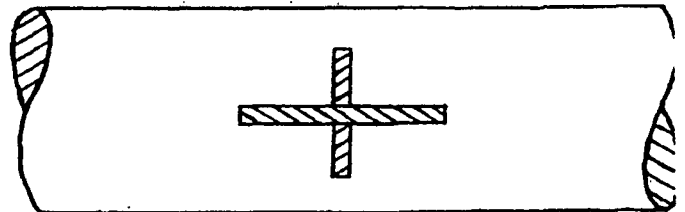
- 1c The support shall be insulated out from the surface of the line covering 6 to 8 inches.

FIG. 26 ASIDE VIEW

1ST. LAYER IS
APPLIED BEFORE
SUPPORT BOXED

FIG. 26 B"Y-Y"

4.2 + TYPE SUPPORTS - figures 27A and B.

FIG. 27 ASIDE VIEWFIG. 27 B"X X"

- 4.2a + type supports shall be insulated with one layer of 2" thick calcium silicate block.
4.2b The block shall be fitted and cemented to the legs of the support as shown in figures 28A and B.