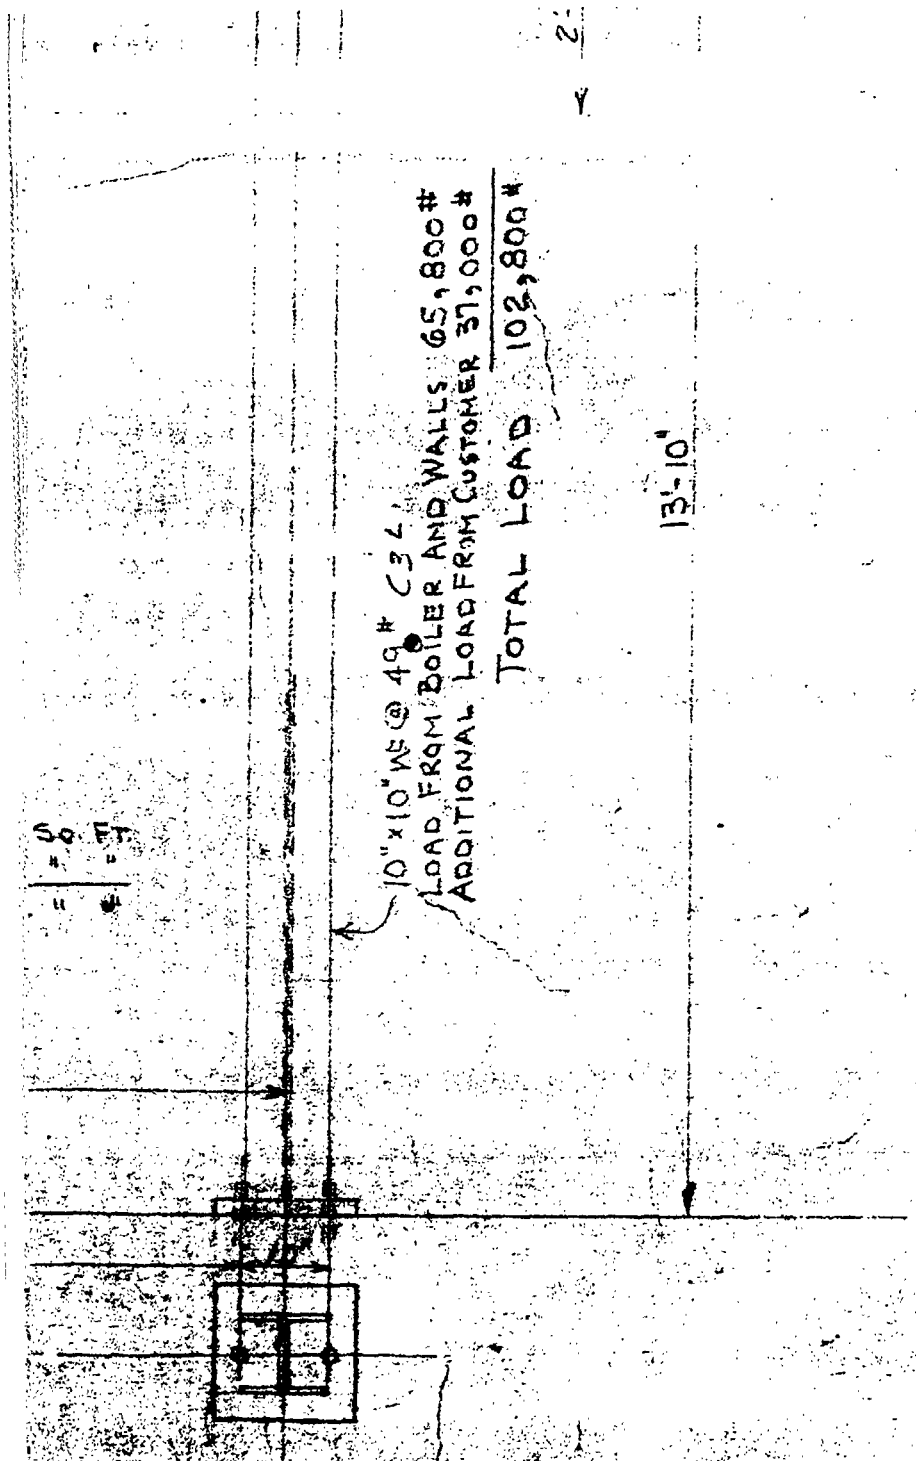

E	CHECKED	7-31-5[illegible]
D	ADDED SPACING OF REAR CIRC. TUBES. ADDED 2 MORE STEAM TUBES FOR EACH SIDE WALL. ADDED MISC. DIMENSIONS.	5-13-5[illegible]
C	STEAM PIPE MOVED OUT 2'-0½"-FOUNDATION ADDED. BE WALL & REAR COLS. SHORTENED 5'-6"-6 BLR. TO FACE OF FLG (DIMENSIONS ADDED)	2-14-5[illegible]
B	ADDED NORMAL WATER LEVEL. CHG'D. LOCATION OF OPENINGS ON DRUM # 2 OMITTED "NF" FROM STEELWORK.	1/15/[illegible]
A	SUPER. OUTLET HEADER LENGTHENED. ADDED COLUMN LOADS, WALLS, AND MISC. BEAMS. CHG'D. COL. CENTERS AND MADE CONNECTIONS ON DRUMS FLANGED.	12/28/[illegible]

ERIE CITY IRON WORKS

ERIE, PA., U. S. A.

NUMBER	SIZE	TYPE
2- 22/24 WL 3¼" 32 WL 2¼"	70,000#/HR. 325#	3-DRUM

SETTING PLAN

OKLAHOMA STATE PENITENTIARY

McALESTER, OKLAHOMA

DRAWN BY	TRACED BY	CHECKED BY
M.F.R.		[illegible]
ORDER	DATE	[illegible]
472-51	12-5-51	

CARD 88838-E INDEX CA-5052

PLAINTIFF'S EXHIBIT

ZUR-55