APPLICATION
BASIC INSULATION

PIPE AND FITTINGS

CALCIUM SILICATE
SINGLE LAYER:

FIG. 49 B — 2ND. STEP

After flange cover has been applied the pipe between the line insulation and cover is covered allowing 3/16" 'A' cloth space - "Y".

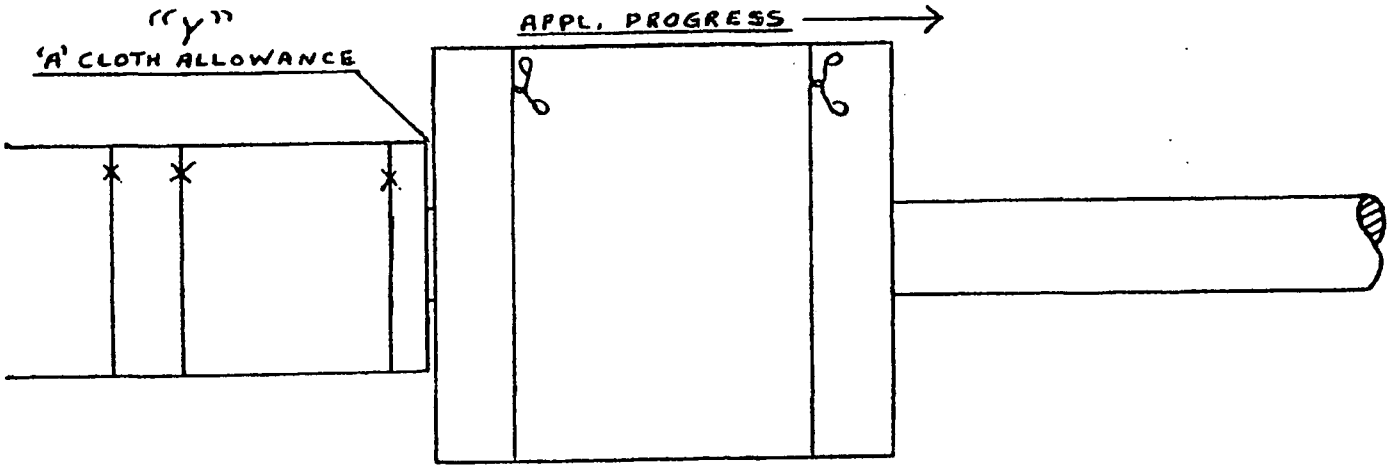


FIG. 49 C — 3RD. STEP

Line insulation is continued allowing 3/16" 'A' cloth space "Z".

