
APPLICATION
BASIC INSULATION
PIPE AND FITTINGS

URETHANE:

C. 11. Butting pipe insulation to built-up covers:
11.1 The pipe insulation shall be butted snugly and sealed to permanent type built-up covers. See figure 50.

FIG. 50 FLANGE COVER

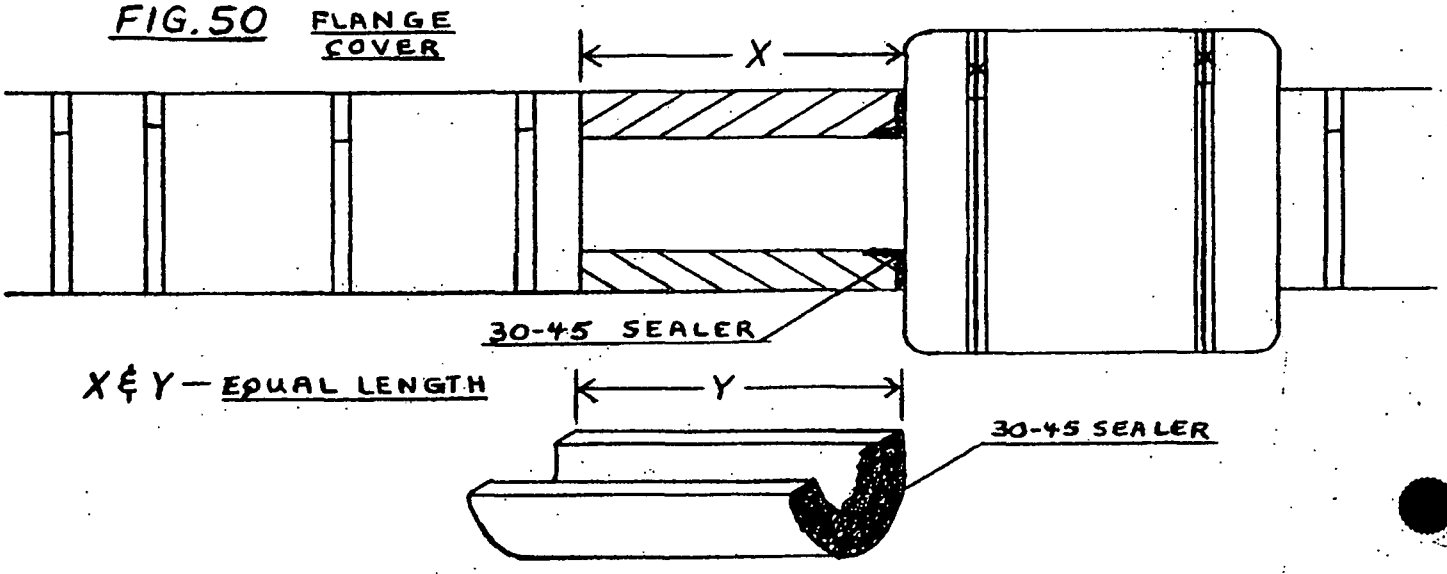

11.2 The pipe insulation shall not be butted snug to semi-portable covers. A gap, approximately 1/4 of an inch wide, shall be allowed between the cover and the line insulation at each end. See figure 51. This gap will permit the removal of the cover without damaging the line covering.

FIG. 51

FLANGE COVER (SEMI-PORTABLE)

