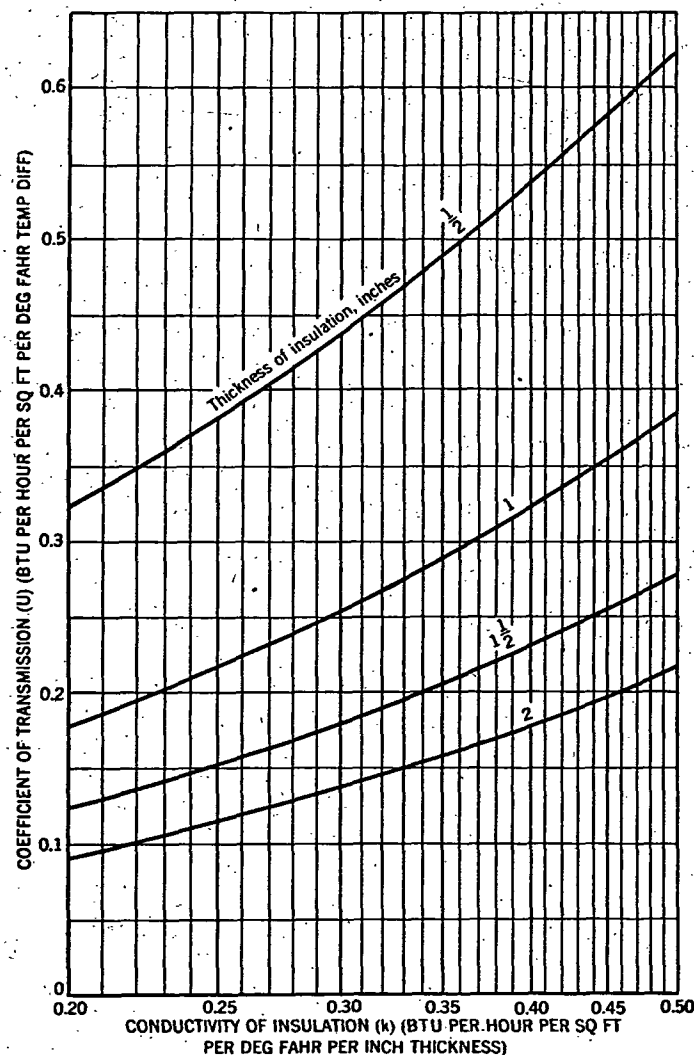


FIG. 9. HEAT LOSS COEFFICIENTS FOR INSULATED DUCTS^a^aFor round ducts less than 30 in. diameter, increase heat transmission values by the percentages shown.

THICKNESS OF INSULATION (Inches)	1/4	1	1 1/2	2
21 to 30 in. Duct Diameter	1%	2%	3%	4%
12 to 21 in. Duct Diameter	3%	5%	7%	9%

A = cross-sectional area of duct, feet.

D = diameter of round duct, feet.

V = velocity of air in the duct, feet per minute, at specified temperature.

ρ = density of air, pounds per cubic foot, at the specified temperature at which V is measured.

e = Napierian base of logarithms = 2.718.

In using Equations 13, 14 and 15, one of the duct air temperatures will be unknown and will be solved for by substitution of the other known or assumed values.

Heat loss coefficients for insulated ducts with various conductivities are given in Fig. 9. The conductivities of various materials, which are based on mean temperatures, ranging from about 70 to 90 F, will be found in Table 2 of Chapter 4. For cases where the mean temperature is other than that on which the test was conducted, a correction should be made. However, in most cases the effect of this factor will be small and may be neglected.

Example 4. Determine the entering air temperature and heat loss for a duct 24 × 36 in. cross-section and 70 ft in length, insulated with 1/2 in. of a material having a conductivity of 0.35 Btu at 86 F mean temperature, carrying air at a velocity of 1200 fpm, measured at 70 F, to deliver air at 120 F with air surrounding the duct at 40 F.

Solution. Referring to Fig. 9, the over-all heat transmission coefficient is found to be 0.49 Btu. From Table 6, Chapter 1 the density of air at 70 F and 29.92 in. Hg is found to be 0.0749 lb per cubic foot. Substituting these and the other given values in Equation 13:

$$y = \frac{28.8 \times 6 \times 1200 \times 0.0749}{0.49 \times 10 \times 70} = 45.3$$

$$t_1 = \frac{120 (45.3 + 1) - 80}{45.3 - 1} = 123.7$$

Substituting in Equation 11:

$$Q = 0.49 \times 10 \times 70 \left[\left(\frac{123.7 + 120}{2} \right) - 40 \right]$$

$$Q = 28,100 \text{ Btu per hour.}$$

For special considerations which apply to insulation of ducts in marine installations see Chapter 38.

REFERENCES

- Method of Determining Rectangular Equivalents and Weights of Ducts, by Peter Franck (A.S.H.V.E. JOURNAL SECTION, *Heating, Piping and Air Conditioning*, December, 1940).
- The Flow of Liquids, by W. H. McAdams (*Refrigerating Engineering*, February, 1925, p. 279).
- A Study of the Data on the Flow of Fluids in Pipes, by Emory Kemler (*A.S.M.E. Transactions*, Hydraulics Section, August 31, 1933, p. 7).
- Air Conditioning and Engineering, American Blower Corp.
- Fan Engineering, Buffalo Forge Co.
- Heat Power Engineering, by Barnard, Ellenwood, and Hirshfeld, Part III (John Wiley & Sons).
- Mechanical Engineers' Handbook, by Lionel S. Marks (McGraw-Hill Book Co.).