SELECTOR


# 1

# PYDRAUL®

## Fire-Resistant Hydraulic Fluid

A guide to selecting the correct Pydraul fluid for hydraulic systems. O/FF-3

Monsanto

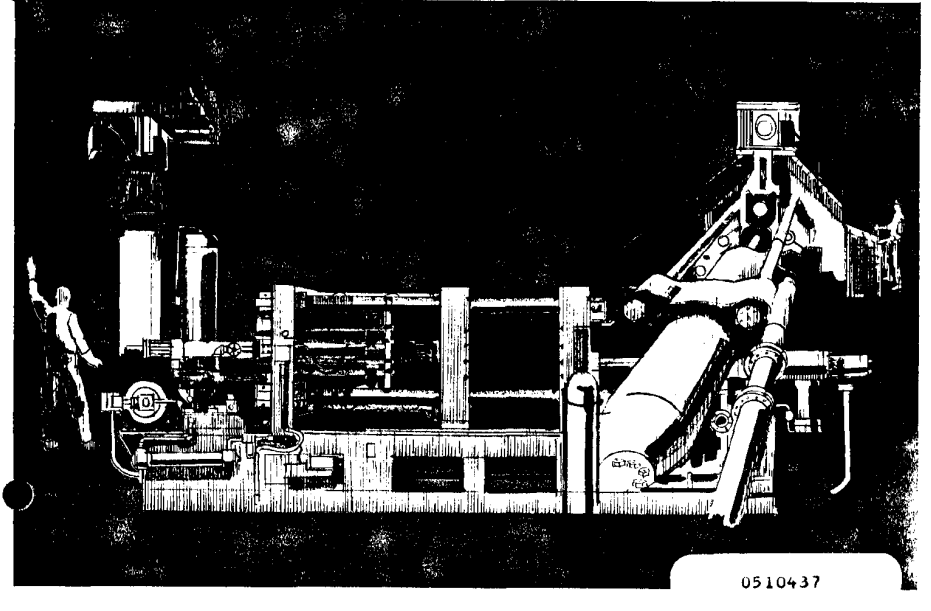


TOWOLDMON0035624
WATER_PCB-00020093

0510438

TOWOLDMON0035625
WATER_PCB-00020094

# PYDRAUL® fluids

## Development

Fire protection for industrial hydraulic operations began with Pydraul in 1951. Pydraul fluids have since provided industry with millions of machine hours of safe operation. Pydraul fluid has never caused a fire—not even when sprayed from broken high pressure hydraulic lines onto white-hot surfaces.

New ways are continuously being explored to improve the excellent performance records of Pydraul fluids. From the first Pydraul fluid, (Pydraul F-9) the family has grown to a dozen-plus specially tailored, fire-resistant safety fluids. Each answers a major but specific hydraulic fluid need for industrial use. In addition to guarding against fire, each Pydraul fluid lubricates as well as premium grade oil. Pydraul fluids have answered the need of virtually every industrial hydraulic operation, indoors and out—from the sub-zero, outdoor hydraulic lift operations for refineries and blast furnaces to the low-viscosity fluid demands of high-speed, precision machine tools.

### REFORMULATION

The Pydraul fluids in this Selector were reformulated in 1970 to remove polychlorinated biphenyls (PCB's). They are now designated with the letter "A" following the product name and provide equal or superior performance when compared to the original Pydraul fluids.

Because some PCB's have been considered to be persistent in the environment, Monsanto chose to remove these components from Pydraul. We took this action voluntarily in an effort to demonstrate our environmental awareness.

Reformulation of the Pydraul fluids provided us with the opportunity to make a number of product improvements, particularly in the areas of lubricity, pump performance and thermal stability. These improvements give you the benefit of the latest Monsanto technology in fire resistant hydraulic fluids.

## Performance

Pydraul fluids offer a wide range of viscosities from which you can select the proper range specified by your hydraulic equipment manufacturer. Whichever Pydraul fluid you select, each provides the same protection against fire, premium lubricity, ease of maintenance, and freedom from corrosive action and foam. Pydraul hydraulic fluids also offer several additional benefits—

### REDUCED FIRE INSURANCE RATES

Pydraul eliminates fire hazards from hydraulic operations, reduces fire threats to surrounding structure and equipment. Insurance premiums for plants using Pydraul are often lower than premiums for operations using petroleum oil.

### LONGER PUMP LIFE

Machines which operate on water-based fluids frequently require pump repair or replacement as often as every two or three months. Machines which use Pydraul hydraulic fluids can operate on the same pump for several years. Pydraul hydraulic fluids give the same long pump life as the finest grade petroleum oil.

### NO CORROSION PROBLEMS

Any metal hydraulic system component in contact with Pydraul will not rust. Pydraul hydraulic fluids do not lose anti-rust properties even after extended use.

### MAXIMUM EQUIPMENT RESPONSE

Pydraul never produces excessive froth or foam during normal operations to interfere with hydraulic equipment response. Because Pydraul hydraulic fluids lubricate as well as premium petroleum oils, Pydraul permits equipment to operate at optimum response capability.

### INSPECTION AND REPLACEMENT DOWN-TIME ARE VIRTUALLY ELIMINATED

Pydraul hydraulic fluids are designed to be permanent. Pydraul fluids do not wear out. Except for normal "make-up" requirements, you never have to add new Pydraul to hydraulic systems. Pydraul eliminates "drain and change" periods; it does not have to be inspected in your system from month to month—or replaced from year to year.



TOWOLDMON0035626
WATER_PCB-00020095

# PYDRAUL® Selector One

| | PYDRAUL 60 |
|---|---|
| **PHYSICAL PROPERTIES** Appearance | Cloudy Blue Liquid |
| Spec. Gravity 25/25°C. | 1.088—1.091 |
| Neutralization No. (mg KOH/g) max. | 0.25 |
| Moisture (max.) % | 0.10 |
| **VISCOSITY** | |
| Centistokes @ 100°F. | 9.6—10.4 cs |
| @ 210°F. | 2.3—2.5 cs |
| SSU @ 100°F. | 60 SSU |
| @ 210°F. | 35 SSU |
| Absolute SSU @ 100°F. | 60.5 SSU |
| (SSU x Density) @ 210°F. | 35 SSU |
| Pour Point | —70°F. |
| Bulk Temp. Max. (continuous operation) | 175°F. |
| Boiling Point °F. at 760 mm Hg | 707°F. |
| Coefficient of Thermal Expansion per °F. | 0.00044 |
| Specific Heat BTU/lb./°F. @ 77°F. | 0.42 |
| Thermal Conductivity BTU/hr./ft./°F. | 0.047 |
| Vapor Pressure mm Hg @ 200°F. | 0.002 |
| Bulk Modulus (Room Temp. 1000-6000 psi) | 328,000 |
| Rust Test ASTM D-665 | Pass |
| Foam Test ASTM D-892 | Pass |
| Solubility in Water | Negligible |
| **FIRE RESISTANCE TESTS** | |
| **Factory Mutual Spray Test.** Test fluid sprayed at 1000 psi through orifice, passing through flame of propane torch. | Pass |
| **Factory Mutual Channel Iron Test.** Test fluid sprayed at 1000 psi through orifice, onto hot channel iron at 1300°F. | Pass |
| **Hot Manifold Test (Federal Test Method Std. 791).** Test fluid dripped on tube at 1300°F. | Intermittent flashing but does not propagate to pan below. |
| **Factory Mutual Approval.** FM | Yes |

**Fire-resistance Advantages of Pydraul**

Pydraul fluids protect hydraulic equipment and personnel with *permanent* fire protection. Pydraul fluids contain no water to evaporate and leave a flammable residue. During their many millions of machine hours of use, Pydraul fluids have been accidentally sprayed over molten metal, through electrical arcs, into flames and sparks—without causing fire. They pass all of the important *ignition tests for fire-resistance.*

**FOLLOWING IS A PARTIAL LIST OF APPLICATIONS FOR THE PYDRAUL FLUIDS:**

**STEEL INDUSTRY**

continuous casters
rolling mills
furnaces
scrap chargers
stripper cranes
arc welders
combustion controls
mobile equipment

0510440



TOWOLDMON0035627
WATER_PCB-00020096

| PYDRAUL 150-A | PYDRAUL F-9-A | PYDRAUL 625-A |
|---|---|---|
| Cloudy Blue Liquid | Clear Blue Liquid | Clear Blue Liquid |
| 1.120—1.131 | 1.20—1.23 | 1.30—1.34 |
| 0.30 | 0.50 | 0.50 |
| 0.10 | 0.10 | 0.10 |
| 29—34 cs<br>6.9—8.1 cs<br>146 SSU<br>53 SSU<br>163 SSU<br>56 SSU | 48—57 cs<br>4.7—5.5 cs<br>250 SSU<br>43 SSU<br>302 SSU<br>52.2 SSU | 125—145 cs<br>6.7—7.2 cs<br>628 SSU<br>49 SSU<br>829 SSU<br>65 SSU |
| −55°F. | 0°F. | +5°F. |
| 150°F. | 225°F. | 225°F. |
| 585°F. | 644°F. | 770°F. |
| 0.00042 | 0.00037 | 0.00048 |
| 0.40 | 0.34 | 0.30 |
| 0.072 | 0.065 | 0.062 |
| 0.01 | 0.02 | 0.004 |
| 319,000 | 395,000 | 400,000 |
| Pass | Pass | Pass |
| Pass | Pass | Pass |
| Negligible | Negligible | Negligible |
| | | |
| Pass | Pass | Pass |
| Pass | Pass | Pass |
| Intermittent flashing and burning. Little burning in pan below. | Does not flash or burn. | Does not flash or burn. |
| Yes | Yes | Yes |

**ALUMINUM INDUSTRY**
stripper cranes
direct chill casters
furnaces
rolling mills
shearers
combustion controls
mobile equipment

**FORGING AND EXTRUSION**
forge presses
extrusion presses
billet manipulators

***FOUNDRIES***
furnaces
molding lines


**DIECASTING**
diecast machines
trim presses

**FABRICATION**
*forming presses*
welders
furnaces



0510441


TOWOLDMON0035628
WATER_PCB-00020097

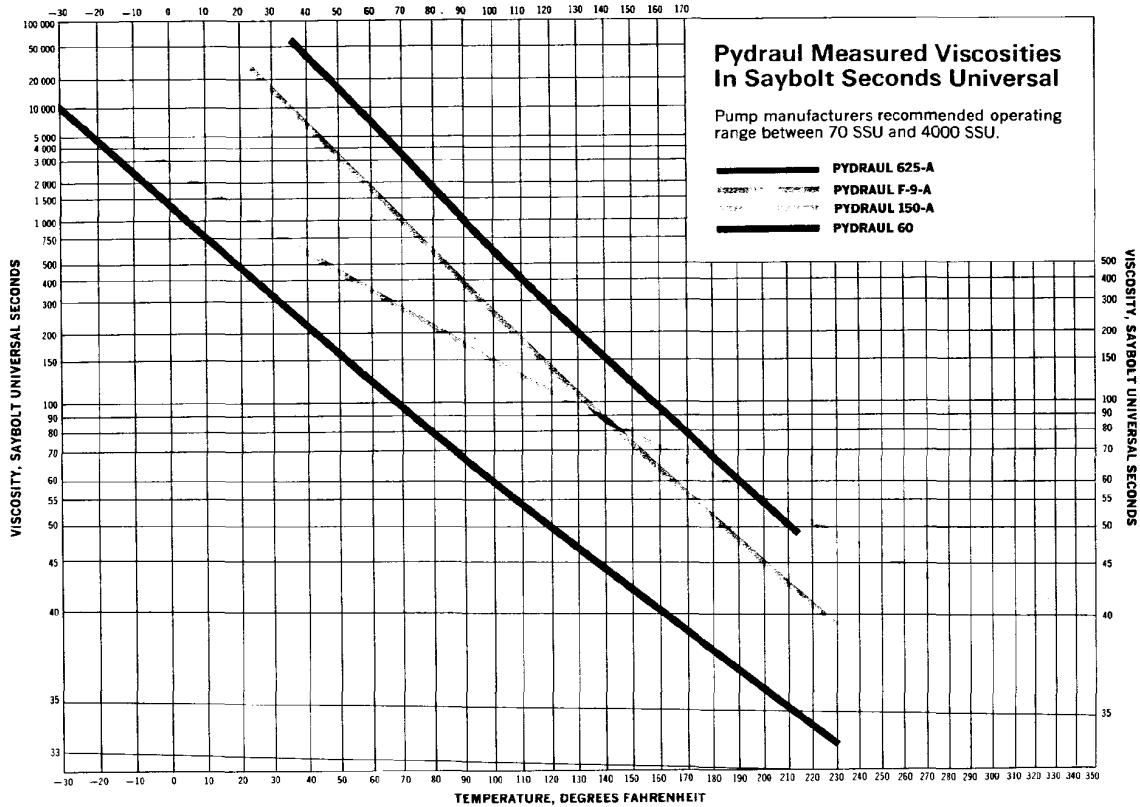


0510442




TOWOLDMON0035629
WATER_PCB-00020098

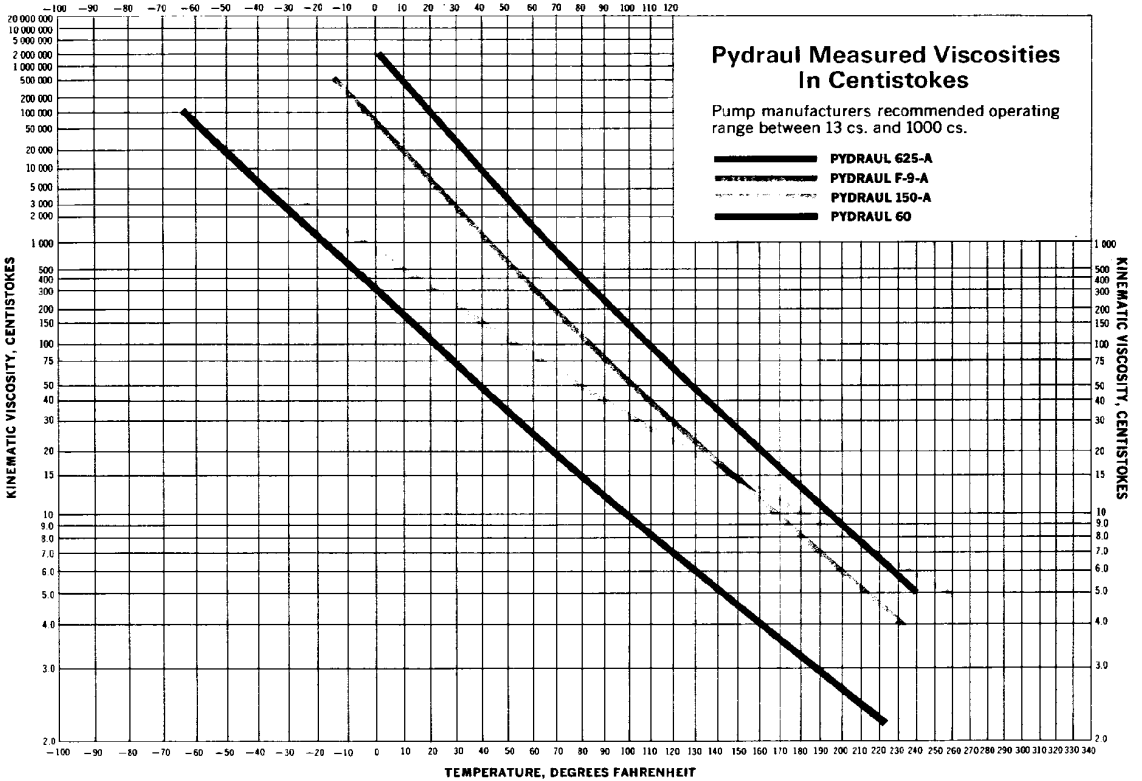


0510443

TOWOLDMON0035630
WATER_PCB-00020099

In a more severe Vickers hydraulic pump test (V-105-C pump), the Pydraul fluids performed as well as commercial antiwear oils and proved far superior to premium R & O oil (rust and oxidation inhibited).

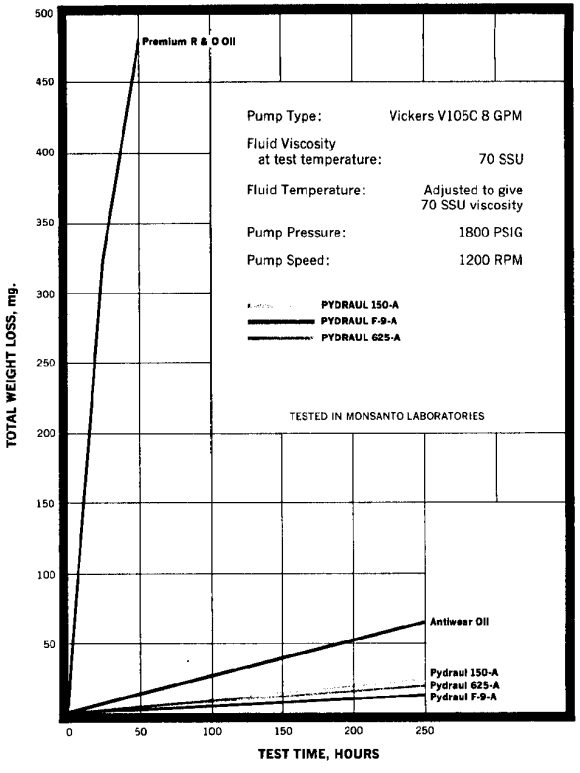


# Mixing Compatibility

## PYDRAUL WITH OTHER HYDRAULIC FLUIDS

| | 60 | 150-A | F-9-A | 625-A |
|---|---|---|---|---|
| **FYRQUEL®** | | | | |
| 90 | YES | NO | YES | YES |
| 150 | YES | NO | YES | YES |
| 220 | YES | NO | YES | YES |
| 300 | YES | NO | YES | YES |
| 550 | YES | NO | YES | YES |
| **HOUGHTO-SAFE®** | | | | |
| 1010 | YES | NO | YES | YES |
| 1055 | YES | NO | YES | YES |
| 1120 | YES | NO | YES | YES |
| 1130 | YES | NO | YES | YES |

Fyrquel® is a registered trademark of Stauffer Chemical Company.
Houghto-Safe® is a registered trademark of E. F. Houghton Co.

## PYDRAUL WITH OTHER PYDRAUL FLUIDS

| | 60 | 150-A | F-9-A | 625-A |
|---|---|---|---|---|
| 135-A | YES | YES | YES | YES |
| 230-A | YES | YES | YES | YES |
| 312-A | YES | YES | YES | YES |
| 540-B | YES | YES | YES | YES |
| 60 | — | NO | YES | YES |
| 150-A | NO | — | NO | NO |
| F-9-A | YES | NO | — | YES |
| 625-A | YES | NO | YES | — |

NOTE: All of the reformulated Pydraul fluids are compatible with their older counter part i.e. 150-A is compatible with 150, F-9A with F-9, etc.



0510444

TOWOLDMON0035631
WATER_PCB-00020100

# Converting to PYDRAUL is Easy

Regardless of the type hydraulic fluid being used, converting a system to low-cost Pydraul fluids is easy. Virtually every type of equipment which uses fire-resistant hydraulic fluid has been converted to Pydraul fluids. Most equipment manufacturers are experienced in Pydraul fluid conversions and should be consulted.

If changing seals is necessary, equipment manufacturers can recommend what seals to change, and many carry a supply of correct seals. Laboratory tests and operational experience show Viton*, Teflon*, and silicone the preferred elastomers for compatible seals. Please refer to the following section on seal and packing information for compatibility of Pydraul with other elastomers.

To replace other fluids which are compatible with Pydraul and where compatible seals are in the system, it is only necessary to add Pydraul as make-up fluid. It is not necessary to drain or clean. When converting from petroleum oils, non-compatible synthetic fluids, water-glycol fluids, or water-in-oil emulsions, the following steps are recommended. These conform to USA Standard B93.5—1966.

Please ask the Monsanto fluids specialist for recommendations and assistance. He may be reached by phoning the nearest sales office, listed on the inside back cover of this brochure.

# Change-Over Procedures

### CHANGING FROM PETROLEUM OIL

1. Completely drain and clean the system. Small amounts of oil will not interfere with the performance of Pydraul, but resistance to fire is reduced by the amount of oil left in the system.
2. Drain and blow out pipelines. Manually clean valves and reservoirs.
3. Open or remove and drain valves. Replace gaskets, packings, and seals with those compatible with Pydraul. It is particularly important to change dynamic seals. Static seals do not necessarily have to be changed if they are not leaking. Non-compatible static seals will have to be replaced when the part is disassembled for maintenance.
4. Remove pumps, accumulators, and cylinders, if necessary, for draining. Replace packings, seals, gaskets, and bladders with those compatible with Pydraul.
5. Check component functions before the system is closed and fluid is added.
6. If your system cannot be completely drained, you may have to flush it with a small amount of Pydraul.

### CHANGING FROM WATER-GLYCOL OR WATER-IN-OIL EMULSION

1. Drain and clean system thoroughly. Remove all traces of water. Empty all lines and low points or dead pockets in components.
2. Clean with steam or warm water. Follow by blowing with dry air.
3. Check sealing materials, hoses, and accumulator bags. Replace if necessary with compatible materials.
4. Install a minimum charge of Pydraul and operate the system from 16 to 24 hours. During this period, inspect the reservoir. If water or other contaminants float to the top, skim them off.
5. Drain the flushing charge immediately after shut-down while the fluid is warm. Drain all isolated points or parts which do not drain back to the reservoir. If water is apparent in fluid clinging to walls, wipe down all accessible parts.

### CHANGING FROM PHOSPHATE ESTERS (OTHER THAN PYDRAUL)

1. Drain the system completely.
2. Cleaning is unnecessary.
3. Generally, seal changes are unnecessary at the time of conversion, but installation of compatible seals is recommended during routine maintenance.

*Registered trademark of E. I. Du Pont de Nemours & Co., Inc.



TOWOLDMON0035632
WATER_PCB-00020101

# Seals and Packings Information

Materials compatible with Pydraul hydraulic fluid are necessary for dynamic or moving seals. For static seals they are preferred, but not essential. The following table indicates materials recommended, depending on the Pydraul fluid selected.

| PYDRAUL FLUID | BUTYL | EPR | VITON | TEFLON | SILICONE | BUNA N | NEOPRENE | NATURAL RUBBER |
|---|---|---|---|---|---|---|---|---|
| 60 | R | R | U | S | S | U | U | U |
| F-9-A | R | R | R | R | R | U | U | U |
| 150-A | R | R | R | R | R | U | U | U |
| 625-A | R | R | R | R | R | U | U | U |

R—Recommended S—Satisfactory M—Marginal U—Unsatisfactory

**This list of component manufacturers is a guide to obtaining seals compatible with Pydraul fluids. Please contact your equipment manufacturer or seal supplier for their most current recommendations.**

Acushnet Process Company
776 Belleville Avenue
New Bedford, Massachusetts 02745

Anchor Packing Company
401 North Broad Street
Philadelphia, Pennsylvania 19108

Bearings, Inc.
3634 Euclid Avenue
Cleveland, Ohio 44115

A. W. Chesterton Company
Everett
Massachusetts 02149

Chicago Rawhide Manufacturing Company
1311 Elston Avenue
Chicago, Illinois 60622

C. E. Conover & Company, Inc.
333 Passaic Avenue
Fairfield, New Jersey 07006

Crane Packing Company
6400 Dakton Street
Morton Grove, Illinois 60053

Garlock Packing Company
Palmyra
New York 14522

Goshen Rubber Company, Inc.
P. O. Box 416
Goshen, Indiana 46526

Greene, Tweed & Company
North Wales
Pennsylvania 19454

Hercules Packing Corporation
11061 Walden Road
Alden, New York 14004

International Packing Corporation
Bristol
New Hampshire 03104

Johns-Manville
22 East 40th Street
New York, New York 10016

C. W. Marsh Company
36 Hudson Street
Muskegon, Michigan 49441

Minnesota Rubber Company
3630 Wooddale Avenue
Minneapolis, Minnesota 55416

Parker Seal Company
10567 Jefferson Boulevard
Culver City, California 90230

Plastic & Rubber Engineering, Inc.
756 East Florence Avenue
Los Angeles, California 90001

Plastic & Rubber Products Company
2100 Hyde Park Boulevard
Los Angeles, California 90047

Precision Rubber Products Corporation
Hartmann Drive
Lebanon, Tennessee 37087

Raybestos-Manhattan, Inc.
Packing Division
Passaic, New Jersey

Reliable Rubber Products
Eddyington
Pennsylvania 19020

Rockwell Mechanical Packing Company, Inc.
1634 Long Beach Avenue
Los Angeles, California 90021

W. S. Shamban Company
11617 West Jefferson Boulevard
Culver City, California 90230

Vellumoid Company
Rockdale Street and Beaman Avenue
Worchester, Massachusetts 01606

The James Walker Packing Company, Inc.
P. O. Box 75
Chicago Heights, Illinois 60411



0510446

TOWOLDMON0035633
WATER_PCB-00020102

# Filters and Hoses

**FILTERS**/Most standard oil filters are satisfactory. You can use active earth or clay types. Filter manufacturers include:

Briggs Filtration Division
Bowser Corporation
Cookeville, Tennessee

Capital Engineering Company
5839 Ashland Avenue
Chicago, Illinois

Commercial Filters Corporation
(Honan-Crane)
Lebanon, Indiana

Cuno Engineering Corporation
Sub. of American Machine
& Foundry
4627 S. Vine Street
Meriden, Connecticut

Dollinger Corporation
20 Centre Park
Rochester 3, New York

Fulflo Specialties Company, Inc.
410 Fancy Avenue
Blanchester, Ohio

Hilliard Corporation
98 W. Fourth Street
Elmira, New York

Marvel Engineering Company
7227 North Hamlin Avenue
Chicago 45, Illinois


Pall Corporation
32 Sea Cliff Avenue
Glen Cove, L. I., New York

Purolator Products
1000 New Brunswick Avenue
Rahway, New Jersey

Rosaen Filter Corporation
1776 E. Nine Mile Road
Hazel Park, Michigan

Schroeder Bros. Corporation
101 Nichol Avenue
McKees Rocks, Pennsylvania

Serfilco Division
Service Filtration Corporation
7408 North Milwaukee
Niles, Illinois 60648

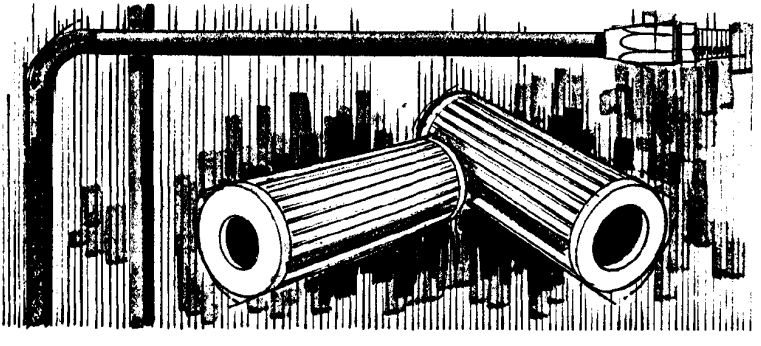

**HOSES**/Although both neoprene and buna elastomers swell somewhat in Pydraul, hose of these materials have given satisfactory service when made of a reinforced braid construction. Butyl, nylon or Viton are preferred when new hoses are installed. Suppliers include:

Anaconda Metal Hose Division
Anaconda American Brass Co.
Waterbury, Connecticut 06720

Anchor Coupling Company
3600 N. Fourth Street
Libertyville, Illinois

Eastman Mfg. Company
(See Imperial-Eastman Corp.)
Department T. R.
6300 West Howard Street
Chicago 48, Illinois

Electric Hose & Rubber Co.
1201 Duro Street
Wilmington, Delaware

Gates Rubber Company
999 South Broadway
Denver, Colorado 80217

Imperial Eastman Corp.
6300 W. Howard Street
Chicago, Illinois

Lewis Products
Hohenwald, Tennessee 38462

Samuel Moore Co.
Mantua, Ohio

Resistoflex Corp.
Roseland, New Jersey

Stratoflex, Inc.
222 Roberts Cutoff Rd.
Fort Worth, Texas

Weatherhead Corp.
302 E. 131st Street
Cleveland, Ohio 44108



0510447

TOWOLDMON0035634
WATER_PCB-00020103

# Other Components

## SWIVEL COUPLINGS

Systems for Pydraul fluids often contain swivel couplings. Some suppliers are:

Chiksan Division
FMC Corporation
332 N. Brea Boulevard
Brea, California

## PIPE JOINT SEALERS

. . . can be bought from:

American Sealants Company
(See Loctite Corporation)
115 N. Mountain Road
Hartford 11, Connecticut

Crane Packing Company
6410 Oakton Street
Morton Grove, Illinois

Dow Corning Corporation
Midland, Michigan

Friesland Plastics Company
Friesland, Wisconsin

General Electric Company
Insulating Materials Department
1 Campbell Road
Schenectady 6, New York

Permatex Company
Department T. R.
Flagler Court Building
West Palm Beach, Florida

W. S. Shamban & Company
11617 W. Jefferson Boulevard
Culver City, California

Shell Chemical Company
110 W. 51st Street
New York, New York

## ACCUMULATORS

. . . many hydraulic systems for Pydraul contain an accumulator which uses a bladder to separate the fluid from air or nitrogen pressure. For these, a rubber compatible with the fluid is necessary. Suppliers include:

Greer Hydraulics, Inc.
5930 W. Jefferson Boulevard
Los Angeles, California

## PAINTS

. . . resistant to Pydraul are supplied by:

Amercoat Corporation
Department T
Brea, California

Andrew Brown Paint Company
5413 S. District Boulevard
Los Angeles, California

Carboline Company
32-R Hanley Industrial Court
St. Louis, Missouri

Carrol Products
148 Marine Street
Farmingdale, New York

Finch Paint & Chemical Company
Torrence, California

W. P. Fuller & Company
1645 W. Valencia Drive
Fullerton, California

The Glidden Company
900 Union Commerce Building
Cleveland, Ohio

Interchemical Corporation
Finishes Division
1255-T Broad Street
Clifton, New Jersey

Lowe Brothers Company
Third & Madison Streets
Dayton, Ohio

Magna Coatings & Chemical Corporation
1785 N. Eastern Avenue
Los Angeles, California

Nycote Laboratories
15002 Delano Street
Van Nuys, California

Pittsburgh Plate Glass Company
One Gateway Center
Pittsburgh 22, Pennsylvania

Rinshed-Mason Company
5935 Milford
Detroit, Michigan


Royalty Paint & Varnish Company
Pasadena, California

Saran Protective Coatings Company
2415 Burdette at Reed
Ferndale, Michigan

Sherwin-Williams Company
101 Prospect Avenue, N. W.
Cleveland, Ohio

Titanine, Inc.
Seagrave Corporation
Elmwood & Morris Avenues
Union, New Jersey

U. S. Paint, Lacquer & Chemical Company
2101 Singleton
St. Louis, Missouri

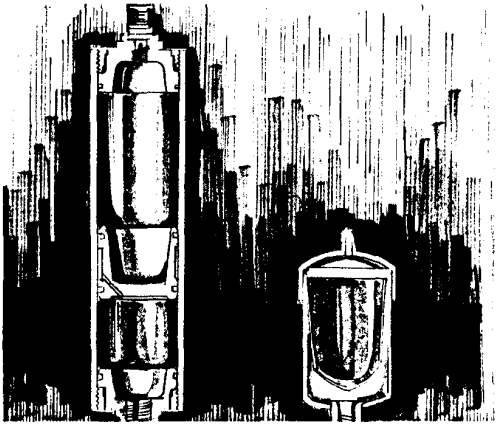



TOWOLDMON0035635
WATER_PCB-00020104

# Reclaiming PYDRAUL Fluids


Pydraul hydraulic fluid lost from leaks and spills can be reclaimed because it is exceptionally stable and resistant to water and other contaminates. If fluid losses are appreciable—fluid recovery can result in considerable savings. Simply placing a container beneath leaks until they can be repaired will save some fluid. Where drip pans have been used beneath hydraulic machinery, more than half of the total Pydraul leakage has been reclaimed.

This dollar-saving recovery appears especially advantageous because it isn't practical to reclaim either water glycol or water-oil emulsions except to filter out large dirt particles. Reclaiming Pydraul fluid helps make it the most economical fire-resistant fluid available.

Reclaiming Pydraul consists of two steps: removing water, and filtering dirt or other solid particles.

**WATER REMOVAL**... Water does not mix with Pydraul and will, therefore, form a layer on top. A drum reserved for contaminated fluid with a side and end bung, placed horizontally on a cradle about two feet off the floor, is a simple and effective settling chamber. Salvaged fluid can be added through a large funnel in the top opening and Pydraul periodically drained off through the lower opening.

FLUID PURIFICATION SYSTEM

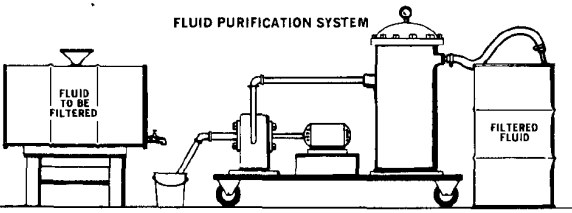



For a more elaborate system, permanently installed settling tanks, or a commercial installation can be used.

A second method is centrifuging. Suitable units are made by DeLaval and Sharples Co. Centrifuges operate swiftly . . . will separate water from large volumes of fluid in a short time.

**FINAL FILTRATION** . . . A number of filtration units are available complete with filter pump and motor. Other systems use filter media such as cotton linters, felt or metal screens. Attapulgus clay and Fuller's earth may be used to help keep the fluid clean, reduce moisture and lower neutralization number. Diatomaceous earth filtration is recommended for solid particles removal only. Paper and fiber type filters are recommended for water and particle removal but are ineffective for lowering neutralization number (acidity) values.

CENTRIFUGE SYSTEM FOR PURIFICATION

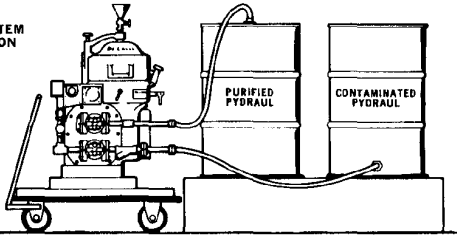


Filters in the 3 to 5 micron range are recommended for Pydraul filtration and reclamation. Such filter media will not affect the basic Pydraul formulation.





TOWOLDMON0035636
WATER_PCB-00020105

# Handling

Animal toxicity studies and human experience indicate that the Pydraul hydraulic fluids may be used safely if a few reasonable precautions are taken. Repeated or prolonged skin contact should be avoided not only to prevent absorption of the material and possible systemic effect but, also, because the fluids are excellent solvents for the oils normally present in the skin. Thus, drying and irritation could occur.

When splashed or sprayed into the eyes, Pydraul causes painful smarting. There is no evidence, however, of any permanent eye injury. In the event of accidental contact with the eyes, the eyes should be flushed with copious amounts of water for 15 minutes and the workman referred to a physician; physicians have used 1% Pontocaine solution and ophthalmic cortisone acetate solution to relieve irritation.

When Pydraul is kept at room temperature, it does not constitute a vapor inhalation hazard except in a confined, unventilated space. Respiratory protection or mechanical exhaust ventilation should be provided if there is repeated and prolonged contact of the fluid with heated surfaces with resulting volatilization or possible decomposition of the fluid. Where a ruptured oil hydraulic line near a white-hot surface means a fire, a ruptured hydraulic line containing Pydraul causes a vapor with an unpleasant odor that can help you locate the trouble.





0510450

TOWOLDMON0035637
WATER_PCB-00020106

## DISTRICT SALES OFFICES
## ALL DIVISIONS

AKRON, OHIO 44313
260 Springside Drive
Montrose Development Park
Tel. (216) 666-4111

ATLANTA, GEORGIA 30326
320 Interstate North Parkway
Suite 500
Tel. (404) 432-7111

BOSTON, MASSACHUSETTS 02149
Everett Station
Tel. (617) 387-5010

CHICAGO, ILLINOIS
3158 Des Plaines Ave.
Des Plaines, Illinois 60018
Tel. (312) 296-6688

CINCINNATI, OHIO 45206
1501 Madison Road
Tel. (513) 751-6707

DETROIT, MICHIGAN 48235
500 Northland Towers East
Tel. (313) 357-0910

HONOLULU, HAWAII 96812
205 Pacific International Bldg.
677 Ala Moana Blvd., P.O. Box 3824
Tel. (808) 531-2744

HOUSTON, TEXAS 77002
1300 Main Street
Tel. (713) 223-4011

LOS ANGELES, CALIFORNIA 90022
6670 E. Flotilla St.
Tel. (213) 723-2492

NEW YORK, NEW YORK 10017
277 Park Avenue
Tel. (212) 922-4111

ST. LOUIS, MISSOURI 63166
800 N. Lindbergh Blvd.
Tel. (314) 694-1000

SAN FRANCISCO BAY AREA
2710 Lafayette, Santa Clara, Calif. 95052
Tel. (408) 243-0414

SEATTLE, WASHINGTON 98121
2112 Third Avenue
Tel. (206) 622-4203

SPRINGFIELD, MASSACHUSETTS 01101
730 Worcester Ave.
Tel. (413) 788-6911

WILMINGTON, DELAWARE 19803
2005 Concord Pike, Fairfax
Tel. (302) 658-6531

For technical information phone your Monsanto representative or the nearest sales office (listed on this page).

To place an order for Pydraul products from Monsanto Dial toll free 800-325-3850.

"Nothing contained herein is to be construed as a recommendation to use any product in conflict with any patent. MONSANTO MAKES NO WARRANTIES AS TO THE FITNESS OR MERCHANTABILITY OF ANY PRODUCTS REFERRED TO, no guarantee of substactory results from reliance upon contained information or recommendations, and disclaims all liability for any resulting loss or damage."

# Monsanto

Monsanto Company / Organic Division, Specialty Products / 800 North Lindbergh Blvd. / St. Louis, Missouri 63166

0510451

TOWOLDMON0035638
WATER_PCB-00020107

# MONSANTO COMPANIES AND OFFICES

**Argentina**
*Monsanto Argentina S.A.I.C.*
*Tucuman 117*
*Buenos Aires*

**Australia**
Adelaide
*Monsanto Australia Limited*
*P.O. Box 1111K Adelaide*
*South Australia 5001*
Brisbane
*Monsanto Australia Limited*
*P.O. Box 63, Hamilton Central*
*Queensland 4007*
Melbourne
*Monsanto Australia Limited*
*East Tower, Princes Gate*
*151 Flinders Street*
Perth
*Monsanto Australia Limited*
*P.O. Box 90*
*Applecross*
*West Australia 6153*
Sydney
*Monsanto Australia Limited*
*P.O. Box 4*
*Rozelle*
*N.S.W. Australia 2039*

**Austria**
*Monsanto G.m.b.H.*
*Rudolfplatz 12*
*Wien 1*

**Belgium**
*Monsanto Europe S.A.*
*1, Place Madou*
*Brussels 3*

**Belgium/Luxembourg**
*Monsanto Europe N.V.*
*163, Mechelsesteenweg*
*Antwerp 1*

**Brazil**
*Monsanto Comercio e Industria Ltda.*
*Rue Araujo 216, 6° Andar*
*Sao Paulo*

**Canada**
Montreal
*Monsanto Canada Limited*
*Suite 1450*
*Place de Canada*
*Montreal 101*
Edmonton
*Monsanto Canada Limited*
*P.O. Box 416*
*Edmonton, Alberta*
Toronto
*Monsanto Canada Limited*
*175 Rexdale Boulevard*
*Rexdale, Ontario*
Vancouver
*Monsanto Canada Limited*
*1550 Rand Avenue*
*Vancouver 14, B.C.*

**Chile**
*Monsanto Chile Comercial e Industrial Ltda.*
*Edificio Espana, Oficinas 502*
*Calle Estado 337*
*Santiago*

**Colombia**
*Monsanto Colombiana, Inc.*
*Carrera 15 No. 77-50*
*Bogota*

**Dominican Republic**
*Monsanto Dominicana, Inc.*
*Josefa Perdomo #17*
*Esquina Pasteur*
*Santo Domingo*

**El Salvador**
*Monsanto Centroamerica (El Salvador) S.A.*
*Edificio Plaza*
*67 Avenida Sur y Calle a Santa Tecla*
*San Salvador*

**France**
*Societe Monsanto*
*9, rue d'Argenson*
*Paris 8me*

**Germany**
*Monsanto (Deutschland) G.m.b.H.*
*3 Immermannstrasse*
*4000 Dusseldorf 1*

**Guatemala**
*Monsanto Centroamerica (Guatemala) S.A.*
*7a Avenida 11-89 Zona 9*
*Edificio Galerias Espana*
*Guatemala City*

**Hong Kong**
*Monsanto Far East Limited*
*Fifth Floor, New Henry House*
*Ice House Street*

**India**
Bombay
*Monsanto Chemicals of India Private Ltd.*
*Wakefield House*
*11 Sprott Road, Ballard Estate*
*Bombay 1*
Calcutta
*Monsanto Chemicals of India Private Ltd.*
*19 Rajendranath Mukherjee Road*
*Calcutta 1*
Madras
*Monsanto Chemicals of India Private Ltd.*
*Calthness Hall*
*310, 311 Linghi Chetty Street*
*Madras 1*
New Delhi
*Monsanto Chemicals of India Private Ltd.*
*3/8 Asaf Ali Road*
*Near Turkman Gate*

**Israel**
*Israel Chemical Fibres Limited*
*Industrial Zone*
*Ashdod*

**Italy**
*Monsanto Italiana S.p.A.*
*24 Via F. Filzi*
*20124 Milano*

**Japan**
*Monsanto Japan Ltd.*
*Room 623, Chiyoda Building*
*14, 2-chome Chiyoda-ku*
*Tokyo*
*Mitsubishi Monsanto Chemical Co.*
*Mitsubishi Main Building*
*5-2, Marunouchi 2-chome*
*Chiyoda-ku*
*Tokyo 100*

**Malaysia**
*Monsanto Far East Ltd.*
*116 Jalan Semangat*
*Petaling Jaya*
*Selangor*

**Mexico**
*Monsanto Mexicana, S.A.*
*Thiers No. 248*
*Colonel Anzures*
*Mexico 5*

**Netherlands**
*Monsanto N.V.*
*Jan van Nassaustraat 53/55*
*The Haag*

**Nicaragua**
*Monsanto (Nicaragua) S.A.*
*Apartado Postal 286*
*Managua*

**Pakistan**
Karachi
*Monsanto Overseas S.A.*
*Dinshaw House Flat D-3*
*No. 4 Bath Island Hill*
*Karachi 4*
Lahore
*Monsanto Overseas S.A.*
*P.O. Box No. 1226*
*Lahore 4*

**Philippines**
*Monsanto Philippines Inc.*
*Suite 314, Rufino Building*
*6784 Ayala Avenue*
*Makati, Rizal, D-708*

**Puerto Rico**
*Monsanto Inter-America Co.*
*P.O. Box 837 Hato Rey Station*
*Hato Rey 00919*

**Singapore**
*Monsanto Singapore Co. (Pte.) Ltd.*
*Gainurn Building, 2nd Floor*
*241 River Valley Road*
*Singapore 9*

**South Africa**
*Monsanto South Africa (Pty.) Ltd.*
*85 Russik Street*
*Johannesburg*

**Spain**
*Monsanto Iberica, S.A.*
*Leparto 350*
*Barcelona 53*

**Sweden**
*Monsanto (Scandinavia) AB*
*Ulvsundavsegen 108*
*Bromma — Stockholm*

**Taiwan**
*Monsanto Far East Limited*
*23 Chung Shen North Road*
*7th Floor, Section 2*
*Taipei*

**Thailand**
*Monsanto Thailand Limited*
*Thai Farmers Bank Building*
*142 Silom Road*
*Bangkok*

**United Kingdom**
*Monsanto Chemicals Limited*
*10-18 Victoria Street*
*London S.W. 1*

**U.S.A.**
*Monsanto Company*
*800 North Lindbergh Boulevard*
*St. Louis, Missouri 63166*

**Venezuela**
*Monsanto (Venezuela) C.A.*
*Torre Phelps — Piso 24*
*Plaza Venezuela*
*Caracas*

Representatives in principal cities of the world

3-71

# Monsanto

Monsanto Company / Organic Division, Specialty Products / 800 North Lindbergh Blvd. / St. Louis, Missouri 63166

PZ-0471-IGI-LRA LITHO IN U.S.A.

0510452

TOWOLDMON0035639
WATER_PCB-00020108