

60 F, the thermodynamic wet-bulb is 50 F, the dew-point is 40.8 F, the degree of saturation is 48.6 per cent, the humidity ratio is 0.00536 lb per pound dry air, and the enthalpy is $14.85 + (1000 \times 0.00536) = 20.21$ Btu per pound dry air.

With the aid of the Mollier diagram, it is easy to throw the definition of thermodynamic wet-bulb, Equation 20, into a more familiar form. Consider the three points 1, 2, 3, Fig. 2. Point 3 is located with respect to points 1 and 2 so that $W_3 = W_1$ and $t_3 = t_2$. Points 1 and 2, being on a line of constant thermodynamic wet-bulb, satisfy Equation 20; thus,

$$h_1 - h_3 + (W_2 - W_1) h_{w,2} = h_2 - h_3$$

where h_3 has been subtracted from both sides. Under Dalton's Law, $h_2 - h_3 = (W_2 - W_1) h_{w,2}$; moreover, $h_1 - h_3$ may be replaced by $s_1(t_1 - t_2)$ where s_1 is often referred to as *mean humid heat* and may be calculated with good approximation from

$$\bar{s}_1 = 0.240 + 0.444 W_1 \quad (21)$$

Finally, introducing latent heat of vaporization at the wet-bulb tempera-

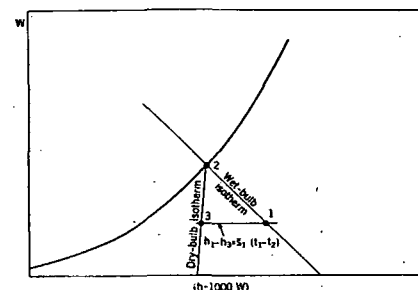


FIG. 2. DIAGRAM ILLUSTRATING THERMODYNAMIC WET-BULB TEMPERATURE

ture, namely, $(h_{ig})_2 = (h_w - h'_w)_2$, Equation 20 becomes, after omitting the subscript 2,

$$\frac{t_1 - t'}{W_s - W_1} = \frac{h_{fg}}{\bar{s}_1} \quad (22)$$

it being understood that W_s is the saturation humidity ratio and h_{fg} , the latent heat, at the wet-bulb temperature t' . Equation 22 was derived by Carrier.

Example 12. Work Example 10 using Equation 22.

Solution. A trial-by-error method is involved. Taking 48 F as a trial value of t' , $(80 - 48) \div (0.007072 - 0) = 4520$; but $1066.7 \div 0.240 = 4440$. The trial value must, therefore, be revised upward, the final solution being 48.26 F as in Example 10.

TYPICAL AIR CONDITIONING PROCESSES

Illustrative Examples. The use of Table 6 and the Mollier diagram in analyzing typical air conditioning processes is best explained by the use of illustrative examples. In each of these examples, the observed pressure is assumed to be standard atmospheric pressure (29.921 in. Hg).

*Approximate average decrease in weight per 0.1 F rise in dry-bulb temperature equals 0.000017 lb per cubic foot.