
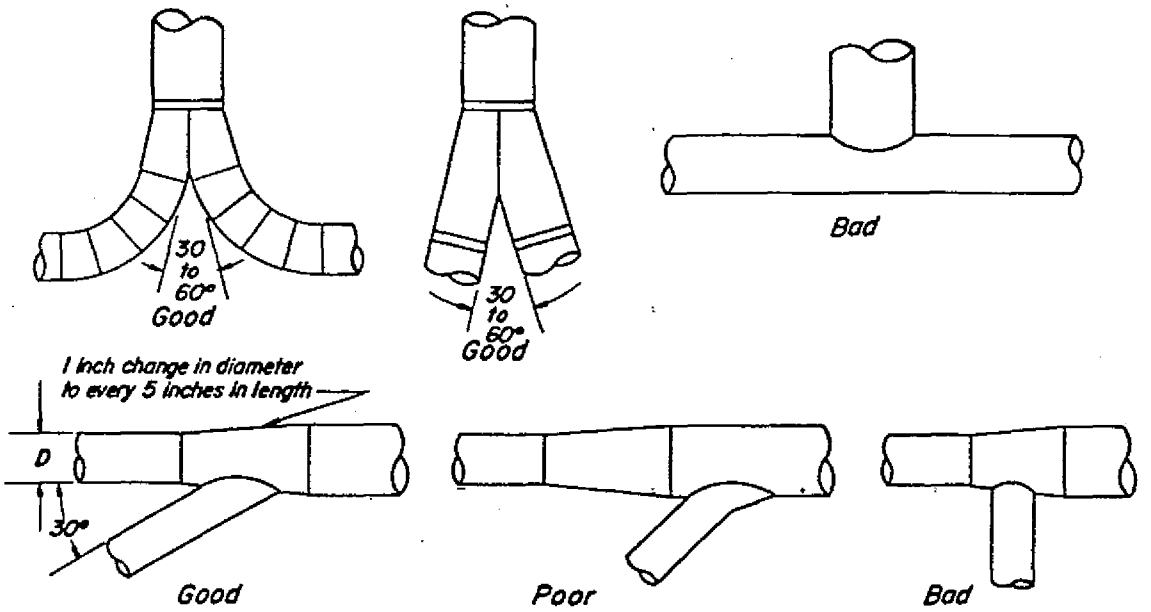



BRANCH ENTRY

*Branches should enter at gradual expansions and at an angle of 30° or less (preferred) to 45° if necessary.*

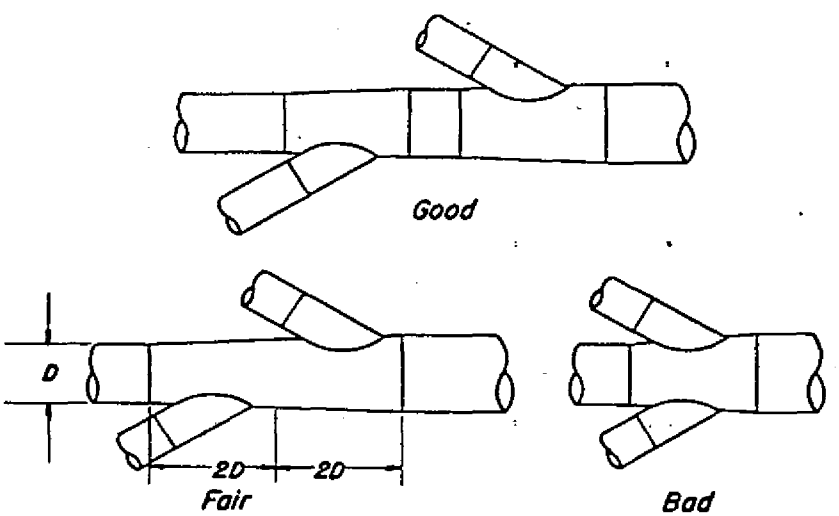


BRANCH ENTRY

*Branches should not enter directly opposite each other.*

AMERICAN CONFERENCE OF GOVERNMENTAL INDUSTRIAL HYGIENISTS

PRINCIPLES OF DUCT DESIGN

DATE 1-66 | Fig. 6-20