

The most common and least complicated type of refrigeration cycle is called the simple saturation cycle and is shown diagrammatically in Fig. 3 and plotted upon pressure-enthalpy coordinates in Fig. 4. For this system saturated vapor flows without gain or loss of heat from the evaporator to the suction of the compressor. During passage through the compressor the energy added as shaft work goes entirely to increase the enthalpy of the refrigerant, and the compression process, which is assumed to occur irreversibly and without external heat transfer, is characterized by constant entropy. Thus the state of the superheated vapor leaving the compressor can be determined from the tables of thermodynamic properties by noting the discharge pressure and fixing also the entropy of the saturated vapor at entrance to the compressor.

TABLE 4. PROPERTIES OF MONOFLUOROTRICHOROMETHANE (F-11)

Sat. Temp. °F	Abs. Press. Lb./Sq. In.	VOLUME		ENTHALPY AND ENTROPY TAKEN FROM -40°F							
		Liquid*	Vapor	Enthalpy		Entropy		25°F Superheat		50°F Superheat	
				Liquid	Vapor	Liquid	Vapor	Enthalpy	Entropy	Enthalpy	Entropy
0	2.59	0.01020	13.700	7.81	90.4	0.0178	0.1975	93.9	0.2049	97.4	0.2120
5	2.96	0.01024	12.100	8.81	91.2	0.0200	0.1974	94.7	0.2047	98.2	0.2117
10	3.38	0.01028	10.700	9.82	92.0	0.0222	0.1973	95.5	0.2045	99.0	0.2114
15	3.85	0.01032	9.530	10.80	92.8	0.0243	0.1971	96.3	0.2043	99.8	0.2111
20	4.36	0.01036	8.490	11.90	93.7	0.0264	0.1970	97.2	0.2041	100.7	0.2109
25	4.94	0.01040	7.580	12.90	94.5	0.0286	0.1969	98.0	0.2039	101.5	0.2107
30	5.57	0.01045	6.770	13.90	95.3	0.0307	0.1969	98.8	0.2038	102.3	0.2105
35	6.27	0.01049	6.080	14.90	96.1	0.0328	0.1968	99.6	0.2037	103.1	0.2103
40	7.03	0.01053	5.460	16.00	96.8	0.0349	0.1968	100.3	0.2036	103.8	0.2101
45	7.88	0.01057	4.920	17.00	97.6	0.0370	0.1967	101.1	0.2035	104.6	0.2099
50	8.79	0.01062	4.440	18.10	98.4	0.0391	0.1967	101.9	0.2034	105.4	0.2098
55	9.80	0.01066	4.020	19.10	99.2	0.0412	0.1967	102.7	0.2033	106.2	0.2097
60	10.90	0.01071	3.640	20.20	100.0	0.0432	0.1967	103.5	0.2033	107.0	0.2096
65	12.10	0.01076	3.300	21.30	100.8	0.0453	0.1967	104.3	0.2032	107.8	0.2094
70	13.40	0.01081	3.000	22.40	101.5	0.0473	0.1967	105.0	0.2032	108.5	0.2093
75	14.80	0.01086	2.740	23.50	102.2	0.0493	0.1967	105.7	0.2031	109.2	0.2092
80	16.30	0.01091	2.500	24.50	102.9	0.0513	0.1966	106.4	0.2030	109.9	0.2090
85	17.90	0.01096	2.280	25.60	103.6	0.0533	0.1966	107.1	0.2029	110.6	0.2089
90	19.70	0.01101	2.090	26.70	104.4	0.0553	0.1966	107.9	0.2028	111.4	0.2088
95	21.60	0.01106	1.918	27.80	105.1	0.0573	0.1966	108.6	0.2028	112.1	0.2087
100	23.60	0.01111	1.761	28.90	105.7	0.0593	0.1965	109.2	0.2027	112.7	0.2085
105	25.90	0.01116	1.620	30.10	106.4	0.0613	0.1965	109.9	0.2026	113.4	0.2084

Superheated vapor from the compressor flows to the condenser where de-superheating and condensation take place. From the condenser the refrigerant flows to the expansion valve, undergoes a constant-enthalpy pressure reduction and returns to the evaporator where it again removes a quantity of undesired heat. When the evaporator is arranged to permit direct cooling of room air by the refrigerant, the system is said to be of the *direct expansion* type, while a system in which the evaporating refrigerant cools water or brine, which in turn cools the air, is said to be *indirect*. Although many differences exist between most actual systems and that of the simple saturation cycle this latter is nonetheless of great value in that it provides an extremely simple method of rapidly achieving an approximate analysis of probable power requirements, compressor size, etc. Further, the equations used in analysis of a simple saturation cycle form the basis

of the more complex treatments required for compound refrigeration cycles. For these reasons a typical simple saturation problem will be worked in detail.

Example 1. A simple saturation cycle carries a 7 ton load when operating between suction and discharge pressures of 52.7 psia and 121 psia with F-12 as the refrigerant. Determine: (a) the cooling effect provided by each pound of refrigerant, (b) the refrigerant circulating rate, (c) the horsepower required, (d) the quantity of heat to be dissipated from the condenser, (e) the required condenser cooling water, in gallons per minute, if temperature rise of water passing through the condenser is 8 deg., (f) the bore and stroke of a double acting cylinder (neglecting the effect of the piston rod) if speed of compressor is 500 revolutions per minute, (g) coefficient of performance.

Solution. (a) Saturated liquid F-12 at 121 psia leaves the condenser and enters the expansion valve. The enthalpy of this material (from Table 1) is 29.68 Btu per pound and this must also be its enthalpy at entrance to the evaporator. Leaving the evaporator as a saturated vapor at 52.7 psia, its enthalpy is 82.82 so the refrigerating effect must be $82.82 - 29.68 = 53.14$ Btu per pound.

(b) The refrigerant circulating rate is equal to the total heat to be picked up in unit time divided by the pick-up per pound of refrigerant or,

$$W_r = (7 \text{ ton} \times 200) \div 53.14 = 26.3 \text{ lb per minute.}$$

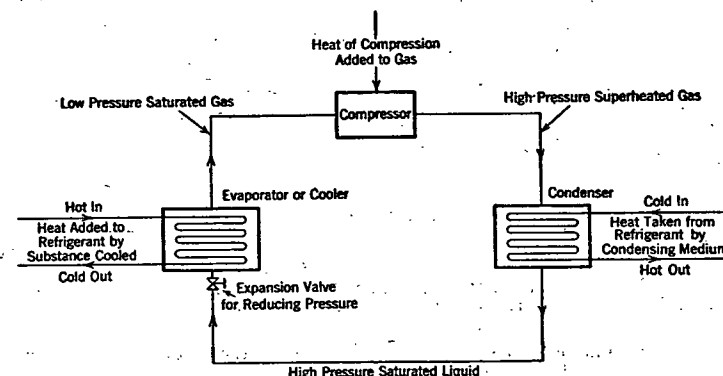


FIG. 3. MECHANICAL REFRIGERATION SYSTEM

(c) The horsepower required is equal to the increase in energy of the refrigerant passing through the compressor (expressed in Btu per minute) divided by the conversion factor 42.42, which is the number of Btu per minute corresponding to 1 hp,

$$(\text{hp}) = W_r (h_d - h_{v_s}) \div 42.42 \quad (7)$$

where

hp = horsepower.
 W_r = refrigerant circulating rate in pounds per minute.
 h_d = enthalpy of vapor at condition of discharge from compressor.
 h_{v_s} = enthalpy of saturated vapor entering compressor.

W_r is known from (b) and h_{v_s} is the enthalpy of refrigerant as it enters the compressor in a saturated vapor state at 52.7 psia; thus $h_{v_s} = 82.82$.

In order to determine h_d , the state of the refrigerant must first be determined at the compressor discharge. At the known suction state the entropy (from Table 1 for saturated vapor at 52.7 psia) is 0.16828 and, since the compression is assumed to occur isentropically, it therefore follows that the discharge state must have the same entropy at 121 psia. From the table the entropy of vapor superheated 25 deg is