Example 7. Cooling (data from Example 3). If the condensate is removed at 54 F the quantity of heat removed is found from Equation 15, by proper regard to the arrow direction in Fig. 1,

$$E_h + R_c = 0.24\ (84 - 54) + 0.00887 \times 0.45\ (84 - 54) + 0.00361$$
$$[1059.2 + 0.45 \times 84 - (54 - 32)] = 11.24 \text{ Btu per pound of dry air.}$$

Using Table 5, the initial total heat of the air-vapor mixture, since the wet-bulb temperature is 70 F, is 33.96 Btu per pound of dry air.

The final total heat is, from Table 5, since the exit air is saturated, 22.55 Btu per pound. Hence, using Equation 16, the quantity of heat removed is, approximately, (33.96 − 22.55) or 11.41 Btu per pound of dry air. The degree of approximation to the correct result is evident in this example.

PSYCHROMETRIC CHART[4]

The revised Bulkeley Psychrometric Chart[5], will be found attached to the inside back cover. It shows graphically the relationships expressed in Equations 9a and 9b. It also gives the grains of moisture per pound of

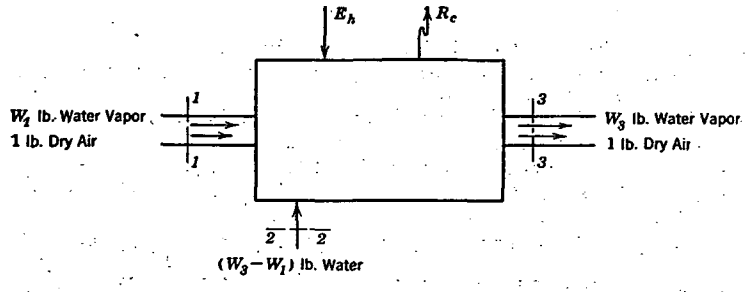

FIG. 1. DIAGRAM ILLUSTRATING ENERGY EQUATION 15

dry air for saturation, the grains of moisture per cubic foot of saturated air, the total heat in Btu per pound of dry air saturated with moisture, and the weight of the dry air in pounds per cubic foot. Fig. 2 shows the procedure to follow in using the Bulkeley Chart. The directrix curves above the saturation line are as follows:

A is the total heat in Btu contained in the mixture above 0 F, and is to be referred to the column of figures at the left side of the chart. Heat of the liquid is not included.

B is the grains of moisture of water vapor contained in each pound of the saturated mixture and is to be referred to the figures at the left side of the chart.

C is the grains of moisture of water vapor per cubic foot of saturated mixture, and is to be referred to the figures at the left side of the chart which are to be divided by 10.

D is the weight in decimal fractions of a pound, of one cubic foot of the saturated mixture, and is referred to the first column of figures to the right of the saturation line between the vertical dry-bulb temperature lines 170 and 180 F. The relative density of the mixture is read in a similar manner from the same curve by the column of figures between the vertical dry-bulb temperature lines 180 and 190 F.

E is similar to *D* but is for dry air, devoid of all moisture or water vapor. For con-

[4]See A Review of Psychrometric Charts, C. O. Mackey (*Heating and Ventilating*, June, July, 1931).

[5]The Bulkeley Psychrometric Chart was presented to the Society in 1926. (See A.S.H.V.E. TRANSACTIONS, Vol. 32, 1926.) Single copy of the chart can be furnished at a cost of $ .50.

venience, the approximate absolute temperature of 500 F is given at 40 F on the saturation line for the purpose of calculating volume, weight per cubic foot, and relative density at partial saturation.

METHOD OF USING THE CHART

Example 8. Relative Humidity: At the intersection of the 78 F wet-bulb line and the 95 F dry-bulb line, the relative humidity is read directly on the straight diagonal lines as 46 per cent.

Example 9. Dew Point: At the intersection of the 78 F wet-bulb line, the dew-point temperature is read directly on the horizontal temperature lines as 70.9 F.

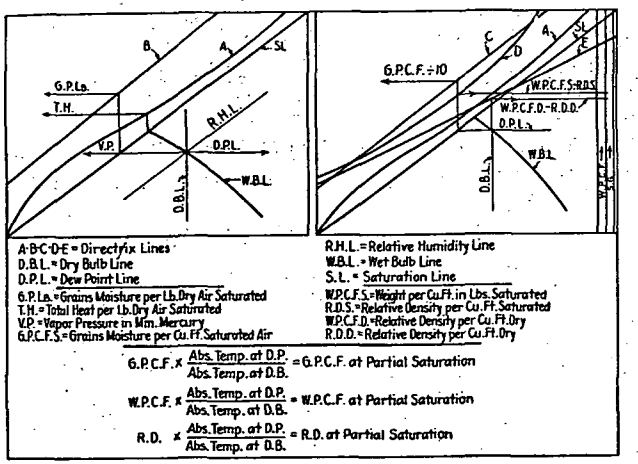

FIG. 2. DIAGRAMS SHOWING PROCEDURE TO FOLLOW IN USING BULKELEY CHART

Example 10. Vapor Pressure: At the intersection of the 78 F wet-bulb line and the 95 F dry-bulb line, pass in a horizontal direction to the left of the chart and on the logarithmic scale read the vapor pressure as 19.4 millimeters of mercury. (Divide by 25.4 for inches.)

Example 11. Total Heat Above 0 F in Mixture per Pound of Dry Air Saturated with Moisture: From where the wet-bulb line joins the saturation line, pass in a vertical direction on the 78 F dry-bulb line to its intersection with curve *A* and on the logarithmic scale at the left of the chart read 40.6 Btu per pound of mixture. The use of this curve to obtain the total heat in the mixture at any wet-bulb temperature is a great convenience, as the number of Btu required to heat the mixture and humidify it, as well as the refrigeration required to cool and dehumidify the mixture, can be obtained by taking the difference in total heat before and after treatment of the mixture.

Example 12. Grains of Moisture per Pound of Mixture: From 70.9 F dew-point temperature on the saturation line, pass vertically to the intersection with curve *B* and on the logarithmic scale at the left read 114 grains of moisture per pound.

Example 13. Grains of Moisture per Cubic Foot of Mixture, Partially Saturated: From 70.9 F dew-point temperature on the saturation line proceed in a vertical direction to curve *C*, and on the logarithmic scale to the left read 83.3 which, divided by 10, gives 8.33 grains. A temperature of 70.9 F is equal to an absolute temperature of 530.9, and 95 F equals 555, absolute temperature. Therefore, $\frac{530.9}{555} \times 8.33 = 7.97$ grains per cubic foot of partially saturated mixture.

Example 14. Grains of Moisture per Cubic Foot of Dry Air, Saturated: Starting at the saturation line at the desired temperature, pass in a vertical direction to curve *C* and on