


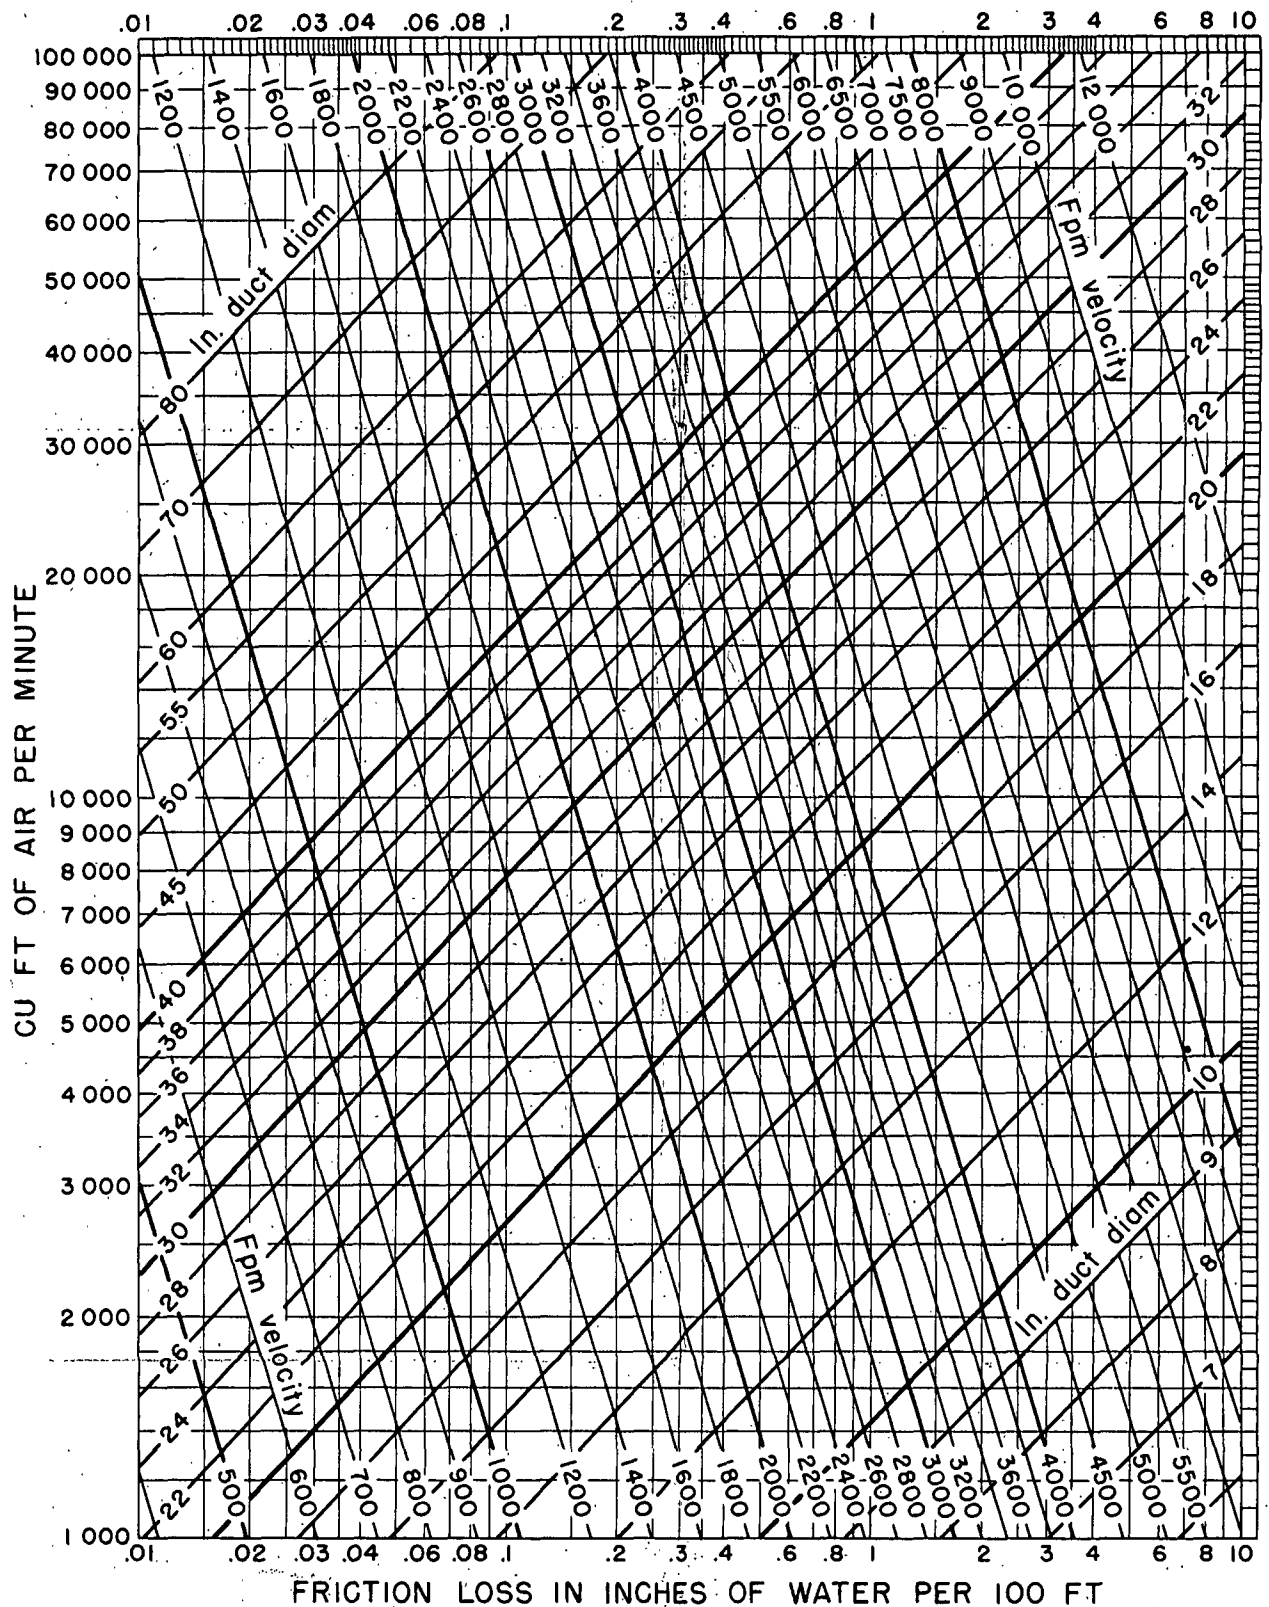

FRICION OF AIR IN STRAIGHT DUCTS

HEATING VENTILATING AIR CONDITIONING GUIDE 1950

COPYRIGHT 1950

BASED ON STANDARD AIR OF 0.075 LB PER CU FT DENSITY FLOWING THROUGH AVERAGE, CLEAN, ROUND, GALVANIZED METAL DUCTS HAVING APPROXIMATELY 40 JOINTS PER 100 FT. NO SAFETY FACTOR INCLUDED. CAUTION: DO NOT EXTRAPOLATE BELOW CHART.