

FABRICATION
EXCAVATION

BERRY CONTRACTING, INC.

Industrial Constructors

P. O. BOX 1757 TELEPHONE TU 4-0373

CORPUS CHRISTI, TEXAS 78403

October 16, 1967

HEAVY RIGGING
RENTAL EQUIPMENT

PLAINTIFF'S EXHIBIT

CC-143

Coastal States Petrochemical Company
P. O. Box 1501
Corpus Christi, Texas

Attention: Mr. B. A. Paulson, General Manager

Subject: 8" Firewater Line for "Alky", Cumene and Ethylbenzene Units.

Gentlemen:

In accordance with your request, "Scope of Work", Drawings and information provided by Mr. G. B. Coleman; Berry Contracting, Inc., is pleased to submit the following Proposal.

Berry Contracting, Inc., proposes to furnish all labor, construction equipment, materials (as designated), tools, taxes, insurance and competent supervision necessary to complete "Subject" 8" Firewater Line and Supports for the total lump sum of:

TEN THOUSAND NINE HUNDRED SIXTY-SEVEN DOLLARS
(\$10,967.00)


The above Price excludes all costs of underground obstructions not shown on Drawings or apparent in Job-Site Investigation.

The length of time required to complete this Construction will not exceed eighteen (18) work days.


Thank you for the opportunity of quoting this Pipe Work and for all previous Construction awarded Berry Contracting, Inc.

Respectfully submitted,

BERRY CONTRACTING, INC.



Robert C. Burditt



RCB/bb

CED0005811

COASTAL STATES PETROCHEMICAL COMPANY
PHONE TULIP 3-5211
CORPUS CHRISTI, TEXAS 78403

MAILING ADDRESS
P. O. DRAWER 521

October 5, 1967

Berry Contracting, Inc.
P. O. Box 1757
Corpus Christi, Texas 78403

Gentlemen: .

You are invited to submit price quotations for installing firewater piping at Coastal States Petrochemical Company, Corpus Christi, Texas, according to the attached specifications and drawings.

For more details, you may visit with me at the plant.

Sincerely,

COASTAL STATES PETROCHEMICAL CO.

H. B. Ramby
H. B. Ramby
Maintenance Supervisor *Rja*

HBR:nb

Attachments

CED0005812

BID SPECIFICATIONS
FOR
8" FIREWATER LINE

Coastal States Petrochemical Company
Corpus Christi, Texas

October, 1967

mfb

CED0005813

JOB SPECIFICATIONS

I. SCOPE

These specifications shall apply to a firewater line that is to be installed at Coastal States Petrochemical Company, Corpus Christi, Texas, in the Alky, Cumene and E.B. Unit area, according to the attached drawings.

II. SPECIFICATIONS

The contractor shall furnish all labor, supervision, tools, equipment, utilities, insurance, and materials except valves which shall be furnished by Coastal States Petrochemical Company. Concrete shall be 3000 psi, 28-day ultimate strength, and shall be constructed according to the American Concrete Institute. Steel piping shall be ASTM A 53 Gr. B, and shall be welded according to AWS Standards. ASME Welding Qualifications, Section IX, shall apply. All underground piping shall be coated and wrapped according to NAPCA Specification TF2 and all joints shall be cleaned, primed, double wrapped with 20 mils of polyethylene tape, and wrapped with 150# felt. All piping above ground shall be sandblasted according to SSPC-SP 1063T, "Near White Metal Blast", shall be painted with one coat of Briner #2810 Durapon red chromate primer 2-3 mils dry film thickness, one coat of Briner #2809 Durapon green primer 2-3 mils dry film, and one coat of Briner #2842 Red 2-3 mils dry film. All painting shall be done according to SSPC Specifications.


III. GENERAL CONDITIONS

Working hours shall be from 7 A.M. to 3:30 P.M. Monday through Friday. Coastal States holidays shall be observed. The contractor shall comply with the requirements of the plant Safety Department. The contractor shall provide and maintain, at his own expense, with carriers acceptable to Coastal States, the following insurance, to be evidenced by Certificates of Insurance furnished to the Company by the carriers:

1. Workmen's Compensation Insurance, including death coverage.
2. Public Liability and Property Damage Insurance on operations with minimum limits as follows:


Bodily Injury ----- \$100,000/\$300,000.
Property Damage----- \$50,000. on any one accident.

All bids shall be submitted to H. B. Ramby, Coastal States Petrochemical Company on or before 12:00 noon, October 13, 1967. The job shall be completed within 30 days after contract agreement or the contractor shall forfeit 1% of quoted contract price for each day thereafter.

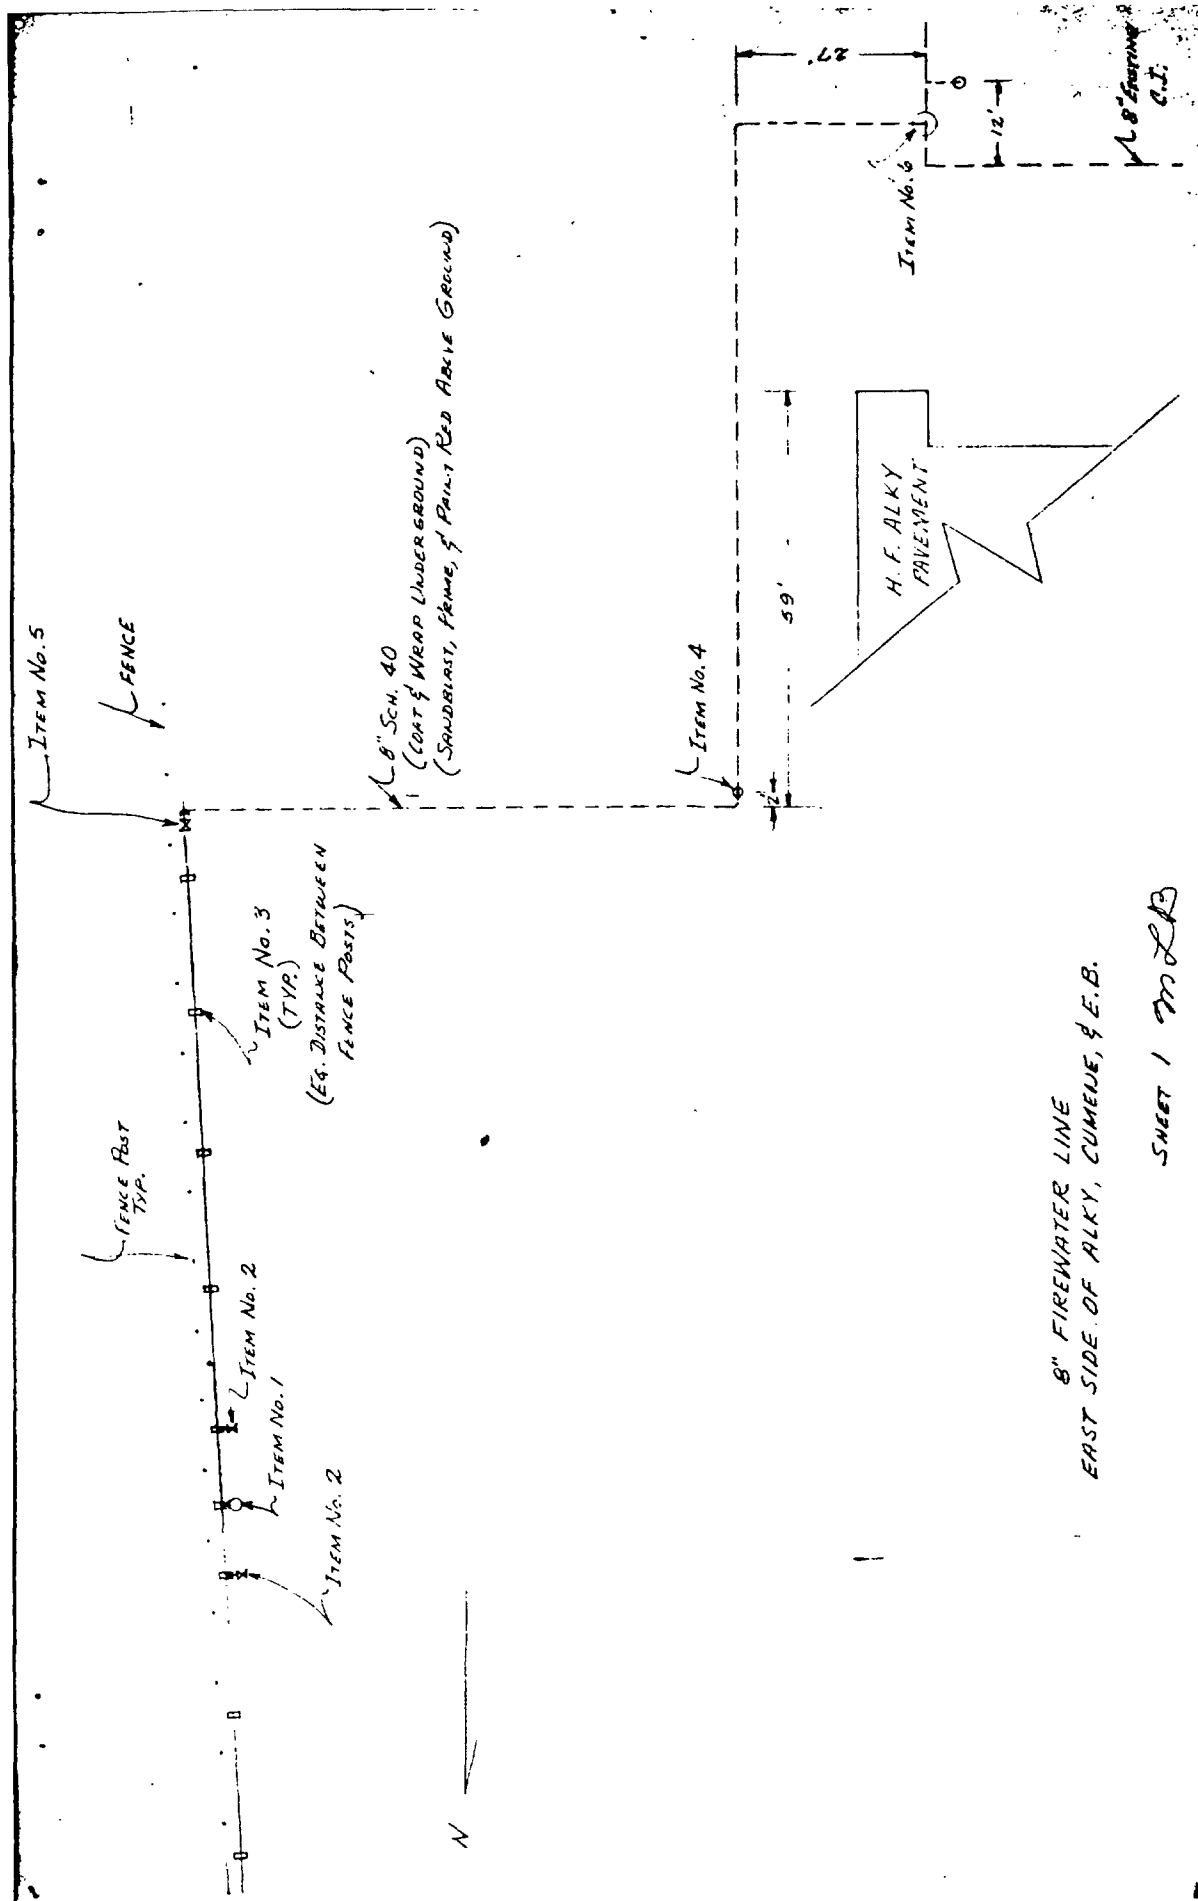


8" FIREWATER LINE
EAST SIDE OF ALKY, CUMENE, & E.B.



SHEET 1 of 2

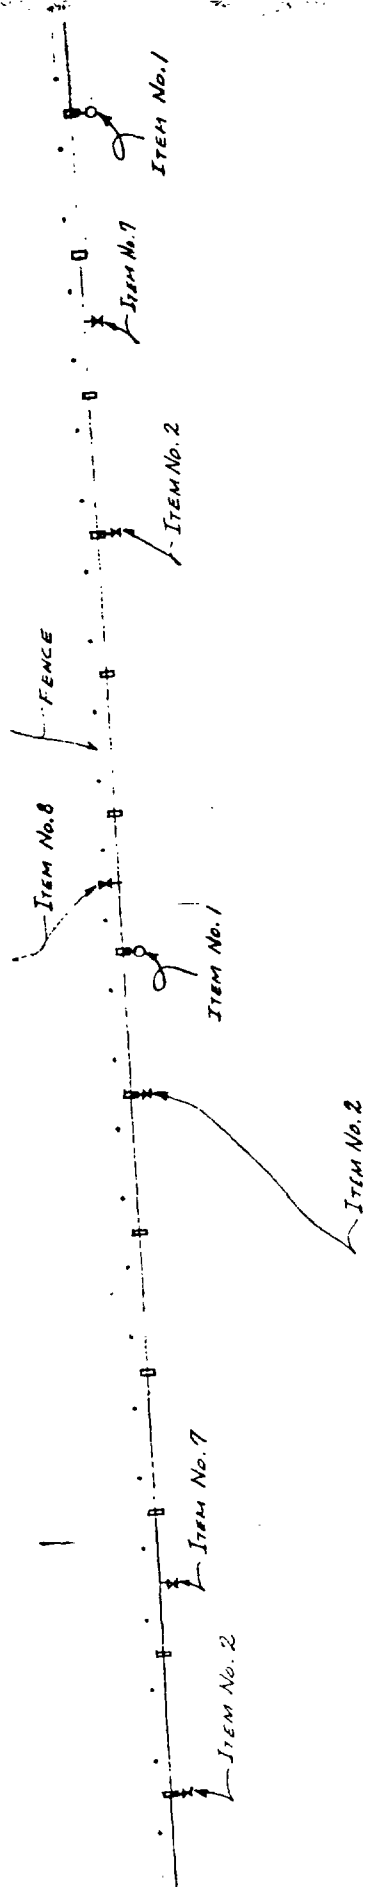

SHEET 2 OF 2 B

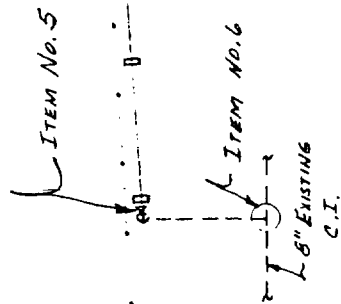


SHEET 3 of 13

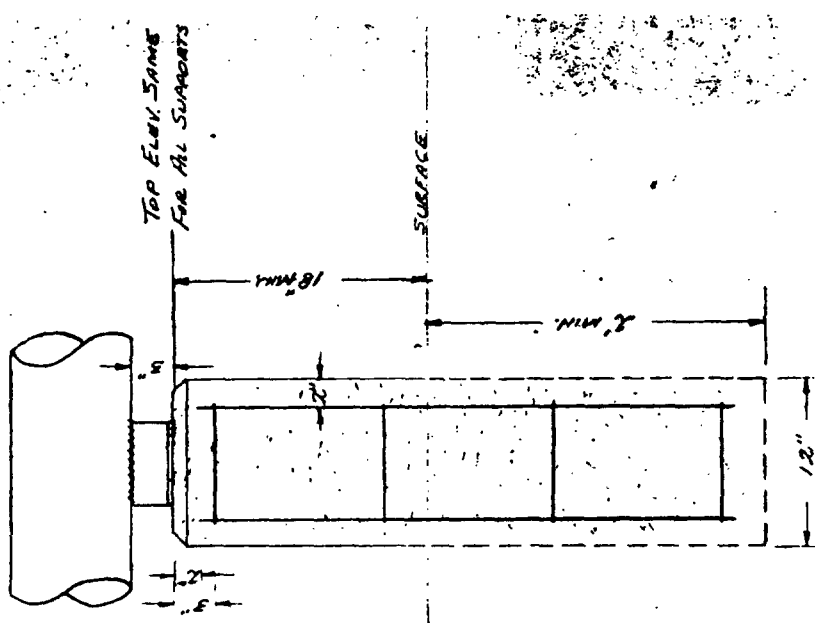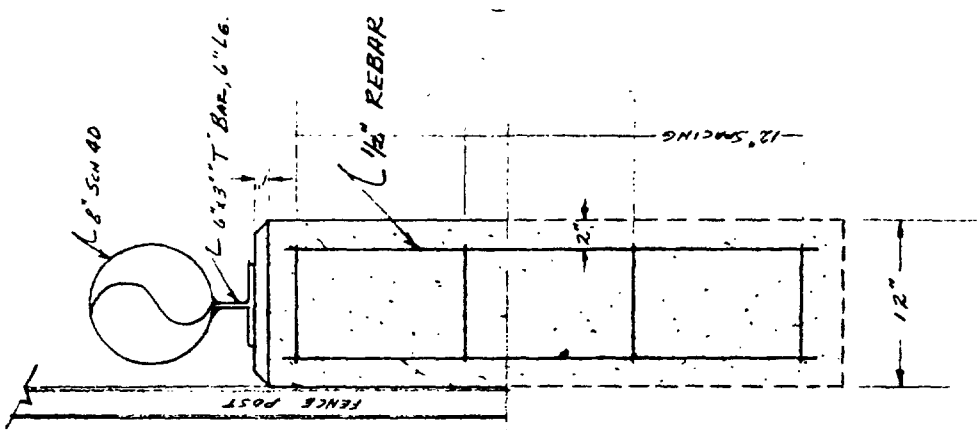


CONCRETE
PIPE SUPPORT
ITEM NO. 3
29 Req'd.

SHEET 4 of 13

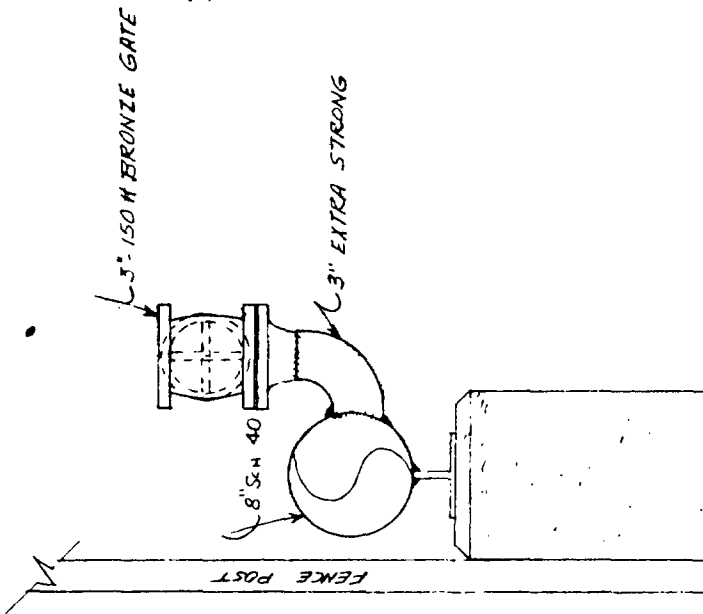

MONITOR NOZZLE
ITEM NO. 1
3 REQ'D.

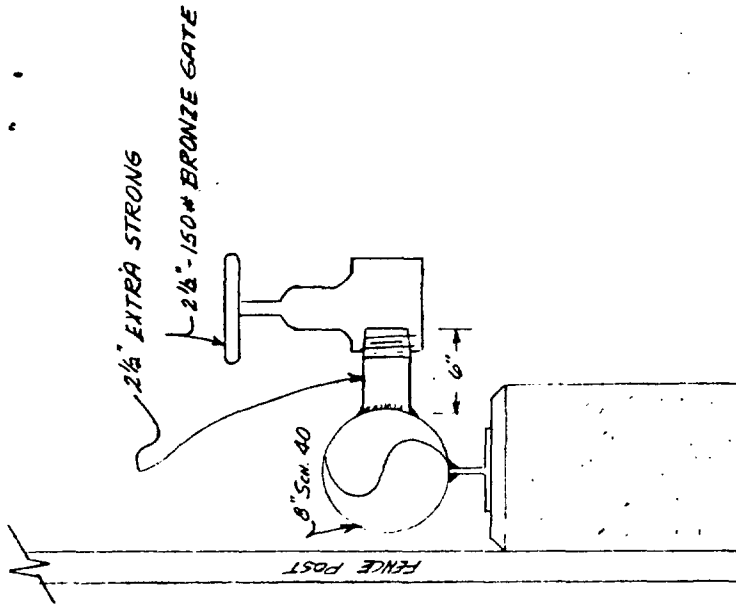

FIREHOSE NOZZLE
ITEM NO. 2
5 REQ'D.

SHEET 5 OF 12

3"-150# BRONZE GATE VALVE

2 1/2"-150# BRONZE GATE VALVE (TYPICAL)

2 1/2"x6" LG. EXTRA STRONG NOZ. (TYPICAL)

SURFACE


6" SCH 40

AS B
8" SCH 40
NEW


SHEET 6 OF 13


8" EXISTING C.I.

MONITOR NOZZLE
ITEM NO. 4 (1 REQ'D)

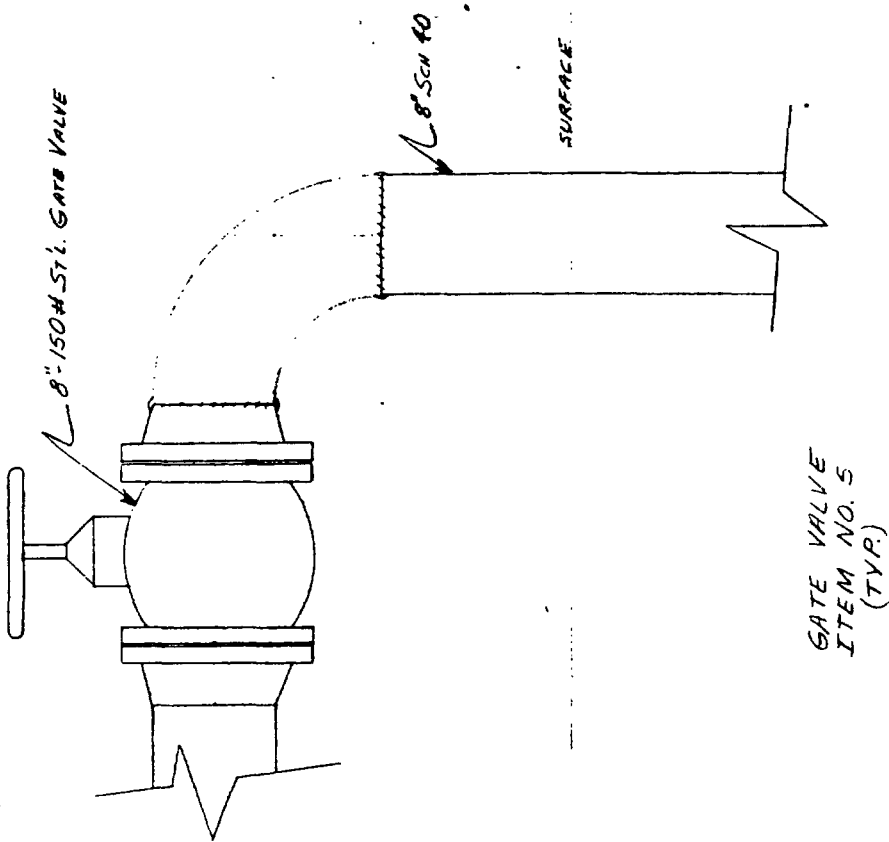


GATE VALVE
ITEM NO. 5
(TYP.)

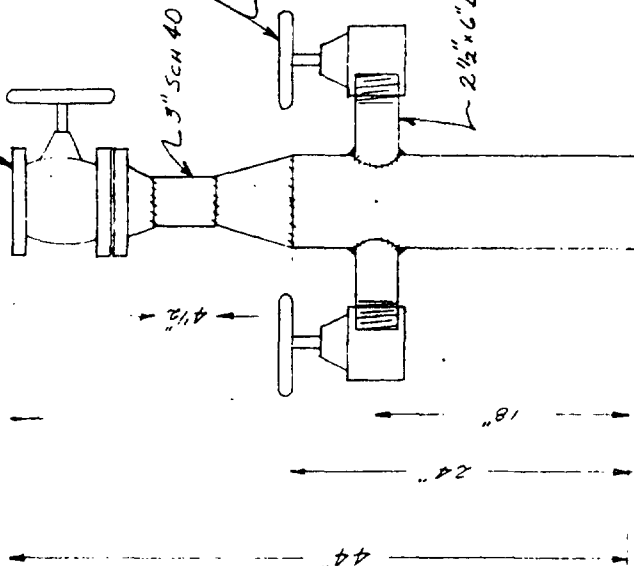


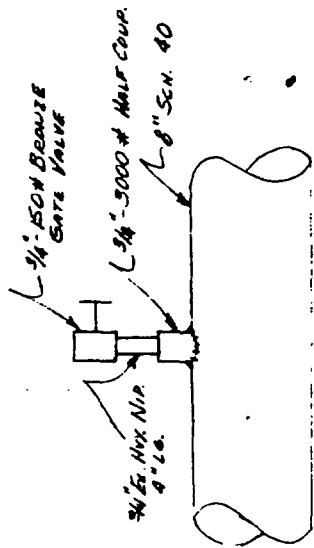


VENT
ITEM NO. 8
1 REQ'D.

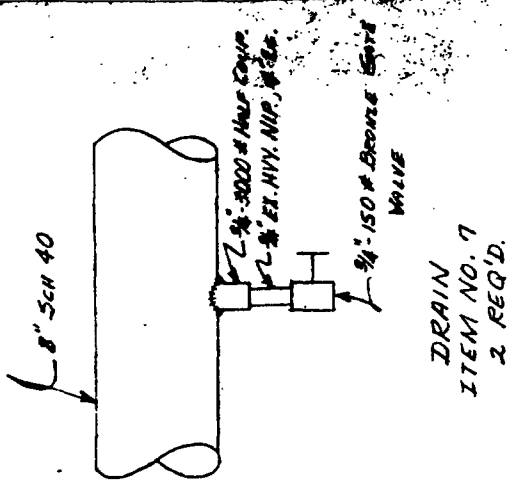

DRAIN
ITEM NO. 7
2 REQ'D.

24"

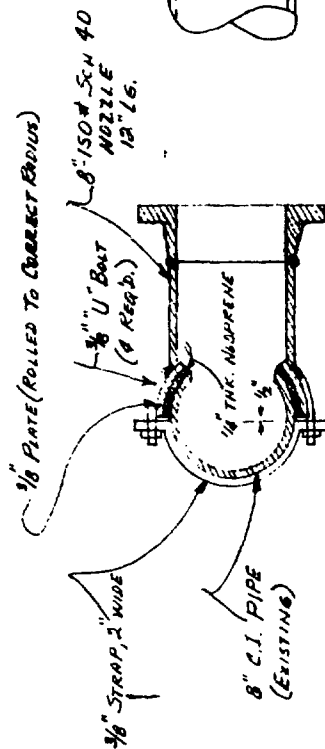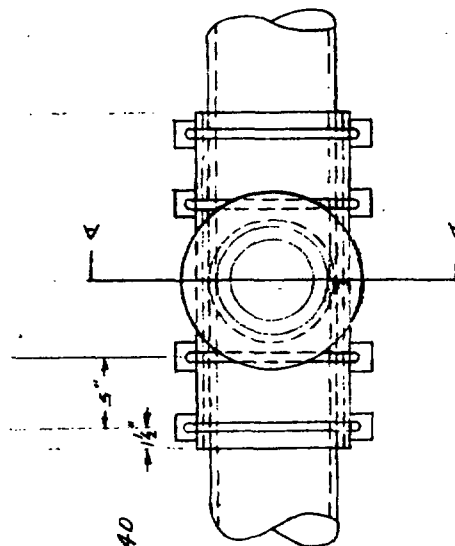

SECTION A-A

8" TAPPING NOZZLE FOR
TIE-IN
ITEM NO. 6 *per* L.B.
2 REQ'D.

SHEET 7