D.L. APPLICATION

E 10 STOVE PIPE ELLS - Figures 41A and B.

FIG. 41A.
2 MITER ELL

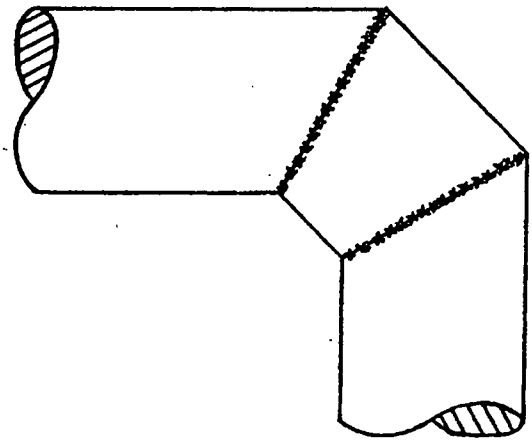

FIG. 41 B.
3 MITER ELL

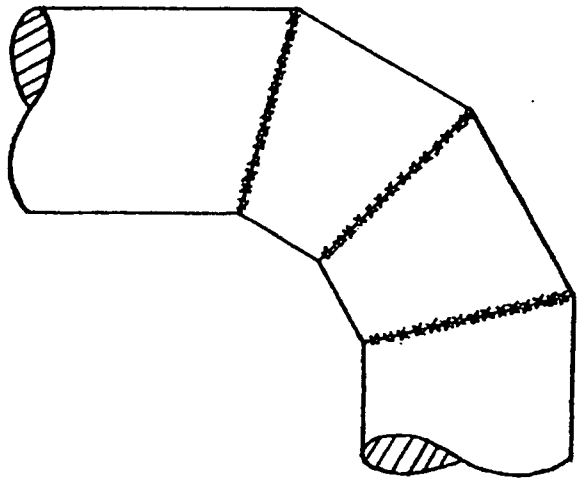

E 10.1 Stove pipe ells shall be insulated with mitered covering the same type and thickness as that specified for the pipe.

10.1a The dimensions of the miters shall be gotten from the pipe or sheet metal fabrication shop or in the field.

E 10.2 The covers may be preformed in the shop or the loose miters applied in the field.

10.2a The end miters of the 1st or inner layer shall be approximately 3" longer than the end miters of the outer layer. See Figure 42.

FIG. 42 — PREFORMED COVER

