


TABLE 8. RETURN AIR—CARRYING CAPACITY—BTU SERVICED

RETURN AIR COMBINATION No.	DUCT DIA. IN.	TYPE A BTU PER HR	TYPE B AND C BTU PER HR	TYPE D BTU PER HR	TYPE E BTU PER HR	TYPE F BTU PER HR	RETURN AIR COMBINATION No.
31	10	11,300	9,500	7,800	5,000	7,800	31
32	12	16,300	13,700	11,300	7,200	11,300	32
33	14	22,200	18,700	15,300	9,800	15,300	33
34	16	29,000	24,400	20,000	12,800	20,000	34
35	18	36,700	30,800	25,300	16,200	25,300	35
36	20	45,300	38,000	31,300	20,000	31,300	36
37	22	54,800	46,000	37,800	24,100	37,800	37
38	24	65,200	54,800	45,000	28,700	45,000	38

The selected types of return air ducts and fittings are shown in Fig. 5.

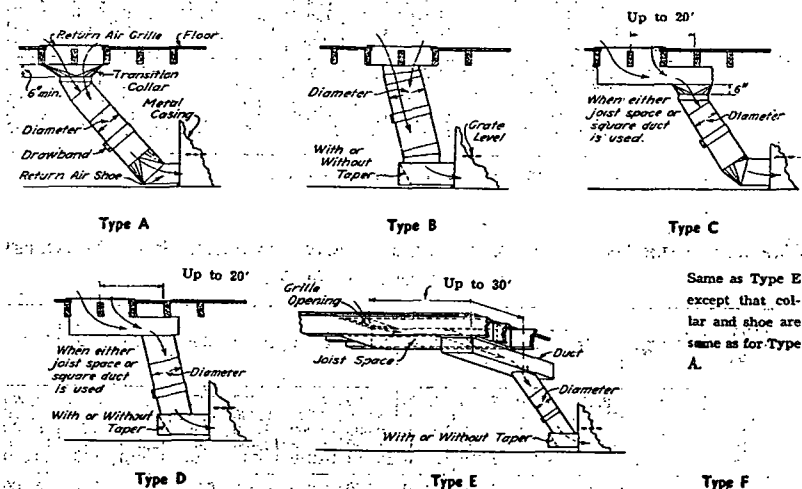

Note: For Types C, D, E, and F return-air duct systems, reduce the carrying capacities shown in Table 8 by 1 per cent for each 4 ft additional length in the horizontal run.

FIG. 5. TYPICAL ARRANGEMENTS OF RETURN AIR DUCT SYSTEMS

Design Procedure

The steps to be taken in designing a gravity warm air duct system are:

1. Calculate the heat loss from each room as explained in Chapters 6, 8 and 14.
2. Prepare a layout showing (a) furnace, (b) chimney connection, (c) warm air registers (whether floor, baseboard or wall), (d) return air grilles.
3. Indicate on each warm air run (using symbols shown in Fig. 6): (a) whether the room to be heated is on the first or second story, (b) the approximate length of leader pipe in the basement, (c) the number of right angle elbows required, including the elbow at the boot connection (see Fig. 2), (d) whether the register is to be located in the floor, in the baseboard, or in the wall.
4. Show the number and proposed locations of return air grilles and the type of return air system (see Fig. 5).

5. From Table 6, for first story, or from Table 7 for second story, select the combination number for the warm air system which will supply the heat required to each room, with the number of elbows and length of leader pipe previously determined. Then, using the combination number as found, read directly in Tables 1, 2, or 3 the leader, stack, and register sizes required.

6. From Table 8 select the combination number for the return air system to correspond with the Btu serviced and the type of return air system. Then from Table 4 select the duct and grille sizes, etc., corresponding to the same combination number.

7. Select a furnace having a register delivery, in Btu per hour, equal to the total heat loss from the structure.

Design Examples

Examples 1 and 2 will illustrate the use of the tables in selecting warm air and return system sizes.

Example 1. For a room which has a heat loss of 22,500 Btu per hour select the size of first story warm air system. There are three elbows and the leader is approximately 10 ft long.

Solution: Since 22,500 Btu is beyond the capacities shown in Table 6, it is necessary to select two units of 11,250 each. From Table 6 in 10 ft leader column and in section for three elbows find 11,400 as nearest capacity which corresponds to Combination Number 4 in first column. Refer to Combination Number 4 in Table 1 and find that the leader should be 12 in. in diameter and should be used with a 12 x 14 in. floor register or a 13 x 11 in. baseboard register with a 5 1/4 in. extension.

Example 2. What is the size of a return system of Type D which is to service 35,000 Btu per hour?

Solution: From Table 8 find Combination Number 37 which will service 37,800 Btu per hour. Refer to Table 4 to find that Combination Number 37 will require a 22-in. diameter duct; a shoe area of 420 sq in., a metal grille 18 x 30 in., a duct 42 x 10 in. or 36 x 12 in. If joist lining is used the minimum depth should be 15 in. for two 2-joist spaces 14 in. wide, or 10 in. for three joist spaces.

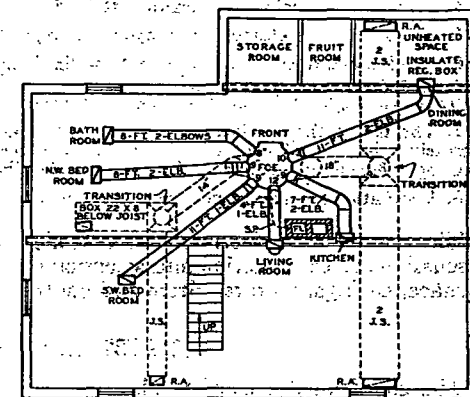


FIG. 6. TYPICAL BASEMENT LINE DRAWING

REFERENCES

- 1—The engineering data were obtained from University of Illinois, *Engineering Experiment Station Bulletin* Nos. 141, 158, 189 and 246: Warm Air Furnaces and Heating Systems, by A. C. Willard, A. P. Kratz, V. S. Day, and S. Konzo. See also Gravity Code and Manual for Gravity Warm Air Heating Systems, published by the National Warm Air Heating and Air Conditioning Association.
- 2—Simplified Procedure for Selecting Capacities of Duct Systems for Gravity Warm Air Heating Plants, by A. P. Kratz and S. Konzo (University of Illinois, Engineering Experiment Station Circular 45, Dec., 1942).
- 3—Gravity Code and Manual for Gravity Warm Air Heating Systems, Second Edition, 1945, National Warm Air Heating and Air Conditioning Association.