


TIME FUNC NEW VALUE
8.78 D1 8.78

INSTR 1 METH 21 FILE 93

RUN 1 PUMP 1 ONE

SENSITIVITIES 100 30

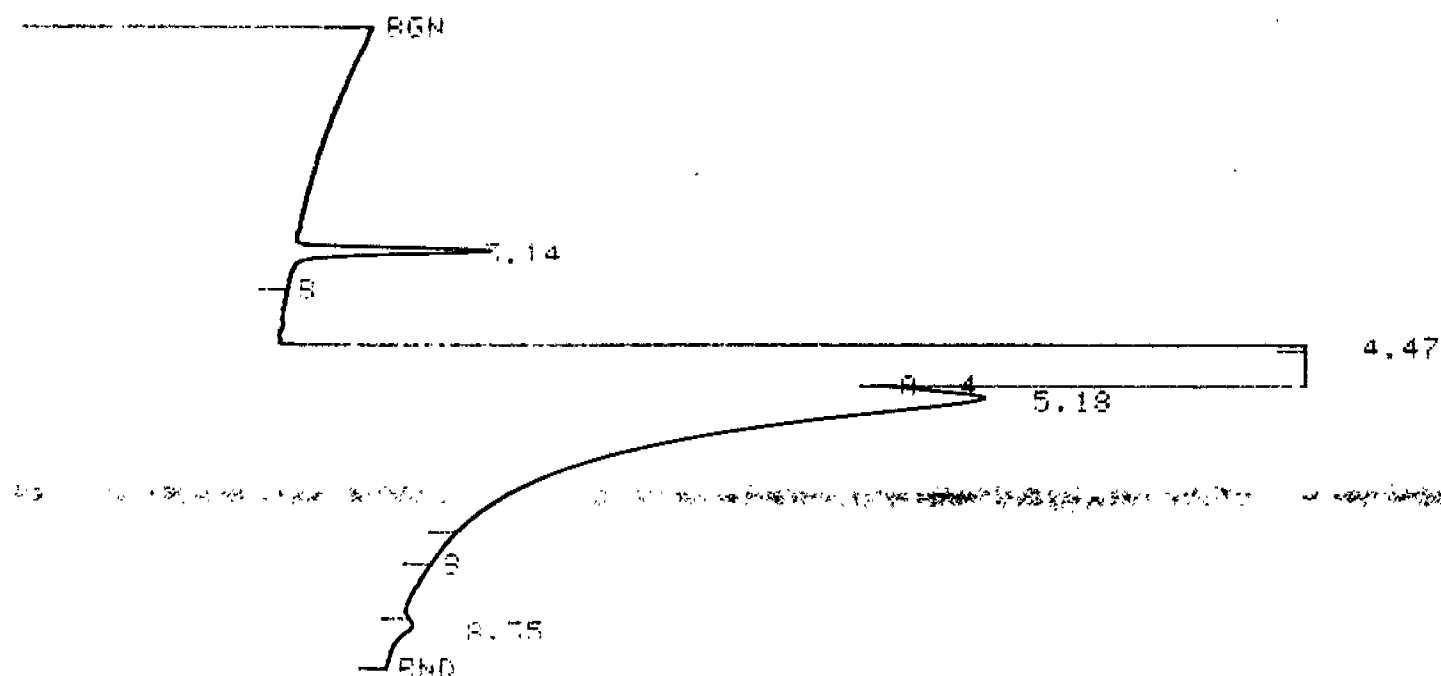


INSTR 1 METH 21 FILE 93

RUN 1 PUMP 1 ONE 12 : 12.0 7 / 6 / 84

SENSITIVITIES 100 30

TIME	AREA	BC	PRT	RF	C	NAME
			0.272	0.737		PROPYLENE:
3.14	0.2862		0.314	1.357	19.4214	VINYL:
			0.351	1.320		ETOL:
4.47	1.5288	T	0.447	2.711	207.2397	MECL:
5.18	73.3004		0.518	5.000	18325.1200	CS2:
			0.727	1.204		EDC:
8.75	0.0858		0.835	0.908	12.9762	
			1.414	1.528		R-TRI:
			2.459	1.633		1112 TETRAS:

DO A 108855
CONFIDENTIAL

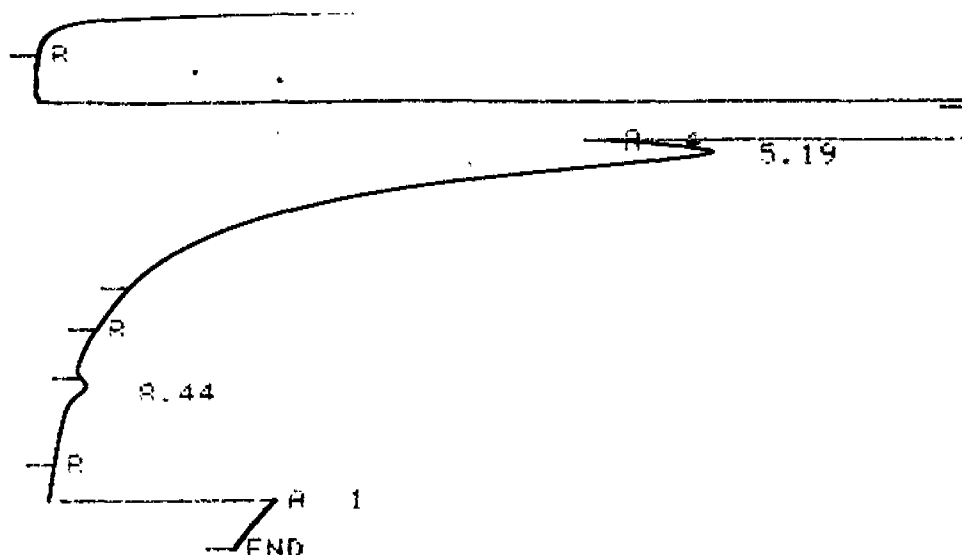

INST 1 METH 21 FILE 83

RUN 1 PUMP 1 ONE 10 : 0.5 7 / 6 / 84

SENSITIVITIES 100 30

TIME	AREA	BC	RRT	RF	C	NAME
------	------	----	-----	----	---	------


			0.272	0.737		PROPYLENE:
3.17	5.3590		0.317	1.357	363.5457	VINYL:
			0.351	1.320		ETOL:
4.49	1.4430	T	0.449	2.711	195.6041	MECL:

TIME	FUNC	NEW VALUE
10.68	01	10.68


INST 1 METH 21 FILE 81

RUN 1 PUMP 2 TWO

SENSITIVITIES 100 30

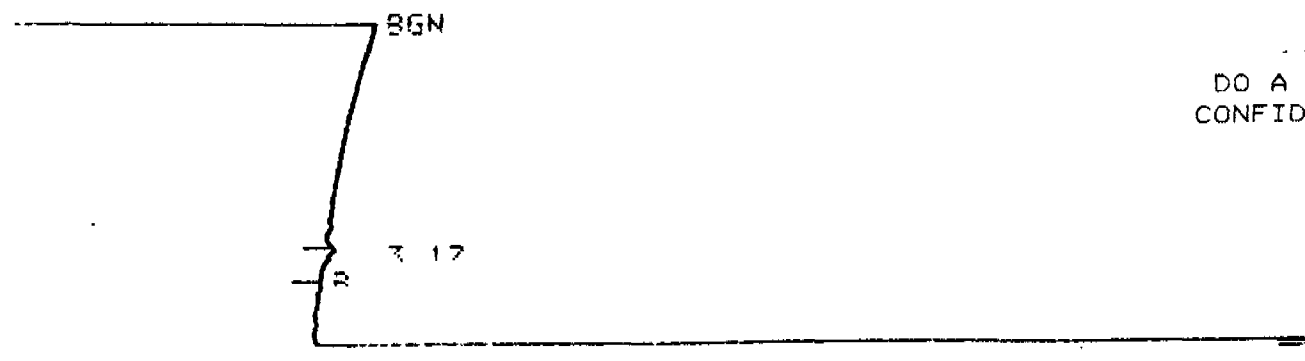

DO A 108856
CONFIDENTIAL

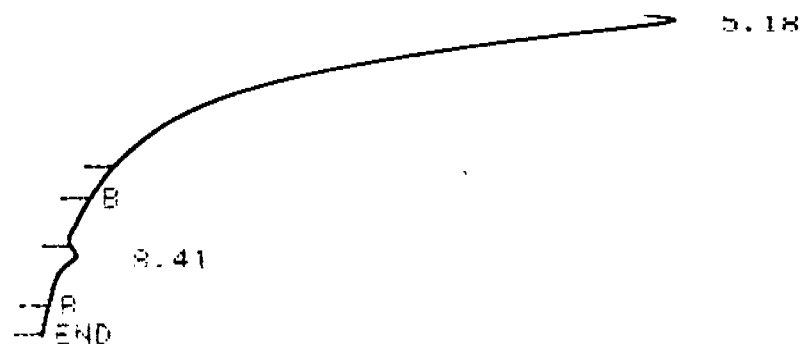

INST 1 METH 21 FILE 31

RUN 1 PUMP 2 TWO 10 : 13.3 7 / 6 / 84

SENSITIVITIES 100 30


TIME	AREA	BC	RRT	RF	C	NAME
			0.272	0.737		PROPYLENE:
3.17	0.0205		0.317	1.357	1.3936	UINYL:
			0.351	1.320		ETCL:
4.50	1.2218	T	0.450	2.711	165.6204	MECL:
5.18	76.9152		0.518	5.000	19228.8000	CS2:
			0.727	1.204		EOC:
8.41	0.2751		0.841	0.908	12.4914	
			1.414	1.528		B-TRI: -
			2.459	1.633		1112 TETRASY
			3.433	1.658		1122 TETRAS:

TIME FUNC NEW VALUE
9.49 D1 9.49

INST 1 METH 21 FILE 80


RUN 1 PUMP 3 THREE

SENSITIVITIES 100 30

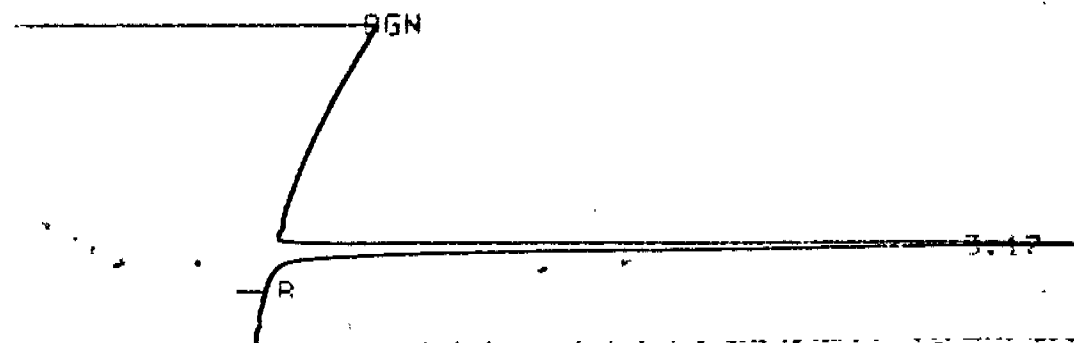

DO A 108857
CONFIDENTIAL

PERKIN-ELMER PART No. 332-1910

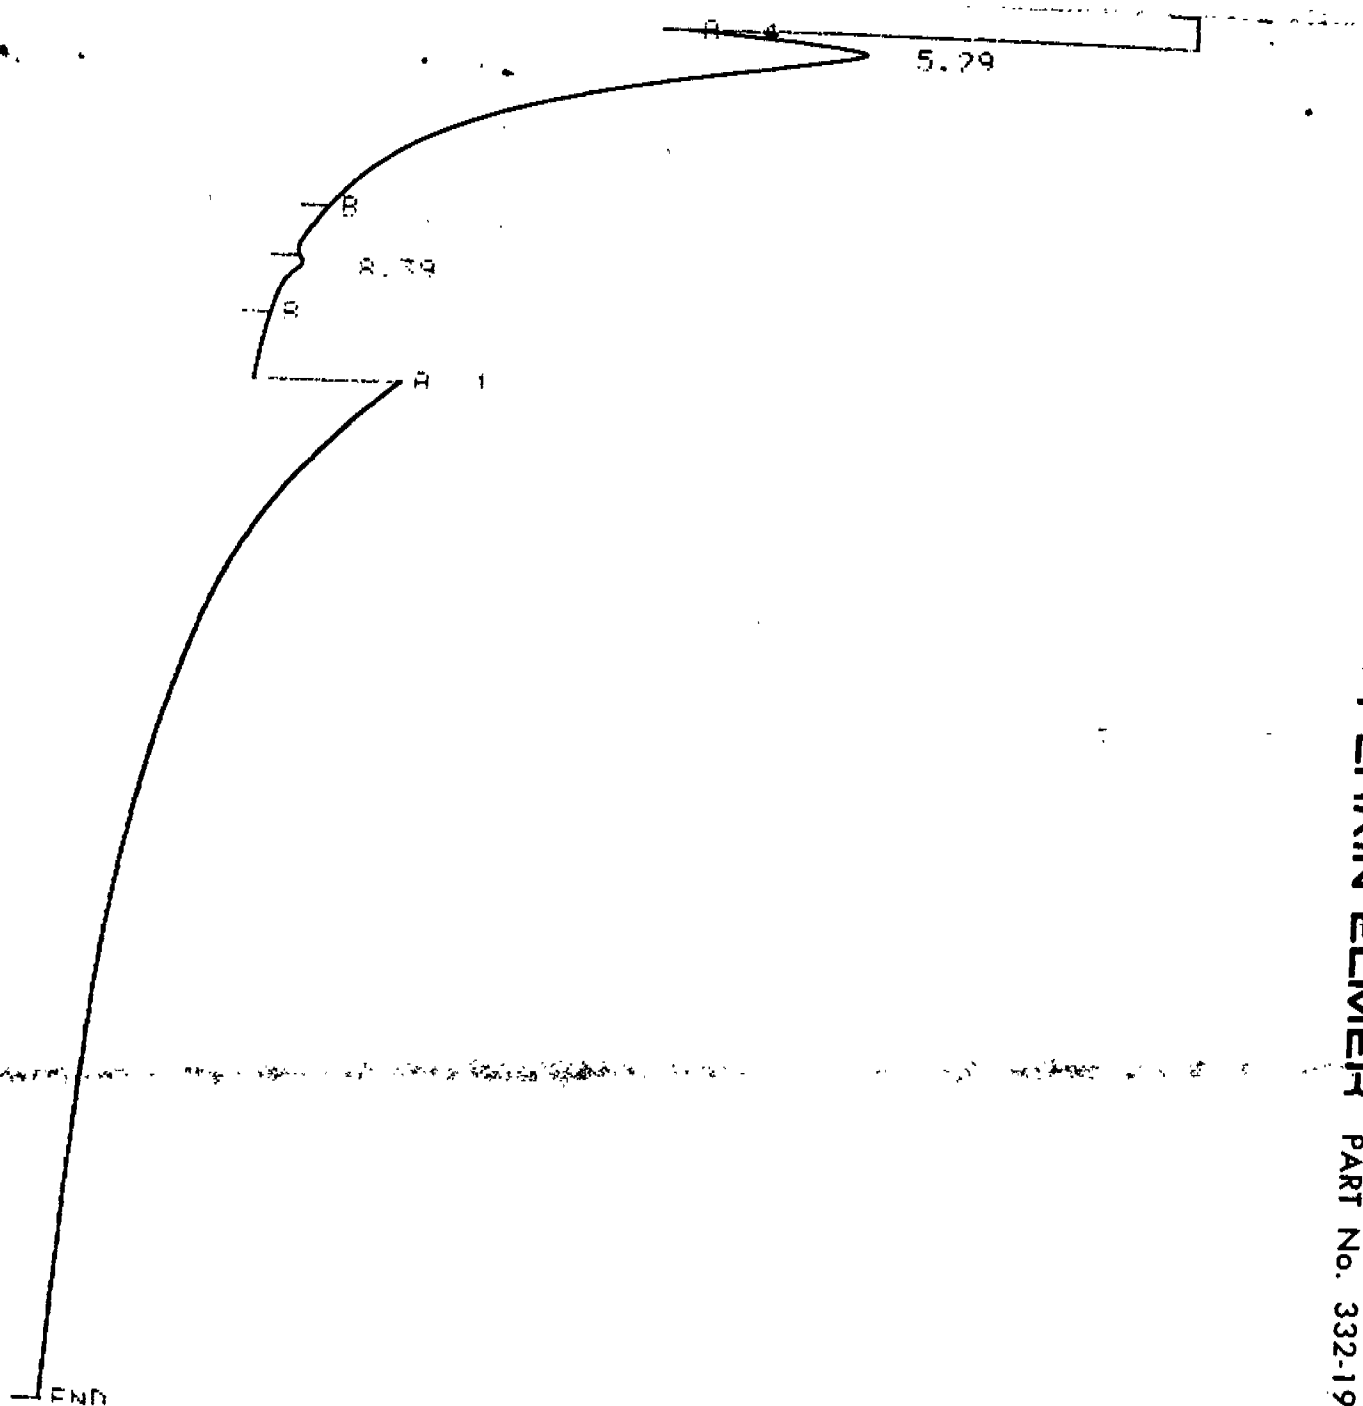

INCT 1 METH 21 FILE 80

1 PUMP 3 THREE 10 : 24.5 7 / 6 / 84

SENSITIVITIES 100 30

DO A 108858
CONFIDENTIAL

TIME	AREA	BC	RRT	RF	C	NAME
------	------	----	-----	----	---	------

[illegible]

850