TABLE 7. WARM AIR CARRYING CAPACITY, BTU DELIVERED, SECOND STORY REGISTERS[a]

Length of Leader Pipe—in Feet

COMBINATION No.[b,c]	No. OF ELBOWS	4 FT	6 FT	8 FT	10 FT	12 FT	14 FT	16 FT	18 FT	20 FT	22 FT	24 FT
11-22	1	8,370	8,140	7,900	7,670	7,430	7,190	6,950	6,710	6,470	6,240	6,000
12-24		10,040	9,760	9,470	9,190	8,900	8,620	8,330	8,050	7,770	7,480	7,200
14		11,710	11,380	11,050	10,720	10,390	10,060	9,720	9,390	9,060	8,730	8,400
15		16,200	15,750	15,300	14,840	14,380	13,920	13,460	13,000	12,550	12,100	11,640
16		18,920	18,390	17,850	17,310	16,780	16,240	15,710	15,180	14,640	14,100	13,570
11-22	2	7,940	7,720	7,500	7,280	7,050	6,830	6,600	6,370	6,150	5,930	5,700
12-24		9,540	9,270	9,000	8,730	8,460	8,190	7,920	7,650	7,380	7,110	6,840
14		11,120	10,810	10,500	10,180	9,870	9,550	9,230	8,920	8,610	8,290	7,980
15		15,400	14,970	14,530	14,100	13,670	13,230	12,800	12,380	11,930	11,500	11,070
16		17,980	17,470	16,960	16,450	15,950	15,430	14,830	14,420	13,910	13,400	12,890
11-22	3	7,530	7,320	7,110	6,900	6,680	6,470	6,250	6,040	5,830	5,620	5,400
12-24		9,030	8,780	8,520	8,270	8,010	7,750	7,500	7,240	6,990	6,730	6,470
14		10,530	10,240	9,940	9,650	9,350	9,050	8,750	8,450	8,160	7,860	7,560
15		14,580	14,180	13,780	13,370	12,960	12,530	12,120	11,710	11,300	10,890	10,480
16		17,040	16,550	16,070	15,580	15,110	14,620	14,140	13,660	13,180	12,700	12,210
11-22	4	7,120	6,920	6,720	6,520	6,310	6,110	5,900	5,700	5,500	5,300	5,100
12-24		8,530	8,290	8,050	7,810	7,570	7,330	7,080	6,840	6,600	6,360	6,120
14		9,950	9,670	9,390	9,110	8,830	8,550	8,260	7,980	7,700	7,420	7,140
15		13,780	13,390	13,000	12,610	12,220	11,830	11,440	11,050	10,670	10,280	9,890
16		16,080	15,620	15,170	14,710	14,260	13,810	13,350	12,900	12,440	11,980	11,530
11-22	5	6,700	6,510	6,320	6,130	5,940	5,750	5,560	5,370	5,180	4,990	4,800
12-24		8,040	7,810	7,580	7,350	7,130	6,900	6,670	6,440	6,220	5,990	5,760
14		9,370	9,110	8,850	8,580	8,310	8,050	7,780	7,510	7,250	6,980	6,720
15		12,970	12,600	12,240	11,870	11,500	11,140	10,770	10,400	10,040	9,680	9,310
16		15,140	14,710	14,280	13,850	13,420	13,000	12,570	12,140	11,710	11,280	10,850

[a] When floor registers are used, see Fig. 2.
[b] No. 21 for Btu values multiply 11-22 values by 0.83.
[c] No. 23 for Btu values multiply 12-24 values by 0.83.

5. From Table 6, for first story, or from Table 7 for second story, select the combination number for the warm air system which will supply the heat required to each room, with the number of elbows and length of leader pipe previously determined. Then, using the combination number as found, read directly in Tables 1, 2, or 3 the leader, stack, and register sizes required.

6. From Table 8 select the combination number for the return air system to correspond with the Btu serviced and the type of return air system. Then from Table 4 select the duct and grille sizes, etc., corresponding to the same combination number.

7. Select a furnace having a register delivery, in Btu per hour, equal to the total heat loss from the structure.

TABLE 8. RETURN AIR—CARRYING CAPACITY—BTU SERVICED

RETURN AIR COMBINATION No.	DUCT DIA IN.	TYPE A BTU PER HR	TYPES B AND C BTU PER HR	TYPE D BTU PER HR	TYPE E BTU PER HR	TYPE F BTU PER HR	RETURN AIR COMBINATION No.
31	10	11,300	9,500	7,800	5,000	7,800	31
32	12	16,300	13,700	11,300	7,200	11,300	32
33	14	22,200	18,700	15,300	9,800	15,300	33
34	16	29,000	24,400	20,000	12,800	20,000	34
35	18	36,700	30,800	25,300	16,200	25,300	35
36	20	45,300	38,000	31,300	20,000	31,300	36
37	22	54,800	46,000	37,800	24,100	37,800	37
38	24	65,200	54,800	45,000	28,700	45,000	38

Examples 1 and 2 will illustrate the use of the tables in selecting warm air and return system sizes.

Example 1. For a room which has a heat loss of 22,500 Btu per hour select the size of first story warm air system. There are three elbows and the leader is approximately 10 ft long.

Solution: Since 22,500 Btu is beyond the capacities shown in Table 6, it is necessary to select two units of 11,250 each. From Table 6 in 10 ft leader column and in section for three elbows find 11,400 as nearest capacity which corresponds to Combination Number 4 in first column. Refer to Combination Number 4 in Table 1 and find that the leader should be 12 in. in diameter and should be used with a 12 x 14 in. floor register or a 13 x 11 in. baseboard register with a 5¼ in. extension.

Example 2. What is the size of a return system of Type D which is to service 35,000 Btu. per hour?

Solution: From Table 8 find Combination Number 37 which will service 37,800 Btu per hour. Refer to Table 4 to find that Combination Number 37 will require a 22-in. diameter duct, a shoe area of 420 sq in., a metal grille 18 x 30 in., a duct 42 x 10 in. or 36 x 12 in. If joist lining is used the minimum depth should be 15 in. for two 2-joist spaces 14 in. wide, or 10 in. for three joist spaces.

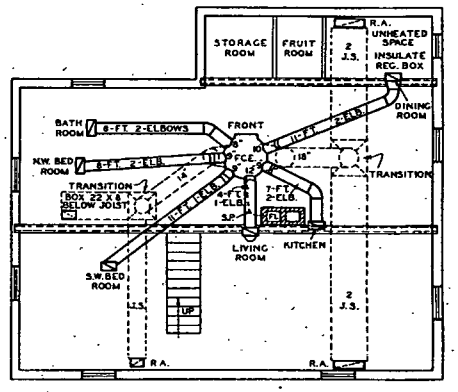

FIG. 4. TYPICAL BASEMENT LINE DRAWING