

imum perimeter 210 ft, and maximum length of uninsulated feeder duct 30 ft for area served by one furnace; is the following:

1. Calculate the heat loss for each room using the methods explained in Chapter 12. For subfloor and edge losses, see Manual 3 of the *National Warm Air Heating and Air Conditioning Association*.

2. Determine the required furnace-bonnet capacity from the heat loss of the building.

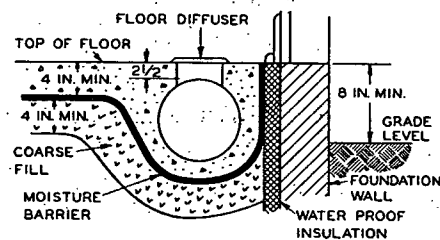


FIG. 5. CROSS-SECTION OF SLAB CONSTRUCTION CONTAINING PERIMETER DUCT

The minimum thickness of concrete over the loop duct should be $2\frac{1}{2}$ in., and continuous mesh reinforcing not less than 6 x 10 gage and 18 in. wide should be placed in the concrete and centered over the duct.

3. Locate the diffusers on the plan. For best heating results, if a room has a heat loss of more than 8,000 Btuh or if it has two or more exposed walls, use two or more diffusers. Proportion the Btuh heat loss of each room among all diffusers in that room.

4. Locate the feeder ducts. First, divide the heat loss of the structure by 15,000 to determine the probable number of feeders. Second, locate the ducts so that they connect with the perimeter-loop at areas of greatest heat loss or in rooms where warm floors are particularly desirable. Third, locate the feeder ducts so that no more than 3 diffusers are in the section of loop duct between any two feeders. (The final number of feeder ducts may be larger than that originally estimated.)

5. Determine the size of feeder ducts using Table 1. Assume that the Btuh required by each diffuser will be supplied by the feeder nearest it. Determine the feeder duct diameter from its length and the total diffuser Btuh delivery carried by it.

6. Determine the total diffuser free area required in each room using Table 2. Measure the length of feeder duct under each room. Add to this *one-half* of the length of the loop duct, and determine the total diffuser free area required. Apportion this among all diffusers in the room.

7. The diameter of the loop duct should be uniform and equal to the diameter of the largest feeder duct.

Perimeter-Radial Systems in Concrete Slab Construction

The perimeter-radial system, Fig. 6, is similar to the perimeter-loop system in that the supply ducts are embedded in the concrete slab. The

TABLE 1. DIAMETER OF FEEDERS IN PERIMETER-LOOP SYSTEM

BTUH PER FEEDER	LENGTH OF FEEDER IN FEET	
	0-15 FEET	16-30 FEET
	INCHES	INCHES
up to 7,999	6	6
8,000 to 8,999	6	7
9,000 to 10,999	7	7
11,000 to 11,999	7	8
12,000 to 12,999	7	8
13,000 to 17,000	8	8

TABLE 2. MINIMUM DIFFUSER FREE AREA REQUIRED FOR PERIMETER-LOOP SYSTEMS

SECTION A. USE THIS TABLE IF LENGTH OF FEEDER WHICH DELIVERS MAJOR PORTION OF WARM AIR TO ROOM IS FROM 2 TO 10 FT.

HEAT LOSS OF ROOM BTUH PER HR.	LENGTH OF FEEDER DUCT UNDER ROOM PLUS $\frac{1}{2}$ LENGTH OF PERIMETER DUCT UNDER ROOM, FT.						
	0-9 Ft.	10-19 Ft.	20-29 Ft.	30-39 Ft.	40-49 Ft.	50-59 Ft.	60-69 Ft.
	TOTAL DIFFUSER FREE AREA REQUIRED FOR ROOM, SQUARE INCHES						
0 to 3,999	20						
4,000 to 5,999	32	27					
6,000 to 7,999	43	39	23	18			
8,000 to 9,999	55	50	34	29	25	20	
10,000 to 11,999	66	61	45	41	36	32	27
12,000 to 13,999	77	72	57	52	48	43	38
			68	63	59	54	50
14,000 to 15,999	88	84	79	75	70	66	61
16,000 to 17,999	100	95	91	86	82	77	72
18,000 to 19,999	111	106	102	97	93	88	84
20,000 to 21,999	122	118	113	109	104	100	95
22,000 to 23,999	134	129	125	120	116	111	106
24,000 to 25,999	145	140	136	131	127	122	118
26,000 to 27,999	156	151	147	142	138	133	129
28,000 to 29,999	168	163	159	154	150	145	141
30,000 to 31,999	179	174	170	165	161	156	152
32,000 to 34,000	190	185	182	176	173	167	164

SECTION B. USE THIS TABLE IF LENGTH OF FEEDER WHICH DELIVERS MAJOR PORTION OF WARM AIR TO ROOM IS FROM 10 TO 20 FT.

0 to 3,999	23	18	18				
4,000 to 5,999	36	31	26				
6,000 to 7,999	49	44	39	21	16	16	19
				34	29	24	
8,000 to 9,999	61	56	51	46	41	36	31
10,000 to 11,999	73	68	63	58	53	48	43
12,000 to 13,999	86	81	76	71	66	61	56
14,000 to 15,999	99	94	89	84	79	74	69
16,000 to 17,999	111	106	101	96	91	86	81
18,000 to 19,999	123	118	113	108	103	98	93
20,000 to 21,999	135	130	125	120	115	110	105
22,000 to 23,999	148	143	138	133	128	123	118
24,000 to 25,999	161	156	151	146	141	136	131
26,000 to 27,999	174	168	164	158	154	148	144
28,000 to 29,999	186	181	176	171	166	161	156
30,000 to 31,999	198	194	188	184	178	174	168
32,000 to 34,000	211	206	201	196	191	186	181

SECTION C. USE THIS TABLE IF LENGTH OF FEEDER WHICH DELIVERS MAJOR PORTION OF WARM AIR TO ROOM IS FROM 20 TO 30 FT.

0 to 3,999	27	21	21				
4,000 to 5,999	42	36	30				
6,000 to 7,999	57	51	45	24	18		
				39	33	27	21
8,000 to 9,999	72	66	60	54	48	42	36
10,000 to 11,999	86	80	74	68	62	56	50
12,000 to 13,999	101	95	89	83	77	71	65
14,000 to 15,999	116	110	104	98	92	86	80
16,000 to 17,999	131	125	119	113	107	101	95
18,000 to 19,999	145	139	133	127	121	115	109
20,000 to 21,999	160	154	148	142	136	130	124
22,000 to 23,999	175	169	163	157	151	145	139
24,000 to 25,999	190	184	178	172	166	160	154
26,000 to 27,999	205	199	193	187	181	175	169
28,000 to 29,999	220	214	208	202	196	190	184
30,000 to 31,999	234	228	222	216	210	204	198
32,000 to 34,000	249	243	237	231	225	219	213