

The left hand member of Equation 13 represents the total amount of available draft created by the pressure transformer, that is, the natural draft chimney, Venturi chimney, or fan, and is equal to the theoretical intensity less the internal losses incidental to operation. The right hand member represents the sum of all of the various losses of draft throughout the entire boiler plant installation outside of the pressure transformer itself. The left hand member expresses the available intensity and is analogous to the head developed by a centrifugal pump in a water works system, while the right hand member expresses the required draft in-

TABLE 1. RECOMMENDED MINIMUM CHIMNEY SIZES FOR HEATING BOILERS AND FURNACES^a

WARM AIR FURNACE CAPACITY IN SQ. IN. OF LEADER PIPE	STEAM BOILER CAPACITY SQ. FT. OF RADIATION	HOT WATER HEATER CAPACITY SQ. FT. OF RADIATION	NOMINAL DIMENSIONS OF FIRE CLAY LINING IN INCHES	RECTANGULAR FLUE		ROUND FLUE		HEIGHT IN FT. ABOVE GRATE
				Actual Inside Dimensions of Fire Clay Lining in Inches	Actual Area Sq. In.	Inside Diameter of Lining in Inches	Actual Area Sq. In.	
790	590	973	8½ x 13	7 x 11½	81			35
1000	690	1,140				10	79	
	900	1,490	13 x 13	11¼ x 11¼	127			
	900	1,490	8½ x 18	6¾ x 16¾	110			40
	1,100	1,820				12	113	
	1,700	2,800	13 x 18	11¼ x 16¼	183			
	1,940	3,200				15	177	
	2,130	3,520	18 x 18	15¾ x 15¾	248			
	2,480	4,090	20 x 20	17¼ x 17¼	298			45
	3,150	5,200				18	254	50
	4,300	7,100				20	314	
	4,600	7,590	20 x 24	17 x 21	357			55
	5,000	8,250	24 x 24	21 x 21	441			
	5,570	9,190		24 x 24 ^b	576			
	5,580	9,200				22	380	60
	6,980	11,500				24	452	65
	7,270	12,000		24 x 28 ^b	672			
	8,700	14,400		28 x 28 ^b	784			
	9,380	15,500				27	573	
	10,150	16,750		30 x 30 ^b	900			
	10,470	17,250		28 x 32 ^b	896			

^aThis table is taken from the A.S.H.V.E. Code of Minimum Requirements for the Heating and Ventilation of Buildings (Edition of 1929).

^bDimensions are for unlined rectangular flues.

tensity and is analogous to the total dynamic head in a water works system. For a general circulation of gases

$$D_a = D_r \quad (14)$$

where

D_a = available draft intensity, inches of water.

D_r = required draft, inches of water.

The draft loss through the fuel bed (h_F), or the amount of draft required to effect a given or required rate of combustion, varies between wide limits and represents the greater portion of the required draft. In coal-fired

installations, the draft loss through the fuel bed is dependent upon the following factors: (1) character and condition of the fuel, clean or dirty; (2) percentage of ash in the fuel; (3) volume of interstices in the fuel bed, coarseness of fuel; (4) thickness of the fuel bed, rate of combustion; (5) type of grate or stoker used; (6) efficiency of combustion.

There is a certain intensity of draft with which the best results will be obtained for every kind of coal and rate of combustion. Fig. 7 gives the intensity of draft, or the vacuum in the combustion chamber required to burn various kinds of coal at various rates of combustion. Expressed in other words, these curves represent the amount of draft required to force the necessary amount of air through the fuel bed in order to effect various rates of combustion. It will be noted that the amount of draft increases as the percentage of volatile matter diminishes, being comparatively low

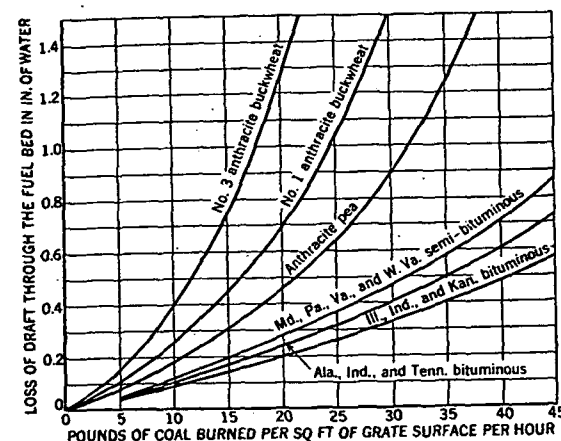


FIG. 7. DRAFT REQUIRED AT DIFFERENT RATES OF COMBUSTION FOR VARIOUS KINDS OF COAL

for the lower grades of bituminous coals and highest for the high grades and small sizes of anthracites. Also, when the interstices of the coal are large and the particles are not well broken up, as with bituminous coals, much less draft is required than when the particles are small and are well broken up, as with bituminous slack and the small sizes of anthracites. In general, the draft loss through the fuel bed increases as: (1) the percentage of volatile matter diminishes; (2) the percentage of fixed carbon increases; (3) the thickness of the bed increases; (4) the percentage of ash increases; (5) the volume of the interstices diminishes.

In making the preliminary assumptions for the draft loss through the fuel bed, due allowances should be made for a possible future change in the grade of fuel to be burned and also in the rate of combustion. A value should be selected for this loss which will represent not only the highest rate of combustion which will be encountered, but also the grade of coal which has the greatest resistance through the fuel bed and which may be burned at a later date.