thermal liquids

A NEW CONCEPT IN HEATING

O/FF-20

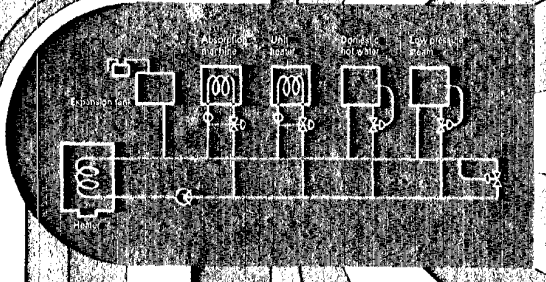

Monsanto

0067374

thermal fluids A NEW CONCEPT IN HEATING

TOWOLDMON0021516
WATER_PCB-00005985

TABLE OF CONTENTS

Convert To Therminol for Dramatic Savings . . 2
Total Therminol Systems in New Buildings . . 4
Therminol for Heating and Cooling in Campus-type Buildings 6
Therminol FR-1 7
Therminol FR Safety of Handling 9

thermal liquids A NEW CONCEPT IN HEATING

Therminol® high temperature liquid phase heating offers new answers to questions you may be facing in heating system design. Questions like:

- **How do you lower the capital investment for heating/cooling equipment?**
- **How do you cut operating costs — particularly rising labor expenses?**
- **How do you save valuable floor space?**
- **How can your system meet rapid changes in heat demand?**
- **How can heating system safety be maximized?**

A liquid phase system designed around Therminol heat transfer fluid – in a new building or in the modernization of an old one – may be your answer to many or all of these questions.

0067375

TOWOLDMON0021517
WATER_PCB-00005986

CONVERT TO

THERMINOL FOR DRAMATIC SAVINGS

When the need to modernize a heating system arises, you will find that Therminol liquid phase heating offers:

- *Superior operating efficiency*
- *Automatic unattended systems — minimum attention by non-licensed personnel*
- *Maintenance reduced by up to 80 percent*
- *Easy conversion and installation*

Operating Savings

The use of high temperature Therminol eliminates the need for system pressurization. A high temperature primary loop (see diagram, p. 3) is vented to an atmospheric liquid trap, usually enabling the heaters to be classified as non-pressurized vessels. Non-pressurized or low pressure heating equipment requires only minimum attention by non-licensed personnel.

Cut Maintenance Costs

Operation of the new plant is entirely automatic except for pu

ventive and operational maintenance and system shutdown and startup. These operations can be performed by the regular building maintenance staff.

Easy Conversion and Installation

Installation basically involves replacing steam boilers with fluid heaters. A steam generator can furnish hot water during the conversion to minimize inconvenience to your building's occupants. Each of the fluid heaters are connected to heat exchangers. These converters generate hot water for building heating and domestic hot water heating and steam for kitchen equipment, garage heating systems and the building ventilation. Two pumps recirculate the fluid between heaters and converters.

Space No Problem

All system changes can be confined to the previous boiler room area. Existing piping and equipment for the secondary services, including building heating service pumps, domestic hot water pumps, and condensate receivers remain in place. Thus, your building's services can continue to utilize water and steam as before.

River House Cooperative Apartments - Detroit

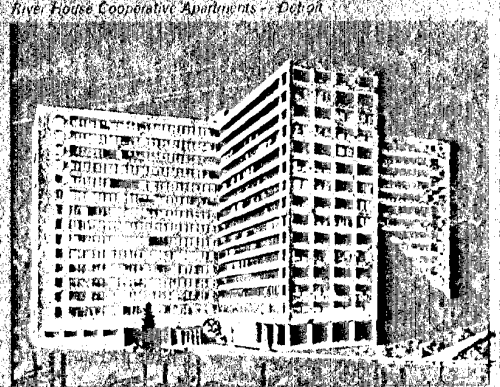

This system, which has been in operation for more than five years, provides an annual savings of $35,000 compared to the old steam systems. $25,000 through the elimination of licensed boiler operators and $11,000 through reduced fuel costs. The latter saving results from an increase in over-all efficiency from 60 percent with the old system to 83 percent with the new, and from switching to gas firing.

TOWOLDMON0021518
WATER_PCB-00005987

Holy Cross Hospital – Detroit

The conversion of this 250 bed hospital addition to Thermal liquid phase heating yielded an annual savings of $40,000 in operating costs. This saving was estimated to pay for the cost of conversion in three years. Moreover, the improved efficiency of the system added additional savings through lower fuel costs. J. P. Noble, Detroit consulting engineer, received the first hydronic award for mechanical engineering in the 1962 awards competition of the Consulting Engineer Council of Michigan for his design of this system.

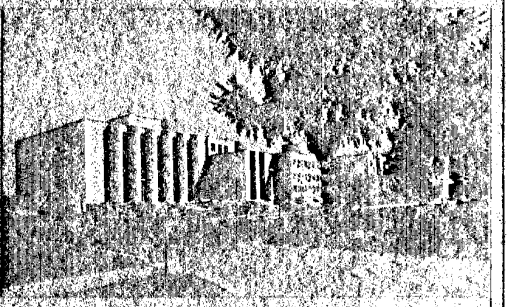

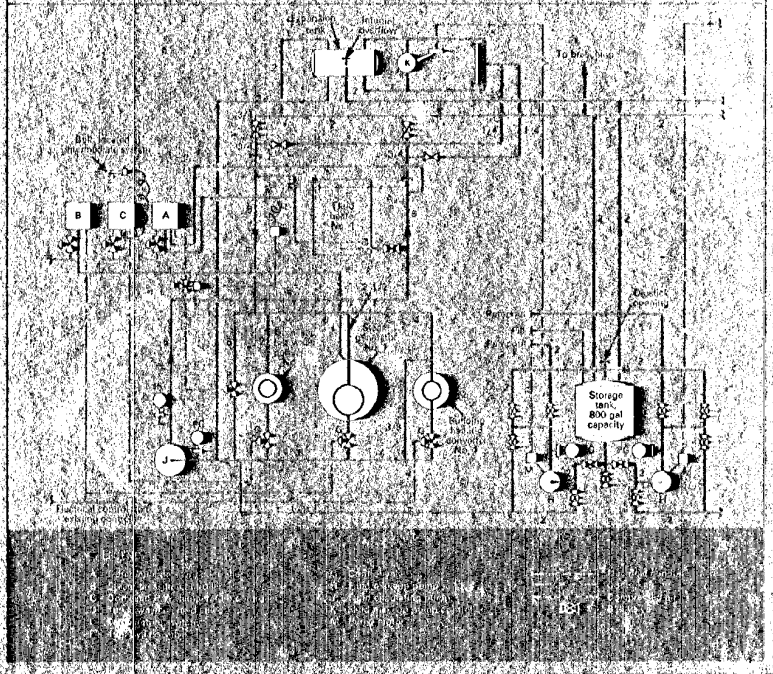

0067377

TOWOLDMON0021519
WATER_PCB-00005988

TOTAL THERMINOL SYSTEMS IN

NEW

BUILDINGS

From open flame, to steam, to liquid phase fluids. Unhappy with early direct-fired heating, engineers centralized the fire and used steam to bridge the gap. Now you can bridge that gap more efficiently with new, high temperature liquid phase heating. Some examples of the ways others have designed Therminol into their heating systems are detailed on this page.

Therminol Versus Steam in an Eleven Story Hospital

Kaiser Engineers sought the most economical heating system for the Tower addition to an Oakland, Calif. Hospital. Consequently, they made a detailed analysis of steam versus Therminol for their 243,000 square foot expansion. Their findings:

• Therminol's initial installation cost is *$21,850 less than steam.*

The reduction in capital costs was due to the elimination of low and high pressure steam boilers, deaerator feed water heaters, condensate drainage system for absorption chillers, steam piping, related equipment and mechanical equipment floor space.

• Therminol's operating cost is *$8,000 less than steam,* a *22* percent annual savings.

The reduction in annual operating costs were due primarily to the anticipated added thermal efficiency of the Therminol System and the reduction in preventative maintenance and repair. It was projected that if licensed boiler operators had been required, as is generally the case, an additional operating savings of approximately $25,000 per year would have been realized by utilizing the Therminol System approach.

In addition to these outstanding cost savings, the study found Therminol:

1. Provided excellent response to building load changes.
2. Presented no need for boiler blowdown and venting.
3. Offered increased safety because of the non-pressure characteristics of the system.

On this basis, a number of hospitals have used Therminol in their heating systems or incorporated it into their designs.

Diagrams detailing the design of these two systems are on the next page.

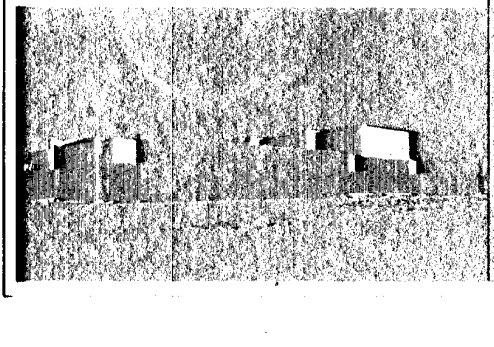

This Monsanto office and laboratory building in Akron, Ohio, was the first to use a high temperature, non-pressurized, fire resistant flight system for all direct heat needs. These include refrigeration, pre-heat, re-heat, baseboard, steam generation and hot water. The completely automatic and unattended system utilizes conventional off the shelf heating and air conditioning hardware. Installation costs were $10.50 per square foot, or 1% percent of the total building cost.

0067373

TOWOLDMON0021520
WATER_PCB-00005989

These two blueprint designs of a Therminol liquid heating system (top) compared to a conventional steam system (bottom) dramatize the reasons Therminol reduces installation and operating costs. The basic simplicity of a Therminol system – without five high pressure steam boilers, a smaller water treatment system, deaerator, etc. – makes it more efficient and takes up less space.



THERMINOL

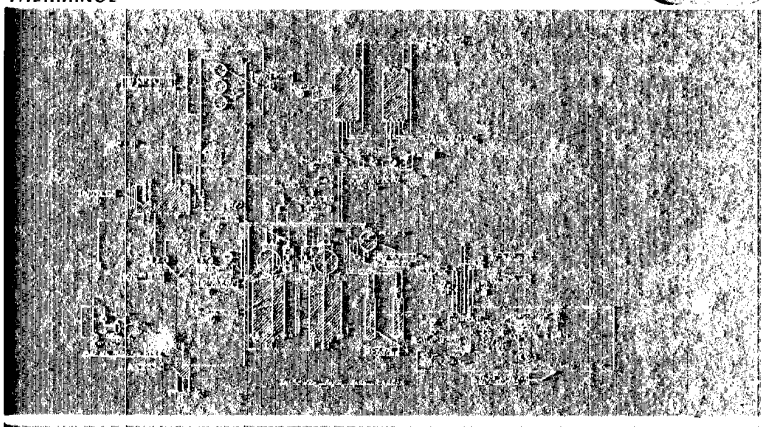

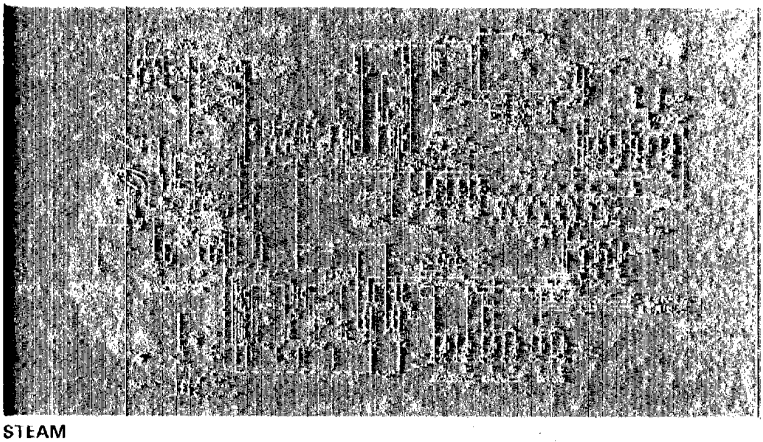

STEAM

TOWOLDMON0021521
WATER_PCB-00005990

THERMINOL FOR HEATING AND COOLING IN

CAMPUS-TYPE

BUILDINGS

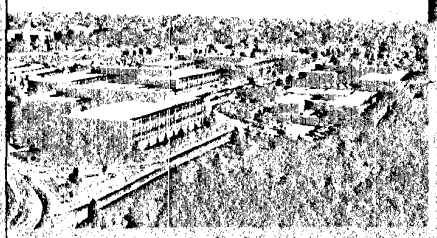

In addition to high-rise structures, Therminol heating systems offer considerable savings for campus-type buildings. Ferris & Hamig, Inc., St. Louis consulting engineers, prepared a feasibility study comparing a conventional system with high pressure steam distribution to four varieties of Therminol systems.

The Monsanto office complex in Creve Coeur, Missouri, was used as a basis for comparison. This complex comprises a powerhouse and five office buildings totalling 425,000 square feet and including a cafeteria and kitchen.

Here's a summary of the five systems and their comparative costs:

System	Description	Initial and Operating Cost*
1.	High pressure steam distribution to the five office buildings; with steam pressure reduced in each building to 10 lbs. pressure. Low pressure steam was distributed to heating coils in the air conditioning units. A central electric motor driven centrifugal water chilling system with condensing water pumps and cooling tower would be installed in the powerhouse. Chilled water mains would be run parallel to the steam mains in the tunnels with branches to the air conditioning units in each building.	$38,997
2.	Varies from No. 1 in that Therminol heaters replace pressure boilers. Therminol supply and return piping are used in the tunnel with branches to each building. At each building a booster pump with a three-way valve would be installed to reduce the temperature of Therminol from 550° to about 275°. The Therminol would then be pumped to heating coils in the air conditioning units. The water chilling system would be the same as in No. 1.	$52,565
3.	This system is the same as No. 2 except that centrifugal water chillers would be replaced by absorption units in the powerhouse; the cooling tower and condensing water pumps would be increased to reject the additional heat from the absorption units.	$83,514
4.	This system varies from No. 3 in that individual absorption units will be installed in each building. Condensing water from a central cooling tower and condensing water pumps at the powerhouse will supply condensing water through the tunnel to these units.	$94,806
5.	This system varies from No. 4 in that individual cooling towers and condensing water pumps would be installed in each building.	$77,476

*These costs *do not* include savings in labor.

The report's conclusion: for this campus application, a Therminol heating system costs less than a conventional system using high pressure steam. And, in addition to eliminating an operating engineer on each shift, the Therminol system would offer: no trap maintenance, no water treatment and lower liability insurance rates.

0067380

TOWOLDMON0021522
WATER_PCB-00005991

THERMINOL FR-1

The Monsanto Therminol heat transfer fluids have been used for a number of years in a variety of heat transfer applications, from rubber molding to resin cooking. Therminol FR-1 represents the best fluid for space heating systems. Therminol FR-1 is unique. It permits installation of a non-pressurized system operating with a liquid which has no fire point and will not support combustion over its use temperature range. Therminol FR-1 is so fire-resistant, it has been certified by UL and approved by Factory Mutual.

THERMINOL FR-1

Typical Properties

Composition	chlorinated biphenyls
Appearance	oily, clear, nearly colorless liquid
Pour Point	2°F.
Density @ 75°F.	11.56 lbs./gal.
Flash Point	360°F.
Fire Point	none to boiling
AIT	greater than 1200°F.
Boiling Range	
10%	620°F.
Dry Point	680°F.

PHYSICAL PROPERTIES - Therminol FR-1

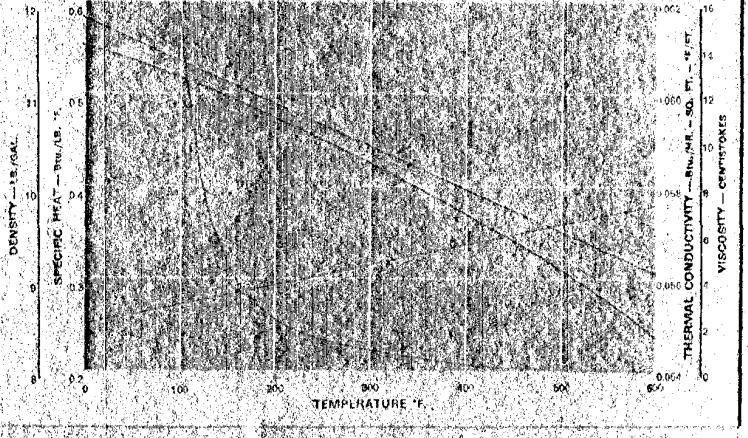

0067351

TOWOLDMON0021523
WATER_PCB-00005992

THERMINOL FR-1 – PRESSURE DROP – psi/100 FOOT

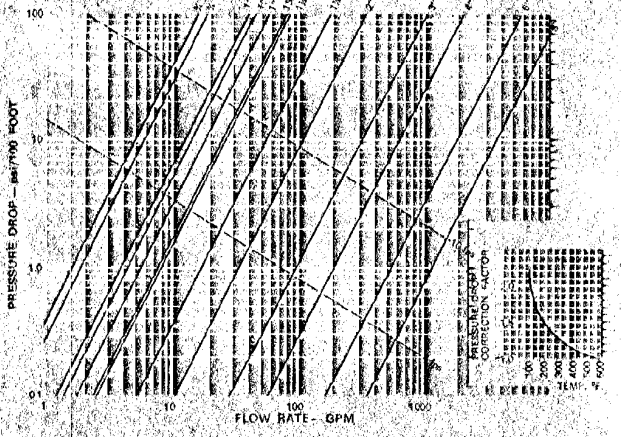

THERMINOL FR-1 – HEAT TRANSFER FILM COEFFICIENT

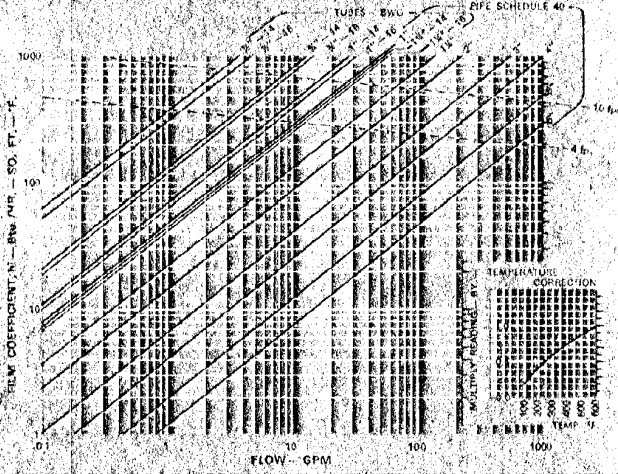

0067342

TOWOLDMON0021524
WATER_PCB-00005993

DO YOU NEED MORE INFORMATION?

If the Therminol concept of heating system design interests you, let's talk some more. Our local fluid specialist can give specific answers to your questions about designing and specifying a Therminol system. Or tell you more about high temperature, liquid phase heating in general.

JUST SEND IN THIS CARD!

[ ] Call for an appointment.
[ ] Drop by any time.

THERMINOL FR-1

Name_____

Title_____

Company_____

Address_____

City, State_____ ZIP_____

Phone_____

JUST SEND IN THIS CARD!

☐ Call for an appointment.
☐ Drop by any time.

THERMINOL FR-1

Name_____

Title_____

Company_____

Address_____

City, State_____ ZIP_____

Phone_____

0067383

TOWOLDMON0021525
WATER_PCB-00005994

FIRST CLASS
PERMIT
NO. 3016
ST. LOUIS, MO.

POSTAGE WILL BE PAID BY

Monsanto

800 North Lindbergh Boulevard
St. Louis, Missouri 63166

ATTN. DEPT. 323

FIRST CLASS
PERMIT
NO. 3016
ST. LOUIS, MO.

POSTAGE WILL BE PAID BY

Monsanto

800 North Lindbergh Boulevard
St. Louis, Missouri 63166

ATTN. DEPT. 323

0067394

TOWOLDMON0021526
WATER_PCB-00005995

DISTRICT SALES OFFICES ALL DIVISIONS

AKRON, OHIO 44313
260 Springside Drive
Montrose Development Park
Tel. (216) 666-4111

ATLANTA, GEORGIA 30339
320 Interstate North Parkway
Suite 500
Tel. (404) 432-7111

BOSTON, MASSACHUSETTS 02149
Everett Station
Tel. (617) 387-5010

CHICAGO, ILLINOIS
3158 Des Plaines Ave.
Des Plaines, Illinois 60018
Tel. (312) 296-6668

CINCINNATI, OHIO 45206
1501 Madison Road
Tel. (513) 751-6707

DETROIT, MICHIGAN
500 Northland Towers West
Southfield, Mich. 48075
Tel. (313) 357-0910

HONOLULU, HAWAII 96812
205 Pacific International Bldg.
677 Ala Moana Blvd., P. O. Box 3824
Tel. (808) 531-2744

HOUSTON, TEXAS 77027
1301 Post Oak Tower
5051 Westheimer Road
Tel. (713) 621-9550

LOS ANGELES, CALIFORNIA 90022
6670 E. Flotilla St.
Tel. (213) 723-2492

NEW YORK, NEW YORK 10017
277 Park Avenue
Tel. (212) 922-4111

ST. LOUIS, MISSOURI 63166
800 N. Lindbergh Blvd.
Tel. (314) 694-1000

SAN FRANCISCO BAY AREA
2710 Lafayette, Santa Clara, Calif. 95052
Tel. (408) 243-0414

SEATTLE, WASHINGTON 98121
2112 Third Avenue
Tel. (206) 622-4203

WILMINGTON, DELAWARE 19803
2005 Concord Pike, Fairfax
Tel. (302) 658-6591

THERMINOL FR SAFETY OF HANDLING

On the basis of animal toxicity studies, THERMINOL FR may be considered only slightly toxic from the standpoint of accidental massive skin exposure or accidental ingestion. Similarly, single exposures to high concentrations of vapors (when heated sufficiently to volatilize) or high concentrations of decomposition products (if the fluid is accidentally discharged into the fire chamber) are not serious hazards because the irritating character of such concentrations preclude voluntary exposure.

Repeated or prolonged skin exposure should be avoided since THERMINOL FR acts as a solvent for fats and oils of the skin. Removal of these natural, protective barriers can lead to drying and chapping such as occurs with exposures to paint thinners. More important, THERMINOL FR may be absorbed if it is allowed to remain on the unbroken skin. For these reasons, we recommend that the skin be washed with soap and water if there is contact. A skin burn resulting from accidental contact with hot fluid should be treated in the normal manner for any thermal burn due to hot oils.

Because of its low vapor pressure, there is no significant vapor inhalation hazard when THERMINOL FR is at room temperature. For example, there is no vapor exposure problem while transferring the fluid from its shipping container to the heat transfer system. On the other hand, the vapors emitted by THERMINOL FR heated to elevated temperatures are injurious on prolonged exposure. It is indicated that the "threshold limit value" or atmospheric vapor concentration which cannot be safely exceeded (on a daily basis) is 0.5 — 1.0 milligrams of THERMINOL FR vapor per cubic meter of air in the workroom. In heat transfer installations, the fluid must be used in a closed, unpressurized system free from leaks with the expansion tank vent trapped so as to condense any vapors. Accordingly, there should be little or no opportunity for workers to come in contact with vapors.

Environmental Considerations

Therminol FR is a stable, long-lasting chemical. Consequently, measures to avoid environmental contamination through spillage, leakage, or careless disposal should be observed.

Therminol FR heat transfer fluids contain polychlorinated biphenyls (PCB). PCB residues in small amounts have been found in the environment, and some studies indicate that they may be harmful to certain forms of animal life. Every care should be taken by users of Therminol FR fluids, or any other PCB-containing products, to prevent entry into the environment through spills, leaks, disposal, vaporization or everyday use and handling.

0067385

"Nothing contained herein is to be construed as a recommendation to use any product in conflict with any patent. MONSANTO MAKES NO WARRANTIES AS TO THE FITNESS OR MERCHANTABILITY OF ANY PRODUCTS REFERRED TO, no guarantee of satisfactory results from reliance upon contained information or recommendations, and disclaims all liability for any resulting loss or damage."

TOWOLDMON0021527
WATER_PCB-00005996

MONSANTO COMPANIES AND OFFICES

Argentina
Monsanto Argentina S.A.I.C.
Tucuman 117
Buenos Aires

Australia
Adelaide
Monsanto Australia Limited
P.O. Box 1111K Adelaide
South Australia 5001
Brisbane
Monsanto Australia Limited
P.O. Box 53, Hamilton Central
Queensland 4007
Melbourne
Monsanto Australia Limited
East Tower, Princes Gate
161 Flinders Street
Perth
Monsanto Australia Limited
P.O. Box 90
Applecross
West Australia 6153
Sydney
Monsanto Australia Limited
P.O. Box 4
Rozelle
N.S.W. Australia 2039

Austria
Monsanto G.m.b.H.
Rudolfplatz 12
Wien 1

Belgium
Monsanto Europe S.A.
1, Place Madou
Brussels 3

Belgium/Luxembourg
Monsanto Europe N.V.
163, Mechelsesteenweg
Antwerp 1

Brazil
Monsanto Comercio e Industria Ltda.
Rua Araujo 216, 6° Andar
Sao Paulo

Canada
Montreal
Monsanto Canada Limited
Suite 1450
Place de Canada
Montreal 101
Edmonton
Monsanto Canada Limited
P.O. Box 416
Edmonton, Alberta
Toronto
Monsanto Canada Limited
175 Rexdale Boulevard
Rexdale, Ontario
Vancouver
Monsanto Canada Limited
1550 Rand Avenue
Vancouver 14, B.C.

Chile
Monsanto Chile Comercial e Industrial Ltda.
Edificio Espana, Oficinas 502
Calle Estado 337
Santiago

Colombia
Monsanto Colombiana, Inc.
Carrera 15 No. 77-50
Bogota

Dominican Republic
Monsanto Dominicana, Inc.
Josefa Perdomo 17
Esquina Pasteur
Santo Domingo

El Salvador
Monsanto Centroamerica (El Salvador) S.A.
Edificio Plaza
67 Avenida Sur y Calle a Santa Tecla
San Salvador

France
Societe Monsanto
9, rue d'Argenson
Paris 8me

Germany
Monsanto (Deutschland) G.m.b.H.
3 Immermannstrasse
4000 Dusseldorf 1

Guatemala
Monsanto Centroamerica (Guatemala) S.A.
7a Avenida 11-89 Zona 9
Edificio Galerias Espana
Guatemala City

Hong Kong
Monsanto Far East Limited
Fifth Floor, New Henry House
Ice House Street

India
Bombay
Monsanto Chemicals of India Private Ltd.
Wakefield House
11 Sprott Road, Ballard Estate
Bombay 1
Calcutta
Monsanto Chemicals of India Private Ltd.
19 Rajendranath Mukherjee Road
Calcutta 1
Madras
Monsanto Chemicals of India Private Ltd.
Cathiness Hall
370-371 Linghi Chetty Street
Madras 1
New Delhi
Monsanto Chemicals of India Private Ltd.
3/8 Asaf Ali Road
Near Turkman Gate

Israel
Israel Chemical Fibres Limited
Industrial Zone
Ashdod

Italy
Monsanto Italiana S.p.A.
24 Via F. Filzi
20124 Milano

Japan
Monsanto Japan Ltd.
Room 623, Chiyoda Building
14, 2-chome Chiyoda-ku
Tokyo
Mitsubishi Monsanto Chemical Co.
Mitsubishi Main Building
5-2, Marunouchi 2-chome
Chiyoda-ku
Tokyo 100

Malaysia
Monsanto Far East Ltd.
116 Jalan Semangat
Petaling Jaya
Selangor

Mexico
Monsanto Mexicana, S.A.
Thiers No. 248
Colonel Anzures
Mexico 5

Netherlands
Monsanto N.V.
Jan van Nassaustraat 53/55
The Hague

Nicaragua
Monsanto (Nicaragua) S.A.
Apartado Postal 288
Managua

Pakistan
Karachi
Monsanto Overseas S.A.
Dinshaw House Flat D-3
No. 4 Bath Island Hill
Karachi 4
Lahore
Monsanto Overseas S.A.
P.O. Box No. 1226
Lahore 4

Philippines
Monsanto Philippines Inc.
Suite 314, Rufino Building
6784 Ayala Avenue
Makati, Rizal, D-708

Puerto Rico
Monsanto Inter-America Co.
P.O. Box 837 Hato Rey Station
Hato Rey 00919

Singapore
Monsanto Singapore Co. (Pte.) Ltd.
Gelmuin Building, 2nd Floor
241 River Valley Road
Singapore 9

South Africa
Monsanto South Africa (Pty.) Ltd.
85 Russik Street
Johannesburg

Spain
Monsanto Iberica, S.A.
Laporte 350
Barcelona 53

Sweden
Monsanto (Scandinavia) AB
Ulvsundavagen 106
Bromma — Stockholm

Taiwan
Monsanto Far East Limited
23 Chung Shan North Road
7th Floor, Section 2
Taipei

Thailand
Monsanto Thailand Limited
Thai Farmers Bank Building
142 Silom Road
Bangkok

United Kingdom
Monsanto Chemicals Limited
10-18 Victoria Street
London S.W. 1

U.S.A.
Monsanto Company
800 North Lindbergh Boulevard
St. Louis, Missouri 63166

Venezuela
Monsanto (Venezuela) C.A.
Torre Phelps — Piso 24
Plaza Venezuela
Caracas

Representatives in principal cities of the world

2-3074-0471-92 LITHO IN U.S.A.

0067386

TOWOLDMON0021528
WATER_PCB-00005997