



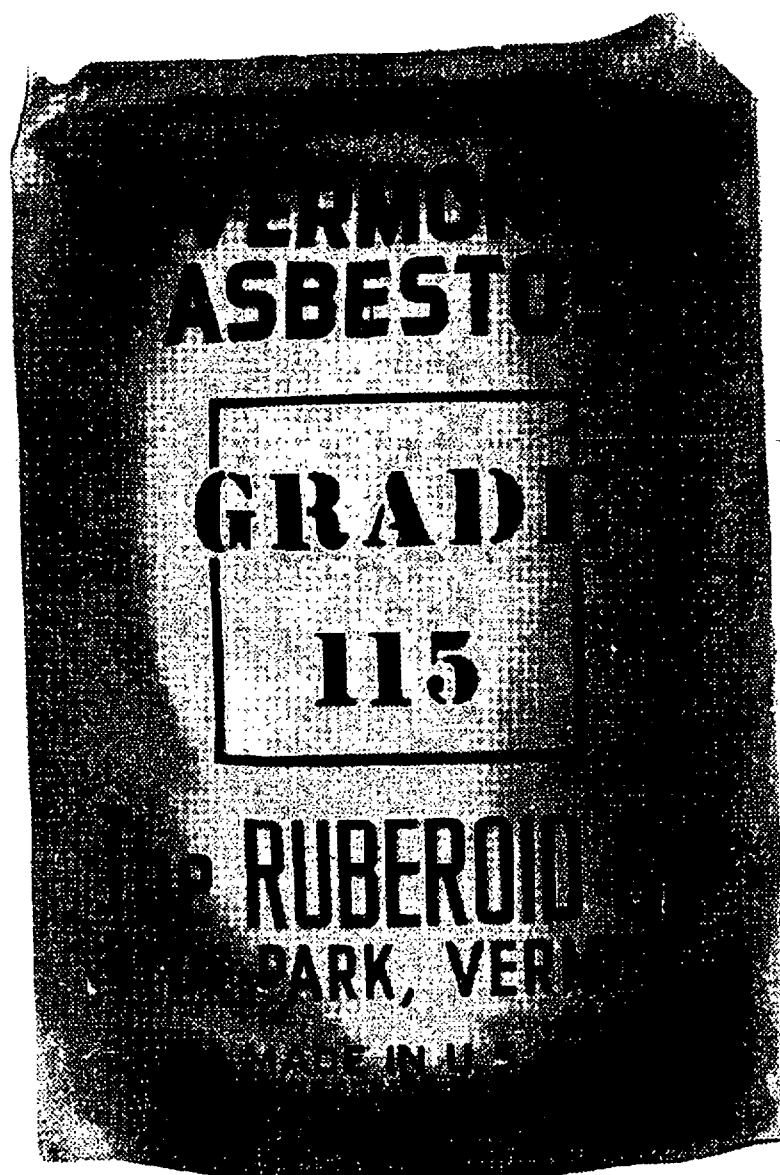

GAF 22689

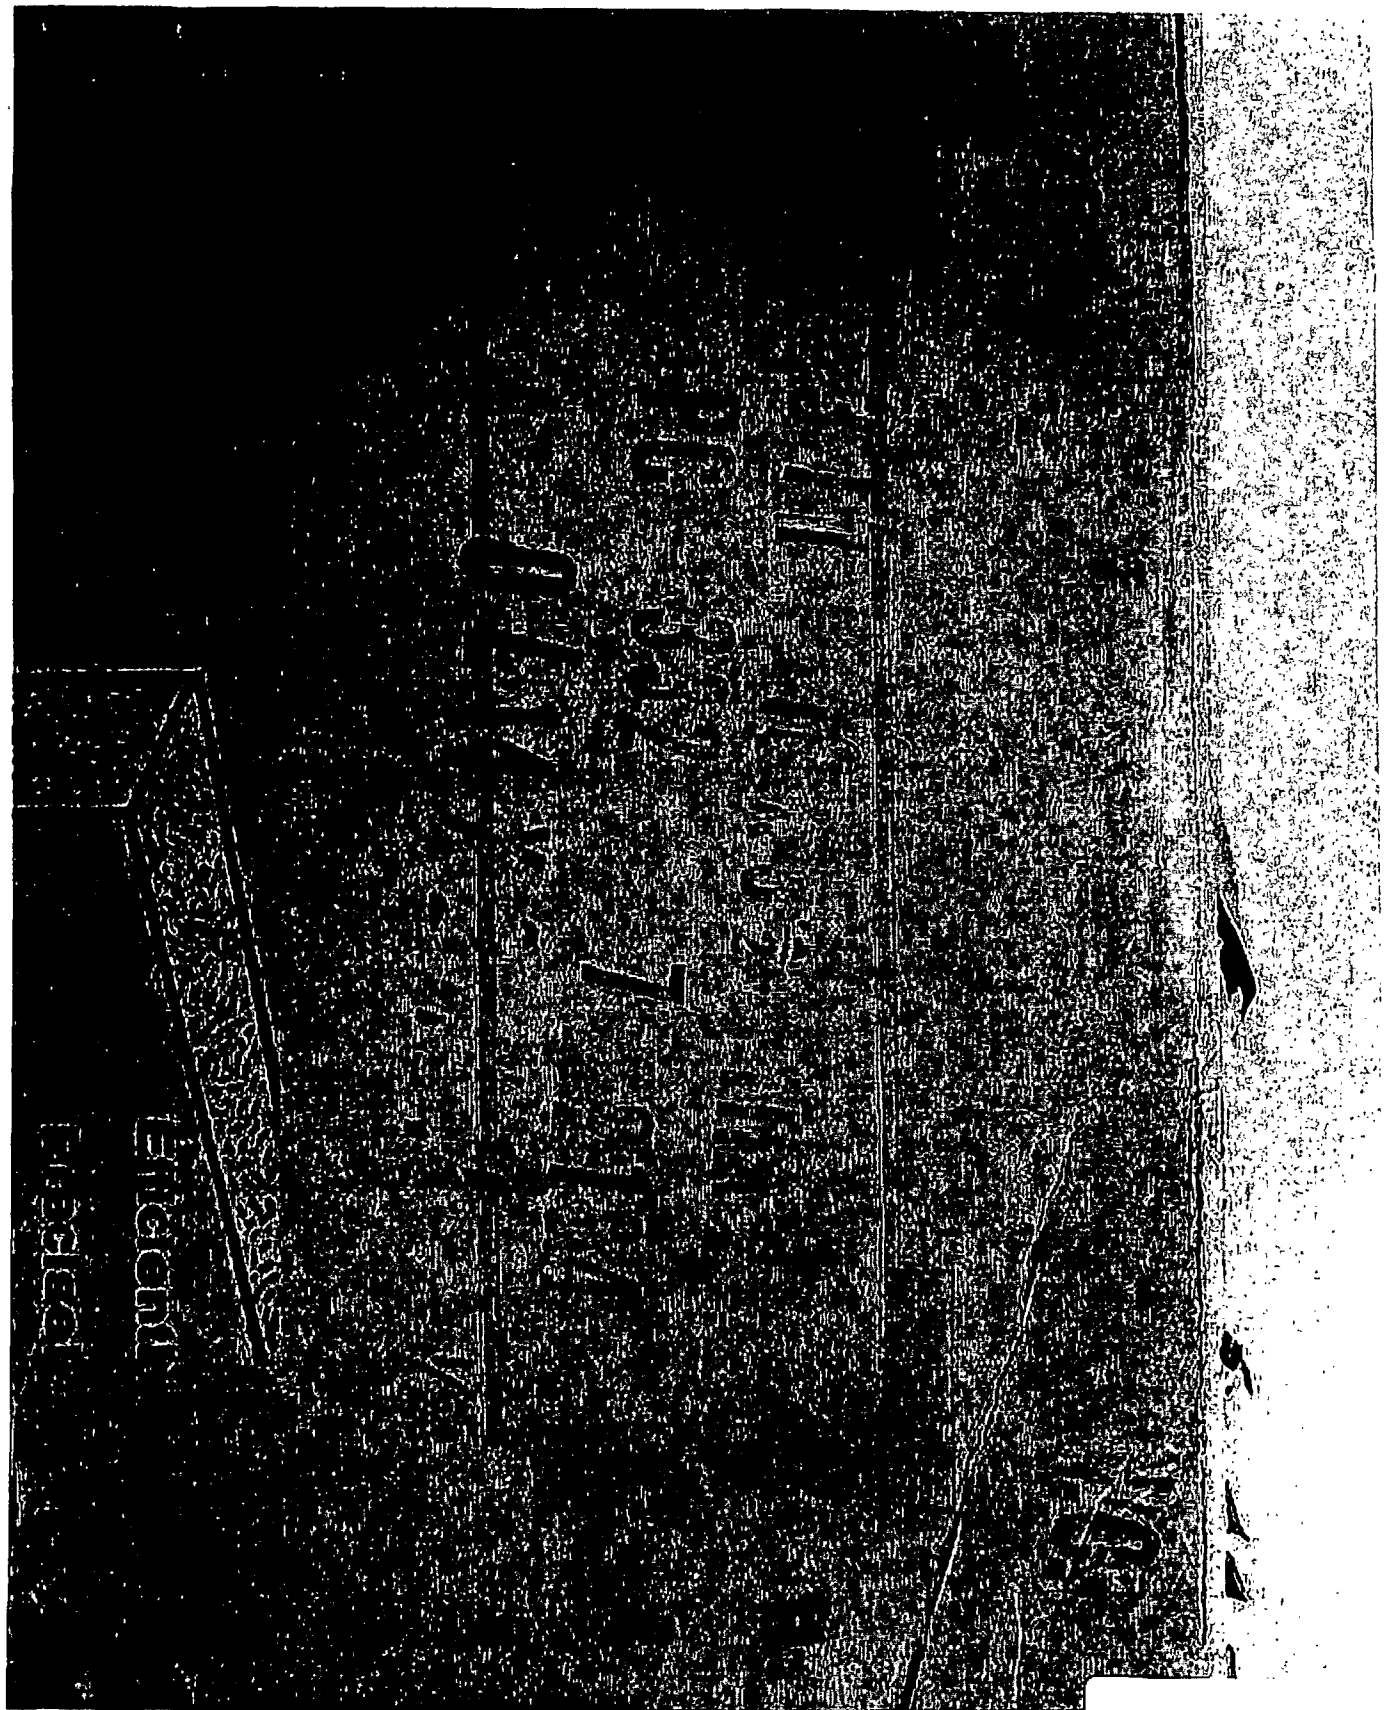

GAF 22688

07 96 10 2007

GAF 22690

3/11 10/15/54
PC 352 7 11/24
044X



GAF 22691



W
Y

West Virginia Rule and Paper

222

0-75415


GAF 22692

BLT 2 1 1 36 11
21 SC 1 212 2 7

NEW!



CALSILITE
PRESSURE MOLDED
THERMAL INSULATION

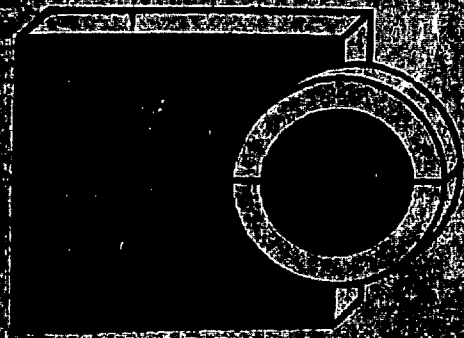

GAF 22693

CAUTION

EXCESSIVE FIBER INHALATION IN
WORK AREAS OVER LONG PERIODS
CAN CAUSE LUNG DISEASE.

USE APPROPRIATE
VENTILATION SYSTEMS TO KEEP
FIBER LEVELS BELOW 0.5 PER CUBIC
FOOT OF AIR. ALWAYS WEAR
PROPER RESPIRATORY PROTECTION
WHEN WORKING IN AREAS WITH
HIGH FIBER LEVELS.

GAF 22695



GAF 22694