


APPLICATION
BASIC INSULATION
PIPE AND FITTINGS

CALCIUM SILICATE
SINGLE LAYER:

- B 3.6 "K" segmental covering.
- 6a. If an even number of lags are required to encircle the pipe they shall be cut and applied the same as quad-segmental, as described in para. 3.5 a&b and figures 7 A&B. The required number of segments necessary to stagger all butt joints shall be cut.
- 6b. If an uneven number of segments are required they shall be cut and applied the same as tri-segmental as described in para. 3.4 a&b, and figures 5&6. The required number of segments necessary to stagger all butt joints shall be cut.
- C. Securing Pipe Insulation
- C. 1. The use of wire or bands to secure pipe covering and the number of each required shall depend upon the O.D. of the insulation and whether it is sectional or segmental.
- C. 2. Sectional Covering
- 2.1 Sectional covering having an O.D. of 6-1/2" or less shall be secured with 5 wraps of 18 ga. s/s wire positioned as shown in figure 8.

Fig. 8
Top View

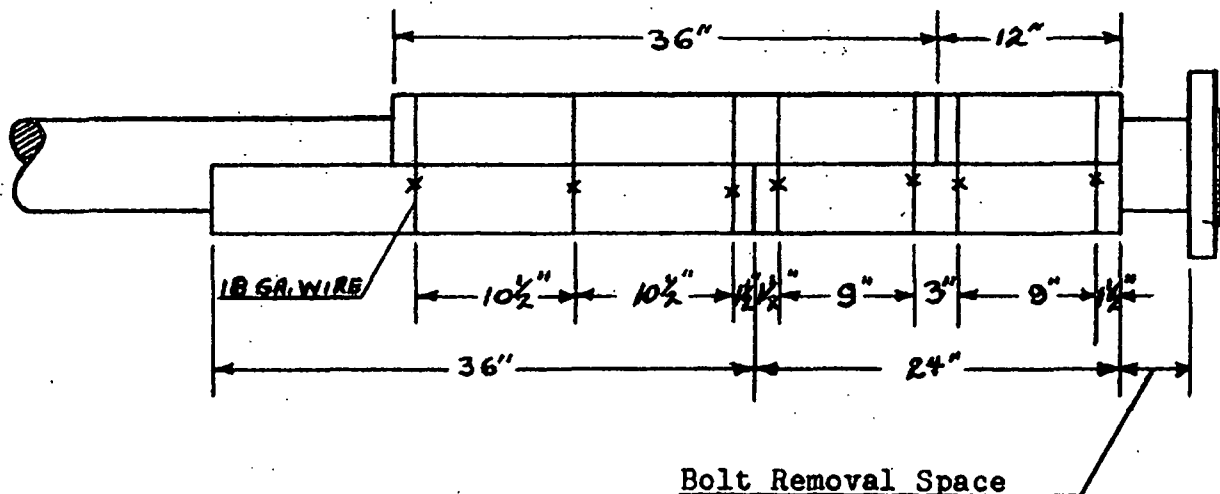

- 2.2 Sectional covering having an O.D. above 6-1/2 in. up to and including 9 inches shall have 5 wraps of 16 ga. s/s wire positioned as shown in figure 9.