

SECTION V A-1a.14

APPLICATION
BASIC INSULATION
PIPE AND FITTINGS

CALCIUM SILICATE
SINGLE LAYER:

- 2.1 This type hanger has a relatively thin strap and both 1 inch and 1-1/2 inch thick covering shall be routed out to fit over the strap, allowing a minimum of void as shown in Fig. 20A.
- 2.2 450 cement shall be packed between the hanger straps around the spreader bolt and over the exposed portion of the hanger, as shown in Figures 20 B & C.

Fig. 20A

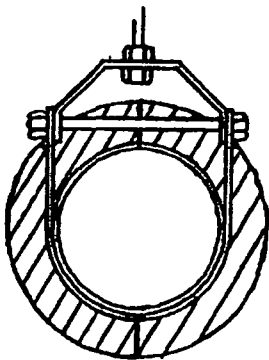


Fig. 20B


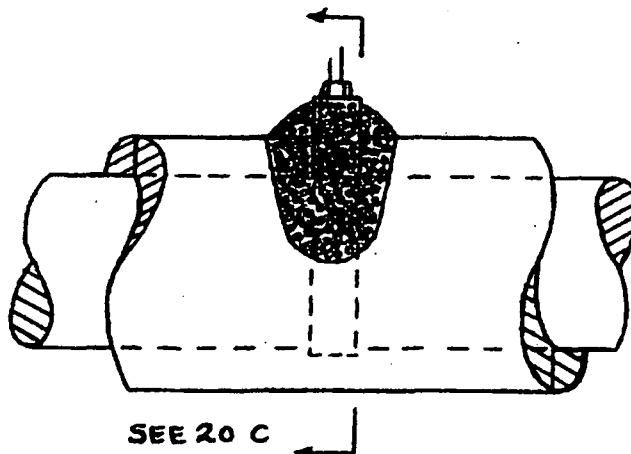


Fig. 20C

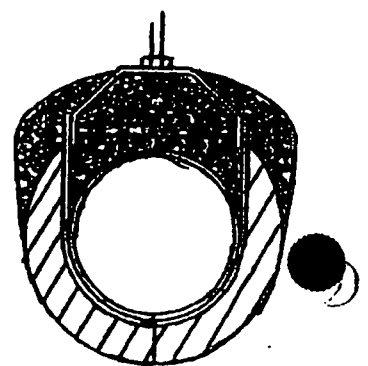

D. 3. Rigid supports; Figures 21 & 22

Fig. 21






Fig. 22

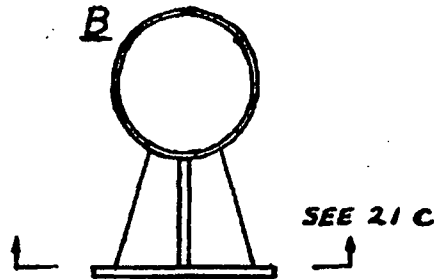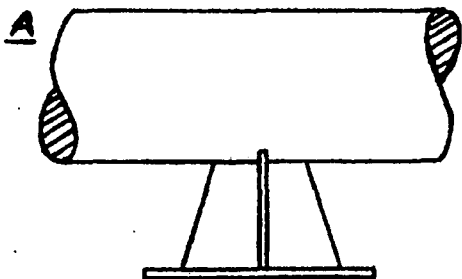